



Fire alarm systems Addressable manual call point 3333

- Attractive design compliant with EN54-11
- Test key for routine testing without breaking the glass element
- Protection against accidental operation

General

The call point has an attractive design compliant with EN54-11, and is either surface mounted in the supplied red backbox or recess mounted in a standard UK single gang box or a Swedish 65 mm circular backbox. It has a clip retained front cover that makes it easy to replace the glass element and adds security since the clips are concealed. The frangible element is a glass element with a protective plastic film. To operate the call point, the glass element is pressed until it is broken. This will activate the built-in microswitch, which will generate a fire alarm in the c.i.e.

Test key

Routine testing is made with a supplied test key, without breaking the glass element. Inserting the test key simulates the breaking of the glass element. The call point is automatically reset when the test key is removed. The test key is also used to release the security clips for the front cover.

Protective cover

To protect the call point against accidental operation, a transparent polycarbonate cover has to be lifted to get access to the glass element.

Encapsulated circuit

All electronics are encapsulated. Only the terminal block is accessible from the rear.

LED indicator

An LED on the front cover indicates fire alarm generated by the call point.

Flashing LED: The LED will flash each time the c.i.e. communicates with the call point, until the call point is operated and the LED is switched on.

Non-flashing LED: The LED is switched off, until the call point is operated and the LED is switched on.

Connections / Settings

The COM loop is connected directly to the call point via a 4-way terminal block. For COM loop address setting is the address setting tool 3314 is used. 3314 is also used to set the call point type and the LED mode:

- **NORMAL** mode (EBL512 SW version \geq 2.0 / EBL128): M.c.p. type 3333. (Flashing or non-flashing LED is set via Win512 / Win128.)
- **2330** mode: M.c.p. type 2333, flashing LED.
- **2312** mode: M.c.p. type 2333, non-flashing LED.


Two flying leads (wires) are connected to the terminal block, for connection of the 3314 address setting tool's connection cable. The wires are to be disconnected before the COM loop wires are connected.

Product applications

Used in the systems **EBL512 / 128 / 1000 / 2000** and is intended for indoor use and in dry premises.

Type numbers

3333	Addressable manual call point
2347	Replacement glass (10 pcs.)
2348	Replacement polycarbonate cover (10 pcs.)

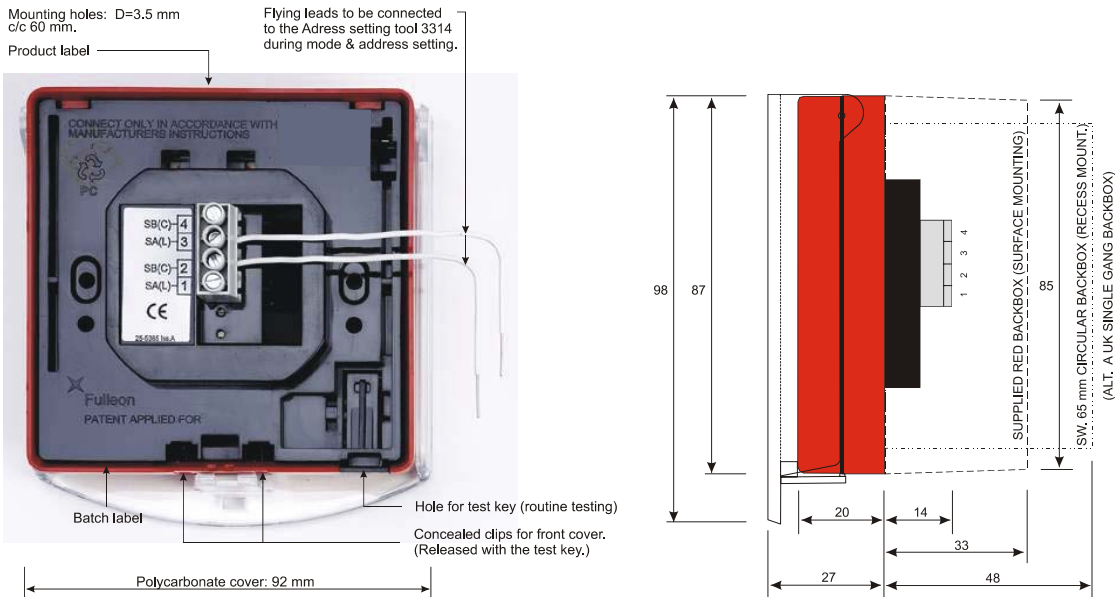

HOW TO PERFORM ROUTINE TESTING:

1. Insert the test key into the hole in the base.
2. The glass position will change, indicating that the call point is operated.
3. Wait until the LED is switched on, i.e. fire alarm is activated in the c.i.e..
4. Remove the test key and the glass position will return to normal.
5. The LED will be switched off when the fire alarm is reset in the c.i.e..

HOW TO REPLACE THE THE GLASS ELEMENT:

1. Lift the polycarbonate cover.
2. Release the front cover security clips with the test key. Lift and remove the front cover.
3. Remove the broken glass element.
4. Place the top edge of the replacement glass element against the microswitch plunger and push it upwards until the glass element is in correct position.
5. Put back the front cover
6. Lower the polycarbonate cover.
7. Perform a routine test (see above).

Technical data

Voltage (V DC)	
allowed	12-30
nominal	24
Current consumption at nom. volt. from COM loop (mA)	
quiescent / active	2 / 5
Ambient temperature (°C)	
operating / storage	-10 to +55 / -40 to +85
Ambient humidity (% RH)	max. 90, non condensing
Ingress Protection rating	IP42
Weight (g)	290
Construction / Colour	ABS / Red (ISO 3864)
Approvals	CE, EN54-11

All technical features and data are subject to changes without notice, resulting from continuous development and improvement.

Product Leaflet	Date of issue	Revision / Date of revision
MEW00097	2001-10-19	5 / 2008-09-24

Free Manuals Download Website

<http://myh66.com>

<http://usermanuals.us>

<http://www.somanuals.com>

<http://www.4manuals.cc>

<http://www.manual-lib.com>

<http://www.404manual.com>

<http://www.luxmanual.com>

<http://aubethermostatmanual.com>

Golf course search by state

<http://golfingnear.com>

Email search by domain

<http://emailbydomain.com>

Auto manuals search

<http://auto.somanuals.com>

TV manuals search

<http://tv.somanuals.com>