



**TRANE®**

# Commercial Self-Contained

---

**Deluxe Self-Contained Units**  
**3 –15 Ton Water-Cooled and**  
**Air-Cooled Air Conditioners**  
**Remote Air-Cooled Condensers**



---

**December 2001**

**PKG-PRC010-EN**



## Introduction

### Deluxe Self-Contained Units — Commercial and Industrial Quality Built into Each Unit

Deluxe self-contained units are single packaged units designed for low-cost installation in the conditioned space or equipment room.

#### Features include:

- Water-cooled or air-cooled
- Vertical or horizontal fan discharge options, ducted or free return
- Return air options include front or rear
- Easy-to-connect piping and power from either side of unit
- Fully assembled and factory-tested
- Optional accessories:
  - plenums
  - cupronickel water-cooled condensers
  - hot water or steam coils

Industrial options with protective coatings are available to help increase resistance to acids, mild alkalides, solvents, inorganic salts, and water.





# Contents

---

<b>Introduction</b>	<b>2</b>
<b>Features and Benefits</b>	<b>4</b>
<b>Application Considerations</b>	<b>6</b>
<b>Selection Procedure</b>	<b>7</b>
Model Number Description	8
<b>General Data</b>	<b>11</b>
<b>Performance Data</b>	<b>13</b>
Airside Pressure Drop	13
Fan Data	14
Waterside Pressure Drop	18
Correction Factors/Heat of Rejection	19
Water-Cooled Unit Performance	20
Air-Cooled Unit Performance	25
Heating Coil Performance	30
<b>Electrical Data</b>	<b>33</b>
<b>Dimensions and Weights</b>	<b>34</b>
<b>Mechanical Specifications</b>	<b>46</b>

## Features and Benefits

Deluxe Self-Contained air conditioners, available in 3–15 tons, are single package units designed for low cost installation in the conditioned space or equipment room. Durable construction, strict quality control, and demanding factory testing ensure reliability from start-up through years of operation.

All units are shipped fully factory assembled and tested, thereby reducing field labor, installation time, and costs. They can also be easily converted from vertical to horizontal discharge arrangements to match most building configurations. Discharge can be either free or ducted. Power and water connections can be made from either side of the unit adding to the unit flexibility.

### Standard Features

- 3 through 15-ton industrial/commercial self-contained units
- Water-cooled or air-cooled condensing applications
- Single point power connection
- Single point water connection on water-cooled units
- Both water and power connections can be made from either side of the unit
- Front or rear return air openings
- Vertical and horizontal discharge arrangements
- UL listing on standard unit
- All compressors are protected with internal motor winding temperature cutouts
- All compressors have crankcase heaters as standard
- Variable pitch sheaves allow for field adjustment of airflow


- High pressure cutout switches on all units
- Low pressure cutout switches on all units
- High pressure relief device on water-cooled units

### Optional Features


- Hydronic heating coils
- Horizontal discharge plenums
- Water regulating valves for condensing pressure control on water-cooled units
- Protective coating for unit and evaporator coil
- CuproNickel condensers
- Permanent filters
- Unit or remote mounted thermostats
- Low ambient control operation on air-cooled condenser
- Oversized fan motor and drive kits

### Available Unit Configurations

#### 3, 5, and 7.5-Ton Units

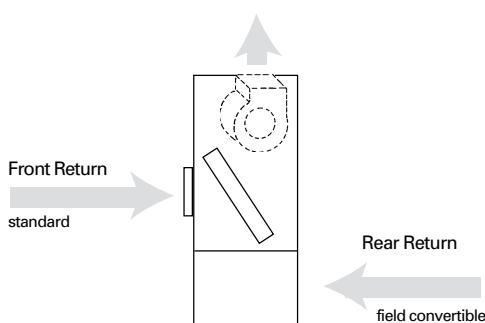

**Figure FB-1. Deluxe Self-Contained 3, 5, & 7.5-Ton Unit With Vertical Discharge, As Shipped**

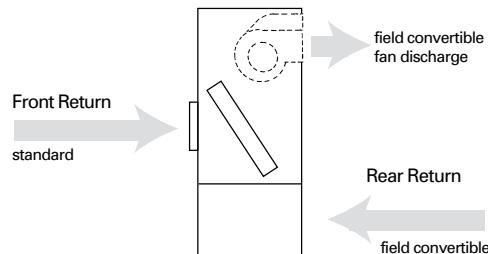


**Figure FB-2. Deluxe Self-Contained 3, 5, & 7.5-Ton Unit With Horizontal Discharge, Field Converted**

## Features and Benefits


---

### Available Unit Configurations


#### 10 and 15-Ton Units

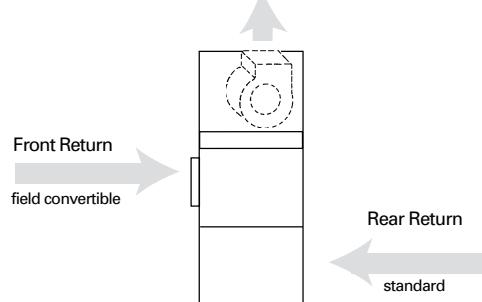


**Figure FB-3. Deluxe Self-Contained 10 & 15-Ton Unit With Counter-Clockwise Vertical Discharge, As Shipped**

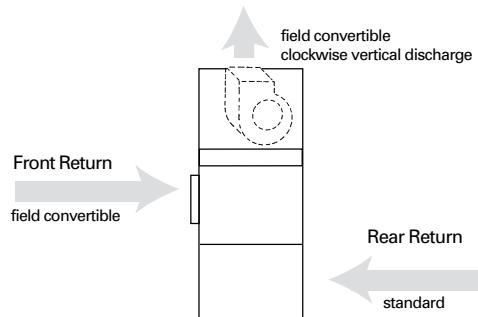


**Figure FB-4. Deluxe Self-Contained 10 & 15-Ton Unit With Clockwise Vertical Discharge, Field Converted**

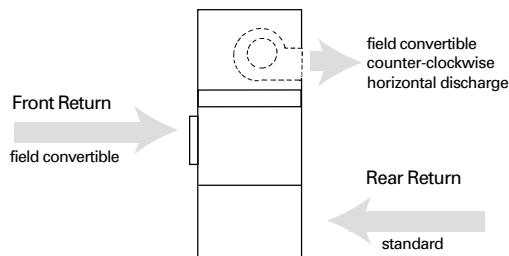


**Figure FB-5. Deluxe Self-Contained 10 & 15-Ton Unit With Counter-Clockwise Horizontal Discharge, Field Converted**

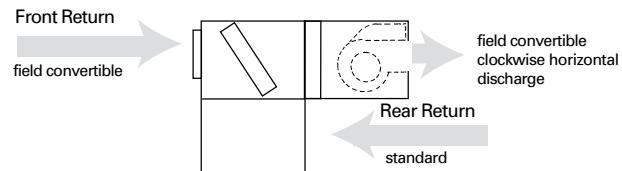

**Figure FB-6. Deluxe Self-Contained 10 & 15-Ton Unit With Clockwise Horizontal Discharge, Field Converted**

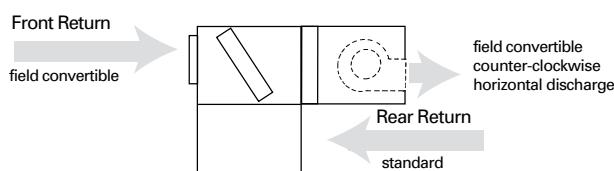

**Figure FB-7. Deluxe Self-Contained 10 & 15-Ton Unit With Counter-Clockwise Horizontal Discharge, Field Converted**

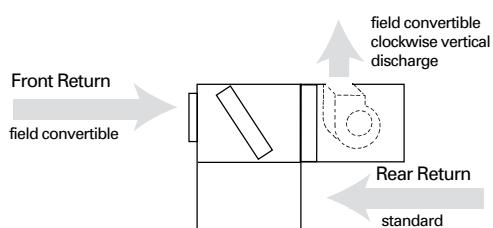

**Figure FB-8. Deluxe Self-Contained 10 & 15-Ton Unit With Clockwise Vertical Discharge, Field Converted**



## Application Considerations

## CCRA Air-Cooled Condenser

### CCRA Unit Location

Unobstructed condenser airflow is essential to maintain capacity and operating efficiency. When determining unit placement, give careful consideration to assure sufficient airflow across the condenser coils. Avoid these two detrimental conditions: warm air recirculation and coil starvation.

Both warm air recirculation and coil starvation cause reductions in unit efficiency and capacity because of the higher head pressure associated with them. In more severe cases, nuisance unit shutdowns will result from excessive head pressures.

### Clearance

Ensure vertical condenser air discharge is unobstructed. While it is difficult to predict the degree of warm air recirculation, a unit installed with a ceiling or other obstruction above it will experience a capacity reduction that will reduce the maximum ambient operation. Nuisance high head pressure tripouts may also occur.

The coil inlet must also be unobstructed. A unit installed closer than the minimum recommended distance to a wall or other vertical riser will experience a combination of coil starvation and warm air recirculation. This may result in unit capacity and efficiency reductions, as well as possible excessive head pressures. Reference the service clearance section on page 45 for recommended lateral distances.

### Ambient Limitations

Standard ambient control allows operation down to 45°F (7.2°C) with cycling of condenser fans. Units with the low ambient option are capable of starting and operating in ambient temperatures down to 0°F (-17.8°C). Optional low ambient units use a condenser fan damper arrangement that controls condenser capacity by modulating damper airflow in response to saturated condenser temperature.

Maximum cataloged ambient temperature operation of a standard condenser is 115°F (46.1°C). Operation at design ambient above 115°F can result in excessive head pressures. For operation above 115°F, contact the local Trane sales office.



# Selection Procedure

## Self-Contained

### Selection Procedure

The selection of a deluxe self-contained unit can be accomplished in three easy steps.

#### Step 1 - Load

Determine the load requirements for heating and cooling (include outside air) using Trane's load estimate program or any standard method.

#### Step 2 - Unit Type

Self-contained air conditioners are available in either water-cooled or remote air-cooled models to match individual needs.

#### Step 3 - Select the Unit

The conditions under which the unit must operate and the design load will give the final selection.

#### Selection Example

Design conditions for a water-cooled unit:

Entering air temperature = 80/67°F

Total gross capacity required = 64,400  
Btu/h

Entering water temperature = 85°F

Leaving water temperature = 95°F

Airflow = 2,400 cfm at 0.5-inch duct static pressure

#### Unit Selection

Tentatively select a 5-ton unit: Model SCWB-B50. Refer to Table PD-10 on page 21 to obtain gross total and sensible unit capacities, gpm, and leaving water temperature at nominal conditions:

Total capacity = 66 MBh

Sensible capacity = 45 MBh

Water flow rate = 20 gpm

Leaving water temperature = 93.1°F

Since the design cfm is greater than the nominal cfm, the capacities and condenser water delta T must be adjusted to reflect the higher cfm.

Design cfm = 2,400

Nominal cfm = 2,000 + 20% of nominal cfm

Refer to Table PD-6 on page 19 to obtain the capacity correction factors for +20% of nominal cfm:

Cooling capacity multiplier = 1.03

Sensible capacity multiplier = 1.05

Multiply the capacities by the correction factors:

66 MBh x 1.03 = 68.0 MBh

45 MBh x 1.05 = 47.3 MBh

The SCWB-B50 meets the total and sensible design requirements.

Subtract the entering water temperature from the leaving water temperature to determine condenser water delta T of 8.1°F. Multiply the delta T by the cooling capacity correction factor of 1.03 to obtain the new delta T of 8.3°F and add this to the entering water temperature to obtain the actual leaving water temperature of 93.3°F. The leaving condenser water temperature is within the design delta T of 10°F.

Refer to the fan data Table PD-1 on page 14 to determine approximate brake horsepower and fan rpm:

Fan brake horsepower = 1.09 bhp

Fan rpm = 934 rpm

Determine net capacities by subtracting fan motor heat from gross capacities:

2.8 X 1.09 bhp = 3.1 MBh

Net total capacity = 67.8 MBh - 3.1 MBh  
= 64.7 MBh

Net sensible capacity = 48.7 MBh - 3.1  
MBh = 45.6 MBh

Refer to the Trane psychrometric chart to determine leaving air temperatures.



## Selection Procedure

## Model Number Description

### Deluxe Self-Contained Model Number Description

Following is a complete description of the deluxe self-contained model number. Each digit in the model number has a corresponding code that identifies specific unit options.

S   C   W   B   B30   4   4   \*   \*   1   0   1   1   A   0   1   2   1   9   A   0   2   0   F   A   0   1   0   0   U  
1   2   3   4   567   8   9   1011   12   13   14   15   16   17   18   19   20   21   22   23   24   25   26   27   28   29   30

#### Digit 1 - Unit Model

S = Self Contained

#### Digit 2 - Unit Type

C = Commercial

I = Industrial

#### Digit 3 - Condenser Medium

W = Water-Cooled

R = Remote Air-Cooled

#### Digit 4 - Development Sequence

B = Development Series

#### Digit 5, 6, 7 - Unit Nominal Capacity

B30 = 3 Tons

B50 = 5 Tons

B75 = 7.5 Tons

C10 = 10 Tons

C15 = 15 Tons

#### Digit 8 - Unit Voltage

4 = 460 Volt/60 Hz/3 ph

5 = 575 Volt/60 Hz/3 ph

6 = 208-230 Volt/60 Hz/3 ph

#### Digit 9 - Air Volume/Temp Control

4 = CV - Zone Temp Cool Only

5 = CV - Zone Temp Heat/Cool

0 = CV - With No Temp Control

#### Digit 10, 11 - Design Sequence

\*\* = Factory Assigned

#### Digit 12 - Unit Construction

1 = Vertical Discharge with Front Return

3 = Vertical Discharge with Rear Return

#### Digit 13 - Plenum Type

0 = Without Plenum

#### Digit 14 - Motor Type

1 = Standard Motor

#### Digit 15 - Fan Drive Kits

1 = Standard Drive Kit

#### Digit 16 - Filter Type

A = 1" Construction Throwaway

#### Digit 17 - Heating Type

0 = Without Factory Installed Heat

#### Digit 18 - Unit Finish

1 = Paint - Deluxe Beige

2 = Protective Coating

3 = Protective Coating with Finish Coat

#### Digit 19 - Unit Connection

2 = Terminal Block

#### Digit 20 - Coil Option

A = Non-coated Aluminum Evaporator

C = Corrosion Protective Coated Aluminum Evaporator

#### Digit 21 - Drain Pan Type

A = Galvanized Standard

#### Digit 22 - Economizer Type

0 = Without Unit Economizer

#### Digit 23 - Waterside Valves

0 = Without Water Valve(s)

#### Digit 24 - Unit Insulation

F = Matte-Faced Fiberglass Insulation

#### Digit 25 - Condenser Type

A = Standard Condenser

E = 90/10 CuNi Condenser

0 = Without Condenser

#### Digit 26 - Compressor Service Valves

0 = Without Service Valves

#### Digit 27 - Temperature Control

0 = Remote Thermostat Interface

1 = Standard Unit Mounted Thermostat

3 = Remote Thermostat, 0H/2C

4 = Remote T'stat, 2H/2C (Manual)

5 = Remote T'stat, 2H/2C (Auto)

6 = Remote Prog. T'stat, 1H/2C

7 = Remote Prog. T'stat, 2H/2C

#### Digit 28 - System Control

0 = Without System Control

#### Digit 29 - Control Options

0 = No System Control Options

#### Digit 30 - Agency Listing

B = UL and CSA Agency Approval

T = CSA Agency Approval

U = UL Agency Approval

0 = No Agency Approval



## Selection Procedure

## Model Number Description

### Self-Contained Accessory Model Number Description

<b>A</b>	<b>1</b>	<b>0</b>	<b>1</b>	<b>0</b>	<b>0</b>	<b>A</b>	<b>7</b>	<b>0</b>	<b>B</b>	<b>9</b>	<b>0</b>	<b>0</b>	<b>2</b>	<b>13</b>	<b>2</b>	<b>A</b>	<b>15</b>	<b>1</b>	<b>0</b>	<b>0</b>
<b>1</b>	<b>2</b>	<b>3</b>	<b>4</b>	<b>5</b>	<b>6</b>			<b>8</b>		<b>10</b>		<b>11</b>	<b>12</b>		<b>14</b>		<b>16</b>	<b>17</b>	<b>18</b>	

#### Digit 1 - Discharge Plenum

A = 3 Ton Standard Plenum  
 B = 3 Ton Protective Coated Plenum  
 C = 5 Ton Standard Plenum  
 D = 5 Ton Protective Coated Plenum  
 E = 7.5 Ton Standard Plenum  
 F = 7.5 Ton Protective Coated Plenum  
 G = 10 Ton Standard Plenum  
 H = 10 Ton Protective Coated Plenum  
 I = 15 Ton Standard Plenum  
 J = 15 Ton Protective Coated Plenum  
 0 = None

#### Digit 2 - Permanent Filters

1 = 3 Ton (1) 20 x 25 x 1  
 2 = 5 Ton (2) 16 x 25 x 1  
 3 = 7.5 Ton (4) 15 x 20 x 1  
 4 = 10 Ton (3) 20 x 25 x 2  
 5 = 15 Ton (8) 15 x 20 x 2  
 0 = None

#### Digit 3 - Front Return Air Grille

A = 10 Ton Front Return Air Grille  
 B = 10 Ton Protective Coated Front Rtn Air Grille  
 C = 15 Ton Front Return Air Grille  
 D = 15 Ton Protective Coated Front Rtn Air Grille  
 0 = None

#### Digit 4 - Rubber-In-Shear Isolators

1 = 3 Ton Isolators  
 2 = 5 Ton Isolators  
 3 = 7.5 Ton Isolators  
 4 = 10 Ton Standard Configuration Isolators  
 5 = 10 Ton Horz. Inverted "L" Isolators (Air-Cooled Units Only)  
 6 = 10 Ton Horz. Inverted "L" Isolators (Water-Cooled Units Only)  
 7 = 15 Ton Standard Configuration Isolators  
 8 = 15 Ton Horz. Inverted "L" Isolators (Air and Water-Cooled Units)  
 0 = None

#### Digit 5 - Steel Spring Isolators

A = 3 Ton Isolators  
 B = 5 Ton Isolators  
 C = 7.5 Ton Isolators  
 D = 10 Ton Standard Configuration Isolators (Air-Cooled Units Only)  
 E = 10 Ton Standard Configuration Isolators (Water-Cooled Units Only)

F = 10 Ton Horz. Inverted "L" Isolators (Air and Water-Cooled Units)  
 G = 15 Ton Standard Configuration Isolators

H = 15 Ton Horz. Inverted "L" Isolators (Air and Water Cooled Units)  
 0 = None

#### Digit 6 - Unit Mounted Thermostat

1 = 10 & 15 Ton 2 Cool Thermostat  
 2 = 3, 5, & 7.5 Ton 2 Cool Thermostat  
 0 = None

#### Digit 7 - Remote Mounted Thermostat

A = 3, 5, & 7.5 Ton 0H/2C (Auto)  
 B = 10 & 15 Ton 2H/2C (Manual)  
 C = 10 & 15 Ton 2H/2C (Auto)  
 0 = None

#### Digit 8 - Programmable Night Setback Thermostat

1 = 3, 5, & 7.5 Ton 1H/2C  
 2 = 10 & 15 Ton 2H/2C  
 0 = None

#### Digit 9 - Fan Motor Kits (Includes Drives)

A = 3 Ton, 3/4 HP, 208-230 Volt  
 B = 3 Ton, 3/4 HP, 460 Volt  
 C = 5 Ton, 1 HP, 208-230 Volt  
 D = 5 Ton, 1 HP, 460 Volt  
 E = 5 Ton, 1-1/2 HP, 208-230 Volt  
 F = 5 Ton, 1-1/2 HP, 460 Volt  
 G = 7.5 Ton, 1-1/2 HP, 208-230 & 460 Volt  
 0 = None

#### Digit 10 - Oversize Fan Motor Kits

1 = 10 Ton, 3 HP, 208-230 & 460 Volt  
 2 = 15 Ton, 5 HP, 208-230 & 460 Volt  
 0 = None

#### Digit 11 - Accessory Drive Kits

A = 10 Ton, Underspeed Drive Kit  
 B = 15 Ton, Underspeed Drive Kit  
 C = 10 & 15 Ton, Overspeed Drive Kit  
 D = 15 Ton, Extra Overspeed Drive Kit  
 0 = None

#### Digit 12 - Hot Water Heating Coil

1 = 3 Ton  
 2 = 3 Ton with Corrosion Protection  
 3 = 5 Ton  
 4 = 5 Ton with Corrosion Protection  
 5 = 7.5 Ton

6 = 7.5 Ton with Corrosion Protection  
 7 = 10 Ton  
 8 = 10 Ton with Corrosion Protection  
 9 = 15 Ton  
 A = 15 Ton with Corrosion Protection  
 0 = None

#### Digit 13 - Steam Heating Coil

A = 3 Ton  
 B = 3 Ton with Corrosion Protection  
 C = 5 Ton  
 D = 5 Ton with Corrosion Protection  
 E = 7.5 Ton  
 F = 7.5 Ton with Corrosion Protection  
 G = 10 Ton  
 H = 10 Ton with Corrosion Protection  
 I = 15 Ton  
 J = 15 Ton with Corrosion Protection  
 0 = None

#### Digit 14 - 90/10 Cupronickel Condensers

1 = 3 Ton CuNi Condenser  
 2 = 3 Ton CuNi Protective Coated Condenser  
 3 = 5 Ton CuNi Condenser  
 4 = 5 Ton CuNi Protective Coated Condenser  
 5 = 7.5 Ton CuNi Condenser  
 6 = 7.5 Ton CuNi Protective Coated Condenser  
 7 = 10 Ton CuNi Condenser  
 8 = 10 Ton CuNi Protective Coated Condenser  
 9 = 15 Ton CuNi Condenser  
 A = 15 Ton CuNi Protective Coated Condenser

#### Digit 15 - Water Regulating Valve Kit

A = 3 Ton Water Reg. Valve Kit  
 B = 5 & 7.5 Ton Water Reg. Valve Kit  
 C = 10 & 15 Ton Water Reg. Valve Kit

#### Digit 16 - Anti-Recycle Timer

1 = Anti-Recycle Timer  
 0 = None

#### Digit 17 - Time Delay Relay

1 = 10 & 15 Ton Time Delay Relay  
 0 = None

#### Digit 18 - Low Ambient Damper

A = 3 & 5 Ton Low Ambient Damper  
 B = 7.5 Ton Low Ambient Damper  
 C = 10 Ton Low Ambient Damper  
 D = 15 Ton Low Ambient Damper  
 0 = None



## Selection Procedure

## Model Number Description

### Remote Air-Cooled Condenser

<b>C</b>	<b>C</b>	<b>R</b>	<b>A</b>	<b>B50</b>	<b>2</b>	<b>0</b>	<b>* *</b>	<b>4</b>	<b>A</b>	<b>U</b>
<b>1</b>	<b>2</b>	<b>3</b>	<b>4</b>	<b>567</b>	<b>8</b>	<b>9</b>	<b>10 11</b>	<b>12</b>	<b>13</b>	<b>14</b>

**Digit 1 - Unit Model**

C = Condenser

**Digit 2 - Unit Type**

C = Commercial

I = Industrial

**Digit 3 - Condenser Medium**

R = Remote Air-cooled

**Digit 4 - Development Sequence**

A = A

**Digit 5, 6, 7 - Nominal Capacity**

B30 = 3 Tons

B50 = 5 Tons

B75 = 7.5 Tons

C10 = 10 Tons

C15 = 15 Tons

**Digit 8 - Unit Voltage**

1 = 208-230 Volt/60 Hz/1 ph

2 = 460 Volt/60 Hz/1 ph

8 = 575 Volt/60 Hz/1 ph

**Digit 9 - Low Ambient**

C = Low Ambient Damper(s)

0 = Without Low Ambient Control

**Digit 10, 11 - Design Sequence**

\*\* = Factory Assigned

**Digit 12 - Unit Finish**

2 = Protective Coating

3 = Protective Coating with  
Finish Coat

4 = Unpainted Unit

**Digit 13 - Coil Options**

A = Non-Coated Aluminum

C = Protective Coated Aluminum

**Digit 14 - Agency Listing**

B = UL and CSA Agency Approval

T = CSA Agency Approval

U = UL Agency Approval

0 = No Agency Approval



## General Data

## Self-Contained

**Table GD-1. SCRB/SIRB/SCWB/SIWB Deluxe Self-Contained General Data**

Unit Size	3	5	7.5	10	15
<b>Compressor Data</b>					
Quantity	1	1	1	2	2
Nominal Ton/Comp	3	5	7.5	5	7.5
Circuits	1	1	1	2	2
<b>Evaporator Coil Data</b>					
Rows	3	3	3	3	3
Sq. Ft.	2.68	5.08	7.08	9.82	16.04
Sq. m.	(.25)	(.47)	(.66)	(.91)	(1.49)
FFP	144	144	144	144	144
<b>Condenser Data (Water-Cooled Only)</b>					
Quantity	1	2	2	2	2
Minimum gpm	5	8	11	15	23
Minimum liters / sec.	(.32)	(.50)	(.69)	(.95)	(1.45)
Maximum gpm	12	20	30	40	50
Maximum liters / sec.	(.76)	(1.26)	(1.89)	(2.52)	(3.15)
Minimum EWT w/out valve, °F	65	65	65	65	65
Minimum EWT with valve, °F	35	35	35	35	35
<b>Evaporator Fan Data</b>					
Quantity	1	1	1	2	2
Size Dia. x width - inches	10 x 10	12 x 12	15 x 15	12 x 9	12 x 9
Size Dia. x width - mm	(254x254)	(305x305)	(381x381)	(305x229)	(305x229)
Standard HP	<sup>1</sup> / <sub>2</sub>	<sup>3</sup> / <sub>4</sub>	1	2	3
Oversized HP Available	<sup>3</sup> / <sub>4</sub>	1, <sup>1</sup> / <sub>2</sub>	1- <sup>1</sup> / <sub>2</sub>	3	5
Minimum Design cfm	960	1600	2400	3200	4800
Minimum Design liter / sec.	(453)	(755)	(1133)	(1510)	(2265)
Maximum Design cfm	1440	2400	3600	4800	7200
Maximum Design liter / sec.	(680)	(1133)	(1699)	(2265)	(3398)
<b>General Data</b>					
EER(SXRB)	10.0	10.0	10.3	10.3	9.7
EER(SXWB)	12.1	12.1	11.5	11.5	12.0
Refrigerant Charge - lbs. R-22 per Circuit					
Total Charge (SXWB)	6.0	11.0	10.0	8.0/8.0	7.5/7.5
Refrigerant Charge - kg R-22					
Total Charge (SXWB)	(2.18)	(3.63)	(3.99)	(5.35)	(7.26)
Capacity Steps - %	100/0	100/0	100/0	100/50/0	100/50/0
<b>Filter Data</b>					
Quantity	1	2	4	3	8
Size (inches)	20x25x1	16x25x1	15x20x1	20x25x1	15x20x1
Size (mm)	(508x635x25)	(406x635x25)	(381x508x25)	(508x635x25)	(381x508x25)
<b>Heating Coil Data</b>					
Steam Coil					
Coil Type	SDS	SDS	SDS	NS	NS
Rows	1	1	1	1	1
Size (inches)	12 x 23 <sup>1</sup> / <sub>4</sub>	15 x 28	18 x 31 <sup>15</sup> / <sub>16</sub>	12 x 53	12 x 73
Size (mm)	(305 x 591)	(381 x 711)	(457 x 811)	(305 x 1346)	(305 x 1854)
FFP	180	180	180	144	144
<b>Hot Water Coil</b>					
Coil Type	WC	WC	WC	WC	WC
Rows	2	2	2	2	2
Size (inches)	15 x 20 <sup>7</sup> / <sub>16</sub>	15 x 25	15 x 29 <sup>5</sup> / <sub>8</sub>	20 x 54 <sup>5</sup> / <sub>8</sub>	20 x 75 <sup>5</sup> / <sub>8</sub>
Size (mm)	(381 x 519)	(381 x 635)	(381 x 737)	(742 x 1388)	(508 x 1921)
FFP	108	108	108	108	108

Notes:

1. All units operate with R-22. Water-cooled units ship with full operating charge. Air-cooled units ship with a dry nitrogen holding charge.
2. Hot water coils do not have turbulators. See Capacity DataTables PD-19 and PD-20 for coil capacities.
3. Steam Coil capacities are shown in Table PD-21.
4. Maximum cfm limits are set to prevent moisture carryover on the evaporator coil.
5. Minimum cfm limits are set to ensure stable thermal expansion valve operation at low load conditions.
6. SCWB/SIWB/SCRB/SIRB 3, 5, 7.5, and 10 ton units are rated at ARI Standard 210/240-1994. SCWB/SIWB/SCRB/SIRB 15-ton units are rated at ARI Standard 340/360-2000.
7. SCRB/SIRB 3 and 5-ton units are rated as SEER.



## General Data

## Air-Cooled Condenser

**Table GD-2. CCRA/CIRA Remote Air-Cooled Condenser General Data**

Unit Size	3	5	7.5	10	15
Gross Heat Rejection (MBh)	59	102	116	207	232
Gross Heat Rejection (kW)	(17.3)	(29.9)	(34.0)	(60.7)	(68.0)
<b>Condenser Fan Data</b>					
Number/Type	1/Prop	1/Prop	2/Prop	2/Prop	4/Prop
Size (inches)	18"	22"	22"	22"	20"
Size (mm)	(457)	(559)	(559)	(559)	(508)
Fan Drive	Direct	Direct	Direct	Direct	Direct
No. of Motors/HP ea.	1/0.33	1/0.75	2/0.75	2/0.75	4/0.75
Nominal cfm					
Nominal (liters / sec)					
<b>Condenser Coil Data</b>					
Circuit 1 Size (in.)	36 x 48	36 x 48	72 x 96	36 x 48	36 x 48
Circuit 1 Size (mm)	(914 x 1219)	(914 x 1219)	(1828x 2438)	(914 x 1219)	(914 x 1219)
Circuit 2 No./Size (in.)	n/a	n/a	n/a	36 x 48	36 x 48
Circuit 2 No./Size (mm)				(914 x 1219)	(914 x 1219)
Face Area (sq. Ft.)	12.0	12.0	24.0	24.0	24.0
Face Area (sq.m)	(1.1)	(1.1)	(2.2)	(2.2)	(2.2)
Rows/fpf	2/144	3/144	3/144	3/144	3/144
<b>Ambient Temp. Operating Range</b>					
Standard Ambient (°F)	40 - 115	40 - 115	40 - 115	40 - 115	40 - 115
Standard Ambient (°C)	(4.4 - 46.1)	(4.4 - 46.1)	(4.4 - 46.1)	(4.4 - 46.1)	(4.4 - 46.1)
Low Ambient Option (°F)	0 - 115	0 - 115	0 - 115	0 - 115	0 - 115
Low Ambient Option (°C)	(-17.8 - 46.1)	(-17.8 - 46.1)	(-17.8 - 46.1)	(-17.8 - 46.1)	(-17.8 - 46.1)


Notes:

1. Gross heat rejection is at a 30°F (-1.1°C) ITD (initial temperature difference) between condensing temperature and ambient air entering condenser (includes the effect of subcooling).


# Performance Data

# Heating Coils

**Chart PD-1. Heating Coil Airside Pressure Drop**

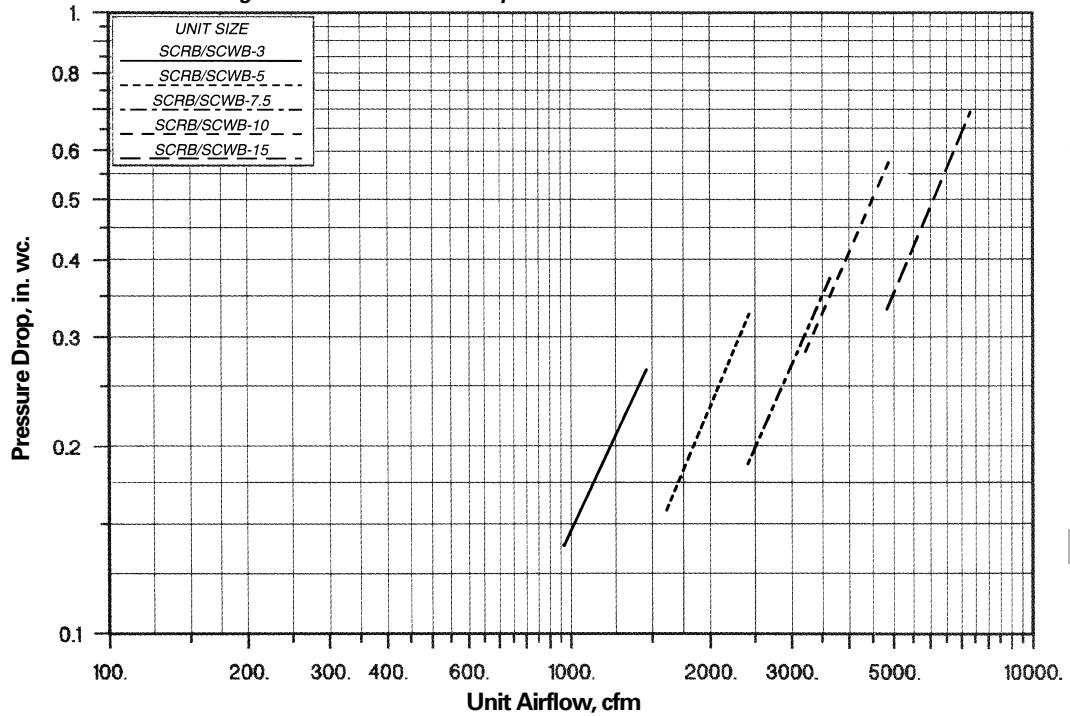

**Chart PD-2. Plenum Airside Pressure Drop**

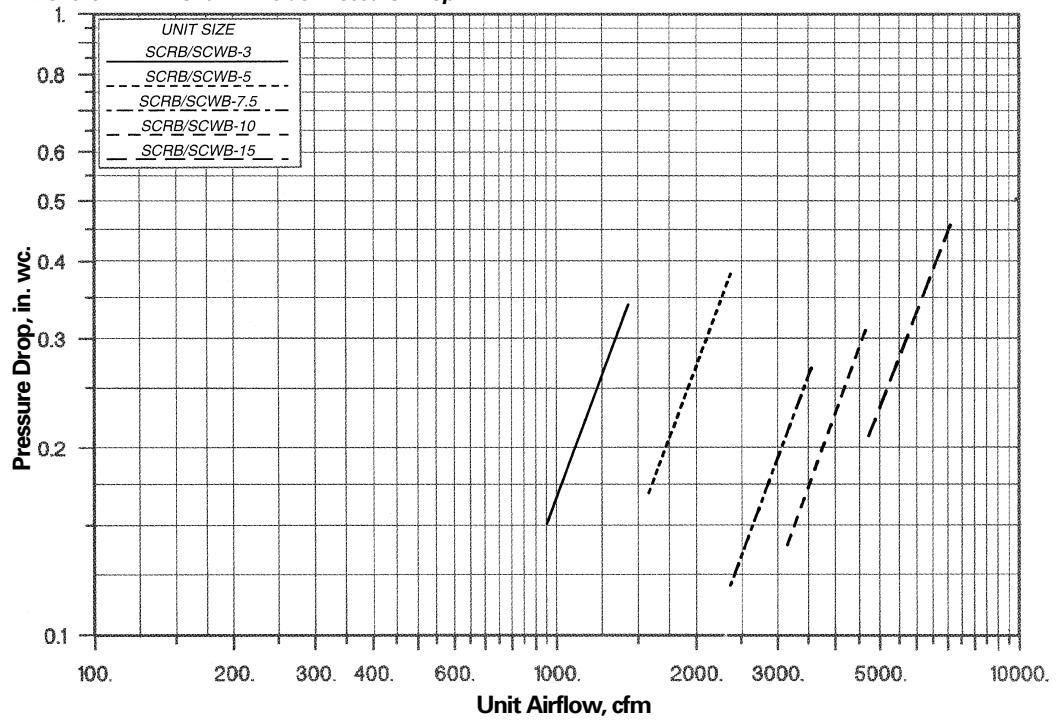

# Performance Data

## Fan Data

**Table PD-1. Fan Performance Data, 0.10 to 0.80 esp**

Unit Size	cfm	External Static Pressure																	
		0.10		0.20		0.30		0.40		0.50		0.60		0.70		0.80			
3-Ton	cfm	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp		
		960	616 0.14	682 0.17	750 0.21	816 0.25	880 0.30	940 0.35	993 0.40	1044 0.45	1080 0.19	735 0.22	796 0.26	856 0.36	915 0.35	972 0.40	1027 0.46	1077 0.52	
		1200	739 0.25	792 0.28	845 0.33	901 0.37	955 0.42	1007 0.47	1059 0.53	1110 0.59	1320 0.32	852 0.35	898 0.40	949 0.45	999 0.50	1048 0.55	1196 0.61	1143 0.67	
		1440	866 0.41	913 0.44	955 0.49	1000 0.54	1046 0.60	1092 0.65	1137 0.71	1137 0.71	1600 0.29	611 0.32	660 0.37	708 0.42	760 0.49	817 0.57	869 0.66	919 0.75	
		1800	612 0.40	664 0.43	709 0.47	751 0.54	793 0.67	839 0.75	888 0.85	937 0.85	2000 0.55	717 0.57	759 0.61	799 0.67	837 0.74	875 0.84	915 0.88	958 0.97	
5-Ton	cfm	2200	724 0.72	771 0.75	812 0.77	849 0.83	884 0.90	919 0.98	953 1.05	989 1.13	2400	781 0.93	826 0.96	865 0.99	900 1.02	934 1.09	966 1.17	998 1.26	1029 1.34
		2700	517 0.42	556 0.50	598 0.59	638 0.68	677 0.78	710 0.87	745 0.98	782 1.09	3000	570 0.57	607 0.66	643 0.75	680 0.86	715 0.96	751 1.08	781 1.18	811 1.28
		3300	625 0.76	661 0.87	691 0.96	725 1.07	758 1.18	789 1.29	822 1.42	822 1.42	3600	681 1.00	715 1.11	742 1.21	771 1.31	803 1.44	839 1.28	867 1.39	905 1.50
		3200	589 0.53	641 0.60	684 0.66	730 0.74	775 0.82	813 0.88	853 0.96	891 1.05	3600	649 0.72	698 0.81	739 0.88	777 0.95	819 1.04	860 1.14	894 1.21	929 1.29
		4000	709 0.97	755 1.06	796 1.15	832 1.23	865 1.31	903 1.41	942 1.52	974 1.60	4400	771 1.26	814 1.37	853 1.47	888 1.56	920 1.64	950 1.73	984 1.84	1020 1.97
10-Ton	cfm	4800	833 1.61	874 1.74	911 1.85	945 1.95	976 2.05	1005 2.14	1033 2.24	1062 2.35	4800	521 0.92	554 0.97	589 1.08	624 1.17	656 1.28	689 1.39	721 1.50	752 1.60
		5400	578 1.29	608 1.34	637 1.43	669 1.56	700 1.66	729 1.77	758 1.90	787 2.02	6000	636 1.76	663 1.80	689 1.87	717 2.00	745 2.14	773 2.26	799 2.38	825 2.51
		6600	694 2.34	719 2.38	743 2.43	767 2.53	792 2.68	819 2.84	844 2.98	868 3.10	7200	752 3.03	776 3.07	798 3.12	820 3.20	842 3.32	866 3.49	890 3.67	913 3.82

Note:


Non-standard drive selection

Oversize motor required

Oversize motor required and non-standard drive selection

### Use Tables PD-1 and PD-2 with these unit configurations:

3, 5, & 7.5-Ton Units

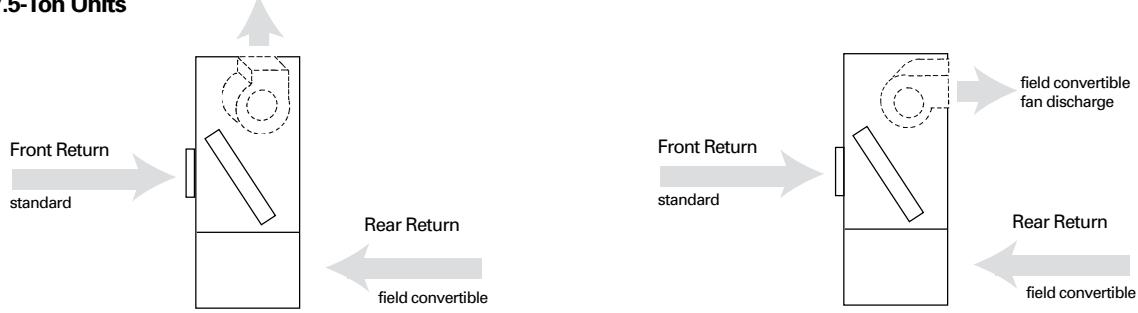

# Performance Data

## Fan Data

**Table PD-2. Fan Performance Data, 0.90 to 2.50 esp**

Unit Size	cfm	External Static Pressure																	
		0.90		1.00		1.10		1.25		1.50		1.75		2.00		2.25		2.50	
		rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp		
3-Ton	960	1092	0.50	1138	0.55	1183	0.60	1248	0.69										
	1080	1124	0.57	1169	0.63	1212	0.68												
	1200	1158	0.66	1202	0.72														
	1320	1190	0.74																
	1440																		
5-Ton	1600	968	0.84	1017	0.94	1064	1.04	1134	1.19										
	1800	984	0.95	1029	1.05	1072	1.16	1137	1.31										
	2000	1003	1.07	1046	1.18	1088	1.29	1149	1.46										
	2200	1027	1.21	1067	1.32	1108	1.44												
	2400	1062	1.42																
7.5-Ton	2400	817	1.21	850	1.33	880	1.44												
	2700	843	1.41																
	3000																		
	3300																		
	3600																		
10-Ton	3200	928	1.14	967	1.23	1007	1.33	1063	1.48	1150	1.76	1234	2.11	1314	2.47	1391	2.86		
	3600	965	1.38	998	1.48	1031	1.58	1082	1.74	1170	2.01	1248	2.30	1324	2.66				
	4000	1005	1.68	1037	1.78	1069	1.89	1114	2.05	1189	2.33	1269	2.64	1342	2.94				
	4400	1052	2.07	1080	2.16	1108	2.25	1152	2.41	1222	2.71								
	4800	1096	2.48	1128	2.61	1156	2.72	1194	2.86										
15-Ton	4800	782	1.71	810	1.82	836	1.92	873	2.08	935	2.36	997	2.70	1062	3.09	1125	3.52	1186	3.98
	5400	815	2.14	843	2.26	869	2.39	907	2.57	964	2.86	1019	3.17	1074	3.51	1130	3.89	1187	4.34
	6000	851	2.66	877	2.78	903	2.92	940	3.12	998	3.46	1051	3.79	1101	4.13	1150	4.47	1199	4.86
	6600	892	3.24	916	3.39	939	3.55	974	3.77	1032	4.14	1085	4.51	1134	4.88				
	7200	936	3.95	945	4.10	979	4.25	1012	4.51	1065	4.92								

Note:


Non-standard drive selection

Oversize motor required

Oversize motor required and non-standard drive selection

### Use Tables PD-1 and PD-2 with these unit configurations:

#### 10 & 15-Ton Units

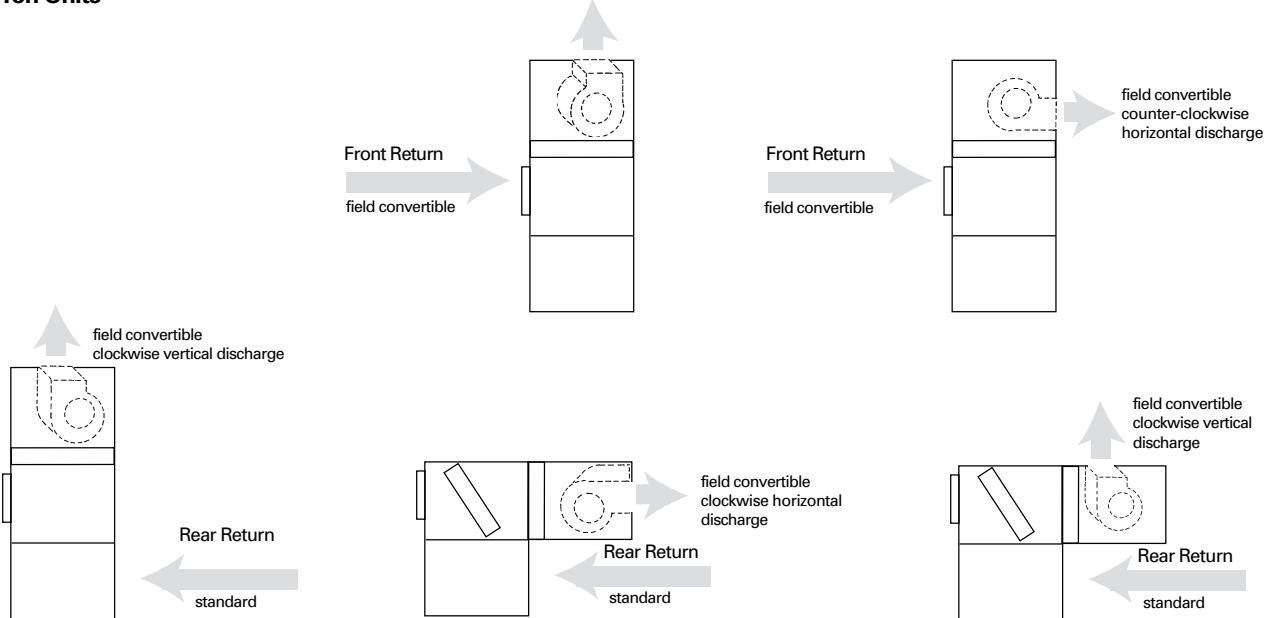

# Performance Data

## Fan Data

**Table PD-3. Fan Performance Data, 0.10 to 0.80 esp**

Unit	cfm	External Static Pressure															
		0.10		0.20		0.30		0.40		0.50		0.60		0.70		0.80	
Size	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	
10-Ton	3200	460	0.45	520	0.49	572	0.56	623	0.63	670	0.70	716	0.78	762	0.86	805	0.95
	3600	501	0.62	558	0.67	608	0.73	653	0.80	698	0.89	741	0.97	782	1.05	823	1.14
	4000	544	0.84	597	0.89	644	0.95	698	1.03	728	1.11	768	1.20	808	1.29	845	1.38
	4400	586	1.10	637	1.16	682	1.22	724	1.29	763	1.38	799	1.47	836	1.57	872	1.67
	4800	632	1.41	679	1.48	721	1.54	761	1.61	799	1.70	834	1.79	867	1.89	900	2.00
15-Ton	4800	478	0.77	516	0.85	555	0.95	597	1.05	634	1.17	668	1.26	700	1.34	733	1.45
	5400	529	1.08	562	1.15	596	1.25	632	1.37	670	1.48	703	1.62	734	1.74	763	1.82
	6000	582	1.47	611	1.53	641	1.64	672	1.76	705	1.88	739	2.01	770	2.16	798	2.31
	6600	634	1.94	660	2.00	688	2.10	716	2.22	744	2.36	773	2.50	804	2.63	834	2.79
	7200	688	2.51	711	2.57	736	2.66	761	2.78	787	2.92	813	3.07	840	3.22	868	3.37

Note:


Non-standard drive selection

Oversize motor required

Oversize motor required and non-standard drive selection

### Use Tables PD-3 and PD-4 with these unit configurations:

#### 10 & 15-Ton Units

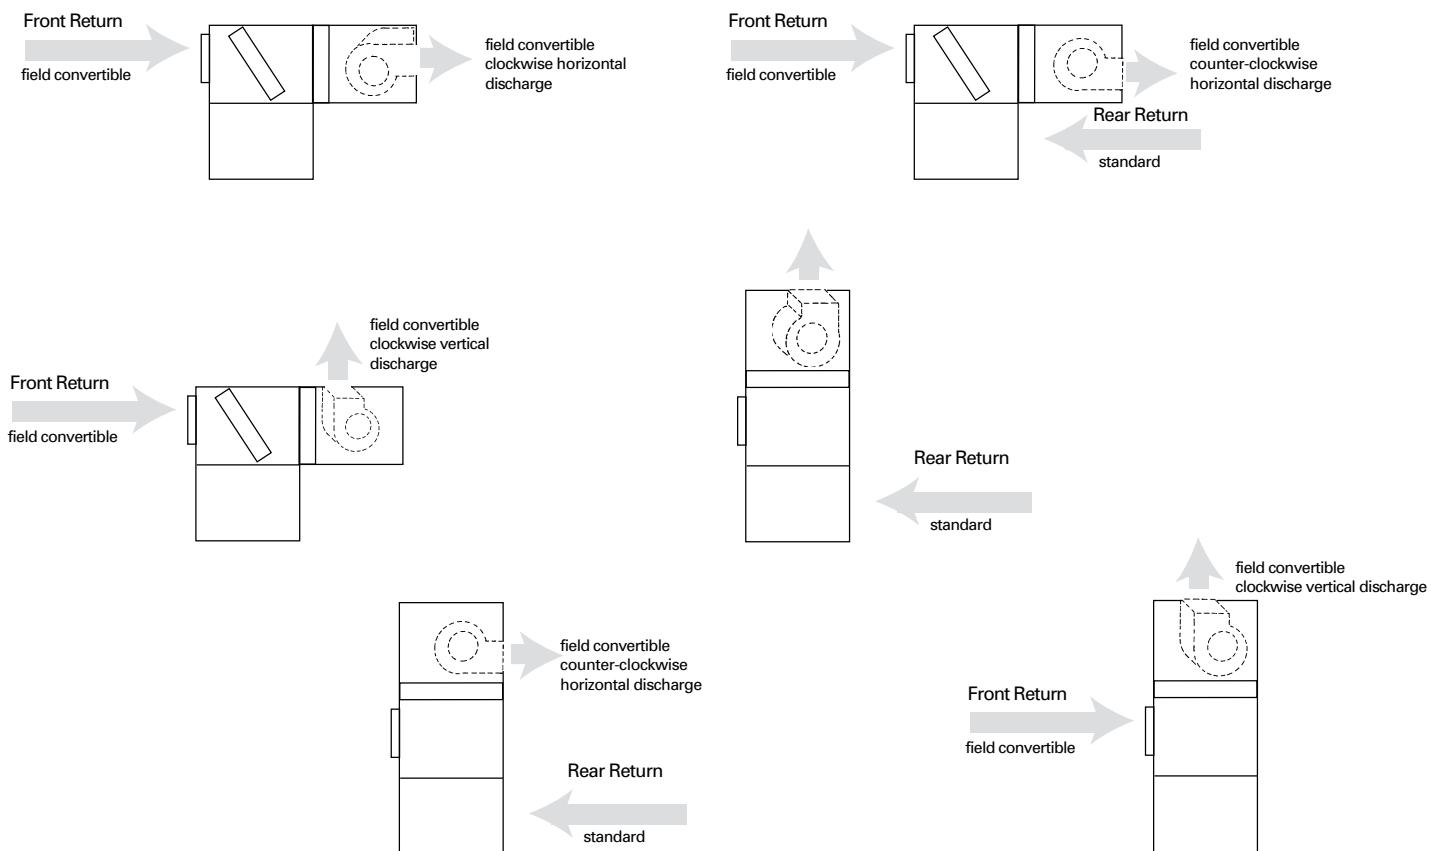



# Performance Data

## Fan Data

Table PD-4. Fan Performance Data, 0.90 to 2.50 esp

Unit Size	cfm	External Static Pressure											
		0.90 rpm bhp	1.00 rpm bhp	1.10 rpm bhp	1.25 rpm bhp	1.50 rpm bhp	1.75 rpm bhp	2.00 rpm bhp	2.25 rpm bhp	2.50 rpm bhp			
10-Ton	3200	846 1.03	887 1.13	925 1.24	980 1.40	1064 1.67	1141 1.95	1215 2.28	1287 2.59	1356 2.94			
	3600	863 1.24	900 1.33	937 1.43	992 1.59	1077 1.89	1154 2.19	1225 2.50	1293 2.83				
	4000	882 1.48	918 1.58	955 1.69	1006 1.84	1088 2.13	1166 2.45	1238 2.78					
	4400	907 1.77	940 1.87	973 1.97	1024 2.15	1102 2.44	1178 2.74						
	4800	934 2.11	967 2.21	998 2.33	1044 2.50	1121 2.80							
15-Ton	4800	765 1.58	796 1.70	825 1.81	869 1.98	939 2.31	1007 2.70	1071 3.14	1132 3.60	1189 4.07			
	5400	792 1.92	821 2.05	849 2.19	891 2.39	956 2.71	1020 3.05	1081 3.45	1141 3.91	1198 4.44			
	6000	825 2.42	851 2.51	877 2.62	916 2.84	979 3.22	1039 3.57	1097 3.93	1153 4.84	1208 4.80			
	6600	861 2.96	886 3.11	910 3.23	945 3.39	1008 3.75	1063 4.18	1118 4.57	1171 4.96				
	7200	896 3.53	922 3.72	946 3.90	980 4.12	1034 4.41	1088 4.80						

Note:

Non-standard drive selection

Oversize motor required


Oversize motor required and non-standard drive selection



## Performance Data

## Waterside Pressure Drop

Chart PD-3. Waterside Pressure Drop

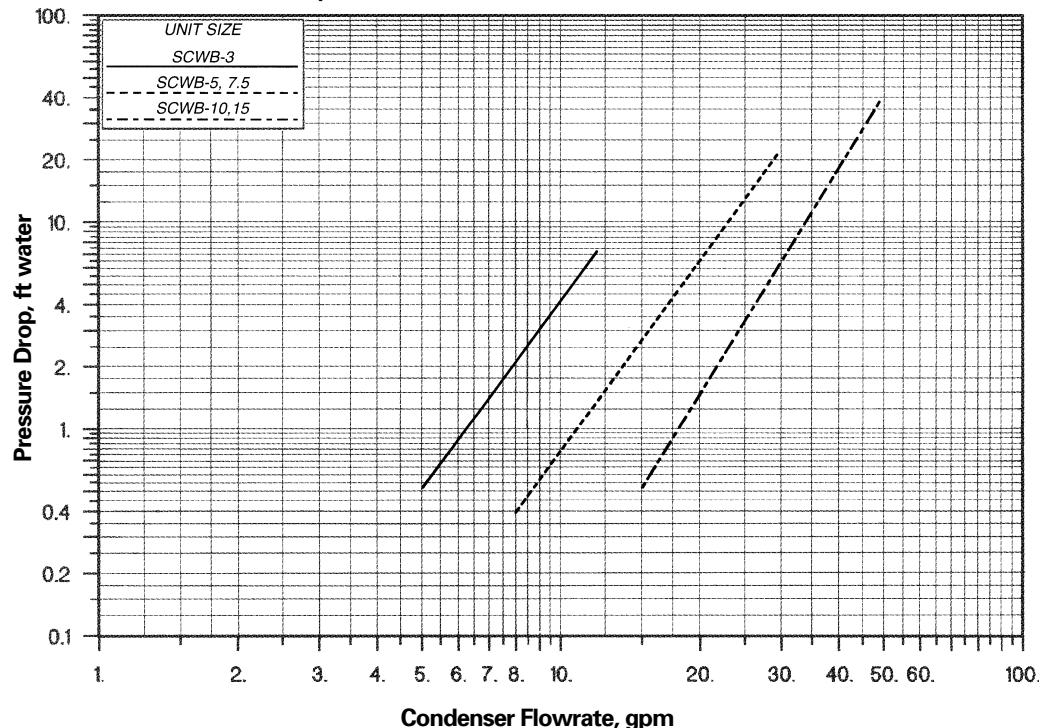

Note: Chart PD-3 includes factory piping and condenser. If adding a water regulating valve, add valve WPD to the value in Chart PD-3. 10 and 15 ton units use two water regulating valves. Therefore, divide the gpm and WPD by 2 to determine values through each valve.

Table PD-5. Water Regulating Valve Pressure Drop, ft of water

9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
4.6	6.0	6.9	8.1	9.9	12.0	16.6	18.4	21.0	23.1	28.9	34.6	36.9	40.4	43.4	46.2	53.1	56.6	61.9	64.0	69.3	76.2

Note: Table PD-5 is based on wide open water valve.



# Performance Data

**Table PD-6. Cfm Capacity Correction Table – Cooling**

	Cfm Compared To Rated Quantity	Cooling Capacity Multiplier	Sensible Capacity Multiplier
DX Cooling	-20%	0.96	0.95
	-10%	0.98	0.98
	Std	1.00	1.00
	+10%	1.02	1.02*
	+20%	1.03	1.05*

\* If, after applying these multipliers, the SHR is greater than 1.0, use 1.0


**Table PD-7. Cfm Capacity Correction Table – Heating**

	Cfm Compared To Rated Quantity	Heating Capacity Multiplier
Hydronic Heating	-20%	0.89
	-10%	0.94
	Std	1.00
	+10%	1.06
	+20%	1.12

**Table PD-8. Altitude Correction Factors**

Altitude	2000	4000	6000	8000	10,000
Cooling Capacity Multiplier	0.98	0.95	0.92	0.89	0.86

**Chart PD-4. CCRA/CIRA Gross Heat of Rejection**

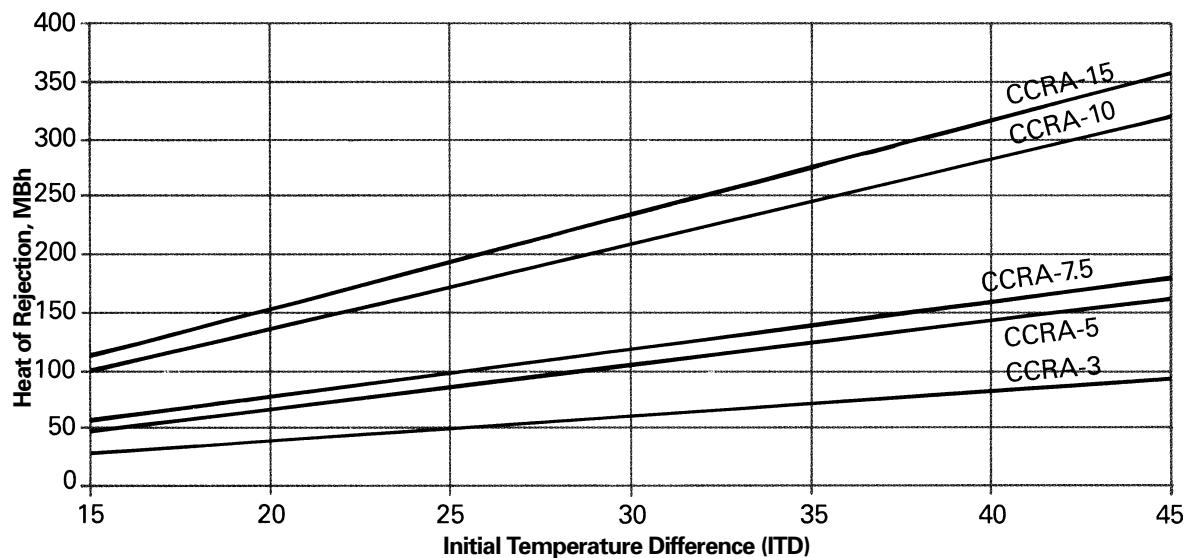













# Performance Data

## Air-Cooled 3 Ton

Table PD-14. SCRB/SIRB 3 Gross Cooling Capacity

Airflow cfm	EDB F	EWB F	75°F		85°F		Entering Ambient Air Temperature		95°F		105°F		115°F	
			Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh
960	70	62	33	20	35	15	28	17	-	-	-	-	-	-
		67	37	16	30	18	31	14	-	-	-	-	-	-
		72	32	19	33	14	-	-	-	-	-	-	-	-
	75	62	33	23	32	23	30	22	28	21	26	20	-	-
		67	37	20	35	19	33	18	31	17	29	16	-	-
		72	40	16	38	15	36	14	34	14	32	13	-	-
	80	62	33	27	31	26	30	25	28	24	26	23	-	-
		67	36	23	35	22	33	22	31	21	29	20	-	-
		72	40	20	38	19	36	18	34	17	32	16	-	-
1200	70	62	33	30	31	30	30	29	28	28	26	26	-	-
		67	36	27	35	26	33	25	31	24	29	24	-	-
		72	40	23	38	22	36	22	34	21	32	20	-	-
	75	62	35	21	36	16	29	19	-	-	-	-	-	-
		67	38	17	31	19	32	14	-	-	-	-	-	-
		72	33	20	34	15	-	-	-	-	-	-	-	-
	80	62	35	25	33	24	31	24	29	23	27	22	-	-
		67	38	21	36	20	34	19	32	18	30	18	-	-
		72	42	17	40	16	38	15	36	14	33	13	-	-
1440	70	62	35	30	33	29	31	28	29	27	27	26	-	-
		67	38	25	36	24	34	24	32	23	30	22	-	-
		72	42	21	40	20	38	19	36	18	33	18	-	-
	75	62	35	34	33	33	31	31	30	30	28	28	-	-
		67	38	29	36	29	34	28	32	27	30	26	-	-
		72	42	25	40	24	38	23	36	23	33	22	-	-
	80	62	36	22	37	16	30	20	-	-	-	-	-	-
		67	39	17	32	21	33	15	-	-	-	-	-	-
		72	34	21	35	16	-	-	-	-	-	-	-	-
	85	62	36	27	34	26	32	25	30	24	28	24	-	-
		67	39	22	37	21	35	20	33	20	31	19	-	-
		72	43	17	41	16	39	15	37	15	34	14	-	-
	80	62	36	32	34	31	32	30	30	29	28	28	-	-
		67	39	27	37	26	35	25	33	24	31	23	-	-
		72	43	22	41	21	39	20	37	19	34	19	-	-
	85	62	36	36	35	35	33	33	32	32	30	30	-	-
		67	39	32	37	31	35	30	33	29	31	28	-	-
		72	43	27	41	26	39	25	37	24	34	23	-	-

Notes: 1. Performance based on matched air-cooled unit and remote condenser. 2. All capacities are gross and have not considered indoor fan heat. 3. CAP = total gross cooling capacity. 4. SHC = sensible heat capacity.



# Performance Data

## Air-Cooled 5 Ton

Table PD-15. SCRB/SIRB 5 Gross Cooling Capacity

Airflow cfm	EDB F	EWB F	75°F		85°F		Entering Ambient Air Temperature 95°F		105°F		115°F	
			Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh
1600	70	62	59	35	62	27	51	32	-	-	-	-
		67	65	28	54	33	56	25	-	-	-	-
		72	57	34	59	26	-	-	-	-	-	-
	75	62	59	42	57	41	54	40	51	38	48	37
		67	65	35	62	34	59	33	56	31	53	30
		72	71	28	68	27	65	26	62	24	58	23
	80	62	59	49	57	48	54	46	51	45	48	44
		67	65	42	62	41	59	39	56	38	53	37
		72	71	35	68	33	65	32	62	31	58	30
	85	62	59	56	57	54	54	53	52	51	49	49
		67	65	49	62	47	59	46	56	45	53	43
		72	70	41	68	40	65	39	61	38	58	36
2000	70	62	62	38	65	28	53	34	-	-	-	-
		67	67	29	56	35	58	26	-	-	-	-
		72	59	37	62	27	-	-	-	-	-	-
	75	62	62	46	59	45	56	43	53	42	50	41
		67	67	38	65	36	62	35	58	34	55	32
		72	73	29	70	28	67	27	64	25	60	24
	80	62	61	54	59	53	56	51	53	50	50	49
		67	67	46	64	44	62	43	58	42	55	40
		72	73	37	70	36	67	35	64	33	60	32
	85	62	62	61	60	60	57	57	55	55	52	52
		67	67	53	64	52	61	51	58	50	55	48
		72	73	45	70	44	67	42	64	41	60	40
2400	70	62	63	40	66	29	55	36	-	-	-	-
		67	69	30	58	38	60	27	-	-	-	-
		72	61	39	63	28	-	-	-	-	-	-
	75	62	63	49	61	48	58	47	55	45	51	44
		67	69	40	66	38	63	37	60	36	56	34
		72	75	30	72	29	69	27	65	26	61	25
	80	62	63	59	61	57	58	56	55	54	52	52
		67	69	49	66	48	63	46	60	45	56	44
		72	75	39	72	38	69	37	65	35	61	34
	85	62	65	65	63	63	60	60	58	58	55	55
		67	69	58	66	57	63	56	60	54	56	53
		72	75	48	72	47	69	46	65	44	61	43

Notes: 1. Performance based on matched air-cooled unit and remote condenser. 2. All capacities are gross and have not considered indoor fan heat. 3. CAP = total gross cooling capacity. 4. SHC = sensible heat capacity.



# Performance Data

## Air-Cooled 7.5 Ton

Table PD-16. SCRB/SIRB 7.5 Gross Cooling Capacity

Airflow cfm	EDB F	EWB F	75°F		85°F		Entering Ambient Air Temperature			105°F		115°F	
			Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	
2400	70	62	91	54	94	41	76	47	-	-	-	-	
		67	99	44	81	50	84	37	-	-	-	-	
		72	86	52	89	39	-	-	-	-	-	-	
	75	62	91	65	86	62	81	60	76	58	71	55	
		67	99	54	94	52	89	49	84	47	78	45	
		72	109	43	103	41	98	39	92	36	-	-	
	80	62	90	75	86	72	81	70	76	68	71	65	
		67	99	64	94	62	89	60	84	57	78	55	
		72	108	53	03	51	98	49	92	47	-	-	
3000	70	62	90	85	86	83	81	80	77	77	73	73	
		67	99	74	94	72	89	70	84	67	78	65	
		72	108	63	103	61	98	59	92	57	-	-	
	75	62	95	58	98	43	79	51	-	-	-	-	
		67	104	45	85	53	87	38	-	-	-	-	
		72	90	56	93	41	-	-	-	-	-	-	
	80	62	94	70	90	68	84	66	79	63	74	61	
		67	103	57	98	55	93	53	87	51	-	-	
		72	113	44	107	42	101	40	95	38	-	-	
3600	70	62	94	82	89	80	84	78	79	75	74	73	
		67	103	70	98	67	93	65	87	63	-	-	
		72	113	57	107	54	101	52	95	50	-	-	
	85	62	95	94	90	90	86	86	82	82	78	78	
		67	103	82	98	79	92	77	87	75	-	-	
		72	113	69	107	67	101	64	95	62	-	-	
	75	62	97	61	101	44	81	54	-	-	-	-	
		67	107	47	87	57	89	40	-	-	-	-	
		72	92	59	95	42	-	-	-	-	-	-	
	80	62	97	75	92	73	87	71	81	68	76	66	
		67	106	61	101	58	95	56	89	54	-	-	
		72	116	46	110	44	104	41	98	39	-	-	
	85	62	97	89	92	87	87	85	82	82	77	77	
		67	106	75	101	72	95	70	89	68	-	-	
		72	116	60	110	58	104	55	98	53	-	-	
	72	62	99	99	95	95	91	91	86	86	82	82	
		67	106	89	101	86	95	84	89	82	-	-	
		72	116	74	110	71	104	69	98	67	-	-	

Notes: 1. Performance based on matched air-cooled unit and remote condenser. 2. All capacities are gross and have not considered indoor fan heat. 3. CAP = total gross cooling capacity. 4. SHC = sensible heat capacity.



# Performance Data

## Air-Cooled 10 Ton

**Table PD-17. SCRB/SIRB 10 Gross Cooling Capacity**

Airflow cfm	EDB F	EWB F	75°F		85°F		Entering Ambient Air Temperature 95°F		105°F		115°F	
			Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh
3200	70	62	123	74	129	57	107	66	-	-	-	-
		67	135	59	113	68	117	51	-	-	-	-
		72	118	71	124	54	-	-	-	-	-	-
	75	62	123	87	118	85	113	82	107	79	-	-
		67	135	73	129	70	123	68	117	65	-	-
		72	147	58	141	56	135	53	128	51	-	-
	80	62	123	101	118	99	113	96	107	93	-	-
		67	134	87	129	84	123	82	117	79	-	-
		72	147	72	141	69	135	67	128	64	-	-
4000	70	62	123	115	118	112	113	110	107	106	102	102
		67	134	100	129	98	123	95	117	92	110	90
		72	147	85	141	83	135	81	128	78	121	75
	75	62	128	79	135	59	111	71	-	-	-	-
		67	140	61	117	73	122	53	-	-	-	-
		72	123	76	128	56	-	-	-	-	-	-
	80	62	128	95	123	93	117	90	111	87	-	-
		67	140	78	134	75	128	73	122	70	-	-
		72	153	60	146	58	140	55	133	52	-	-
4800	70	62	128	112	123	109	117	106	111	103	-	-
		67	140	94	134	92	128	89	121	86	-	-
		72	153	77	146	74	140	72	132	69	-	-
	85	62	129	127	124	124	119	119	114	114	109	109
		67	140	110	134	108	128	105	121	102	114	99
		72	152	93	146	90	139	88	132	85	125	82
	75	62	132	83	138	61	114	75	-	-	-	-
		67	144	63	121	78	125	55	-	-	-	-
		72	127	81	132	58	-	-	-	-	-	-
	80	62	132	102	127	100	120	97	114	94	-	-
		67	144	82	138	80	132	77	125	74	-	-
		72	157	62	150	60	143	57	136	54	-	-
	85	62	132	121	126	118	121	116	114	112	-	-
		67	144	101	138	98	131	96	124	93	-	-
		72	157	81	150	78	143	76	136	73	-	-
	72	62	135	135	130	130	125	125	120	120	114	114
		67	144	120	138	117	131	114	124	112	117	109
		72	157	99	150	97	143	94	135	92	127	89

Notes: 1. Performance based on matched air-cooled unit and remote condenser. 2. All capacities are gross and have not considered indoor fan heat. 3. CAP = total gross cooling capacity.  
4. SHC = sensible heat capacity.



# Performance Data

## Air-Cooled 15 Ton

Table PD-18. SCRB/SIRB 15 Gross Cooling Capacity

Airflow cfm	EDB F	EWB F	75°F		Entering Ambient Air Temperature		95°F		105°F		115°F	
			Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh	Total MBh	Sensible MBh
4800	70	62	190	116	197	86	159	101	-	-	-	-
		67	207	91	169	106	174	77	-	-	-	-
		72	180	111	186	81	-	-	-	-	-	-
	75	62	189	140	179	135	169	130	158	125	-	-
		67	207	115	197	110	186	105	174	101	-	-
		72	226	89	215	85	203	80	191	76	-	-
	80	62	189	164	179	159	169	154	159	149	-	-
		67	207	138	196	134	185	129	174	124	-	-
		72	226	113	215	108	203	104	191	99	-	-
6000	70	62	190	187	180	180	172	172	163	163	-	-
		67	207	162	196	158	185	153	174	148	-	-
		72	226	137	214	132	203	128	191	123	-	-
	75	62	197	125	204	90	164	110	-	-	-	-
		67	216	95	176	115	180	80	-	-	-	-
		72	187	120	193	85	-	-	-	-	-	-
	80	62	197	154	187	149	176	144	164	139	-	-
		67	215	124	204	119	192	114	180	109	-	-
		72	235	93	223	88	210	84	197	79	-	-
7200	70	62	197	183	187	178	177	173	165	165	-	-
		67	215	152	204	148	192	143	180	138	-	-
		72	235	122	222	117	210	113	197	108	-	-
	75	62	202	202	193	193	184	184	175	175	-	-
		67	215	181	204	176	192	171	180	167	-	-
		72	234	150	222	146	210	141	197	136	-	-
	80	62	203	133	210	93	168	118	-	-	-	-
		67	222	98	180	124	185	84	-	-	-	-
		72	192	129	197	89	-	-	-	-	-	-
85	75	62	203	167	192	162	180	157	168	152	-	-
		67	221	132	209	127	197	122	185	117	-	-
		72	241	96	228	92	215	87	202	82	-	-
	80	62	204	200	193	193	183	183	174	174	-	-
		67	221	165	209	160	197	156	184	151	-	-
		72	241	130	228	125	215	120	202	116	-	-
	85	62	213	213	204	204	194	194	184	184	-	-
		67	221	199	209	194	198	189	186	183	-	-
		72	240	163	228	158	215	154	201	149	-	-

Notes: 1. Performance based on matched air-cooled unit and remote condenser. 2. All capacities are gross and have not considered indoor fan heat. 3. CAP = total gross cooling capacity. 4. SHC = sensible heat capacity.



# Performance Data

## Heating Coils

Table PD-19. Hot Water Coil Heating Capacity, 180°F Entering Water Temperature

Unit Size	Airflow cfm	EAT F	Water Temperature Drop								
			20°F			30°F			40°F		
3 Ton	960	40	4.3	43.3	81.6	2.3	35.7	74.3	1.2	24.5	63.5
		60	3.5	35.2	93.8	1.8	27.1	86.1	0.7	13.4	72.9
		80	2.7	27.1	106.0	1.2	17.2	96.5	0.5	10.2	89.8
	1200	40	4.8	47.9	76.8	2.6	39.6	70.4	1.4	28.0	61.5
		60	3.9	38.9	89.9	2.0	30.2	83.2	0.7	14.0	70.8
		80	3.0	30.0	103.0	1.3	19.7	95.1	0.5	10.6	88.1
	1440	40	5.1	51.5	73.0	2.8	42.7	67.3	1.5	30.7	60.0
		60	4.2	41.9	86.8	2.2	32.7	80.9	0.7	14.3	69.2
		80	3.2	32.3	100.7	1.4	21.6	93.8	0.5	10.8	86.9
5 Ton	1600	40	6.5	64.9	75.3	3.7	55.6	70.2	2.3	45.1	64.5
		60	5.2	52.4	89.6	2.9	43.3	84.5	1.5	30.8	77.4
		80	4.0	40.2	103.6	2.0	30.7	98.0	0.7	13.1	87.7
	2000	40	7.1	70.6	70.7	4.0	60.4	66.2	2.5	49.2	61.4
		60	5.7	57.0	85.8	3.1	47.1	81.3	1.7	34.2	75.5
		80	4.4	43.8	100.6	2.2	33.6	95.8	0.7	13.4	86.3
	2400	40	7.5	75.1	67.2	4.3	64.1	63.2	2.6	52.4	59.0
		60	6.1	60.7	82.9	3.3	50.1	78.9	1.8	36.8	73.9
		80	4.7	46.7	98.3	2.4	36.0	94.1	0.7	13.7	85.4
7.5 Ton	2400	40	8.6	86.5	71.3	5.0	75.4	67.3	3.2	64.2	63.2
		60	7.0	70.2	86.4	4.0	59.6	82.4	2.4	47.7	78.0
		80	5.4	54.4	101.3	3.0	44.0	97.2	1.4	28.6	91.2
	3000	40	9.3	93.2	67.0	5.4	81.1	63.5	3.5	69.0	60.0
		60	7.5	75.7	82.8	4.3	64.1	79.3	2.6	51.6	75.5
		80	5.9	58.7	98.4	3.1	47.5	94.8	1.6	31.9	90.0
	3600	40	9.8	98.3	63.7	5.7	85.5	60.6	3.6	72.6	57.5
		60	8.0	80.0	80.1	4.5	67.6	77.0	2.7	54.5	73.7
		80	6.2	62.1	96.2	3.3	50.1	93.1	1.7	34.3	89.0
10 Ton	3200	40	18.8	188.0	94.1	11.5	172.1	89.6	7.8	156.2	85.0
		60	15.7	157.0	105.1	9.4	141.2	100.7	6.3	125.5	96.2
		80	-	-	-	7.4	110.2	111.8	4.7	94.7	107.3
	4000	40	21.0	211.0	88.5	12.8	192.6	84.4	8.7	174.5	80.2
		60	17.5	176.0	100.5	10.5	157.9	96.4	7.0	140.1	92.3
		80	14.1	141.0	112.4	8.2	123.2	108.4	5.3	105.5	104.3
	4800	40	22.9	229.1	84.0	14.0	209.4	80.2	9.5	189.6	76.4
		60	19.1	191.0	96.7	11.4	171.5	92.9	7.6	152.0	89.2
		80	15.3	153.0	109.4	8.9	133.8	105.7	5.7	114.3	102.0
15 Ton	4800	40	26.0	260.5	87.2	16.1	241.8	83.8	11.1	222.7	80.3
		60	21.4	214.1	100.3	13.0	195.8	96.9	8.9	177.4	93.4
		80	16.9	169.5	113.1	10.1	151.6	109.7	6.7	133.7	106.1
	6000	40	28.8	288.0	81.7	17.8	266.9	78.7	12.3	245.7	75.6
		60	23.7	237.1	95.7	14.4	216.5	92.6	9.8	195.9	89.5
		80	18.8	187.9	109.4	11.2	167.9	106.3	7.4	147.6	103.1
	7200	40	31.0	310.2	77.5	19.1	287.2	74.7	13.2	264.1	71.9
		60	25.5	255.6	92.1	15.5	233.2	89.3	10.5	210.7	86.5
		80	20.2	202.7	106.4	12.2	181.0	103.6	8.0	158.8	100.7



# Performance Data

## Heating Coils

Table PD-20. Hot Water Coil Heating Capacity, 200°F Entering Water Temperature

Unit Size	Airflow cfm	EAT F	20°F			Water Temperature Drop			40°F		
			Flow gpm	Capacity MBh	LAT F	Flow gpm	Capacity MBh	LAT F	Flow gpm	Capacity MBh	LAT F
3 Ton	960	40	5.2	52.3	90.2	3.0	45.6	83.8	1.9	37.8	76.3
		60	4.4	44.2	102.4	2.5	37.4	96.0	1.4	28.9	87.7
		80	3.6	36.1	114.7	1.9	29.1	108.0	0.9	17.9	97.2
	1200	40	5.8	57.9	84.5	3.3	50.3	78.6	2.1	42.0	72.3
		60	4.9	48.9	97.6	2.7	41.3	91.8	1.6	32.3	84.8
		80	4.0	39.9	110.7	2.1	32.3	104.8	1.0	30.0	96.1
	1440	40	6.2	62.4	80.0	3.6	54.1	74.6	2.2	45.3	69.0
		60	5.2	52.6	93.7	3.0	44.5	88.5	1.7	35.0	82.4
		80	4.3	42.9	107.5	2.3	34.8	102.3	1.1	23.2	94.9
5 Ton	1600	40	7.8	77.8	82.3	4.6	69.0	77.5	3.0	60.1	72.7
		60	6.5	65.0	96.7	3.8	56.4	91.9	2.4	47.5	86.9
		80	5.2	52.6	110.9	2.9	44.4	106.0	1.7	34.6	100.3
	2000	40	8.4	84.7	76.8	5.0	75.0	72.6	3.3	65.2	68.3
		60	7.1	70.8	92.0	4.1	61.4	87.8	2.6	51.8	83.4
		80	5.7	57.3	107.0	3.2	48.3	102.7	1.9	38.0	97.8
	2400	40	9.0	90.2	72.6	5.2	79.6	68.8	3.4	69.2	65.0
		60	7.5	75.4	88.4	4.3	65.3	84.6	2.7	55.0	80.7
		80	6.9	61.2	103.9	3.4	51.4	100.1	2.0	40.6	95.9
7.5 Ton	2400	40	10.3	103.2	77.4	6.1	92.6	73.5	4.0	82.1	69.7
		60	8.6	86.5	92.6	5.1	76.3	88.7	3.3	66.1	84.9
		80	7.0	70.4	107.6	4.0	60.5	103.7	2.5	50.4	99.7
	3000	40	11.1	111.2	77.2	6.6	99.6	68.9	4.4	88.1	65.5
		60	9.3	93.4	88.2	5.5	82.2	84.8	3.5	71.1	81.4
		80	7.6	76.1	103.8	4.3	65.3	100.4	2.7	54.3	97.0
	3600	40	11.7	117.4	68.3	7.0	105.1	65.4	4.6	92.8	62.4
		60	9.8	98.7	84.8	5.8	86.8	81.8	3.7	74.8	78.8
		80	8.0	80.5	101.0	4.6	68.9	98.0	2.8	57.3	94.9
10 Ton	3200	40	21.9	200.2	103.4	13.6	205.2	99.1	9.5	190.1	94.8
		60	18.8	189.1	114.5	11.6	174.2	110.2	7.9	159.1	105.9
		80	-	-	-	-	-	-	-	-	-
	4000	40	24.6	247.1	97.0	15.3	230.0	93.0	10.6	212.6	89.0
		60	21.1	212.1	108.9	13.0	195.1	105.0	8.9	177.8	101.0
		80	-	-	-	--	-	-	7.2	143.2	113.0
	4800	40	26.8	269.1	91.7	16.6	250.1	88.1	11.5	231.0	84.4
		60	23.0	230.9	104.4	14.1	212.1	100.7	9.6	193.2	97.1
		80	-	-	-	11.6	174.1	113.4	7.8	155.5	109.9
15 Ton	4800	40	30.3	304.4	95.1	19.0	286.3	91.8	13.4	267.9	88.5
		60	25.6	257.1	108.4	15.9	239.5	105.1	11.1	221.5	101.7
		80	-	-	-	-	-	-	8.8	177.0	144.6
	6000	40	33.5	336.7	88.8	21.0	316.3	85.8	14.7	295.7	82.8
		60	28.4	284.8	102.9	17.6	264.9	99.9	12.2	244.9	96.9
		80	-	-	-	14.3	215.3	113.7	9.8	195.8	110.6
	7200	40	-	-	-	22.6	340.4	81.1	15.9	318.0	78.4
		60	30.6	307.2	98.6	19.0	285.5	95.8	13.2	263.7	93.1
		80	25.3	253.5	113.0	15.4	232.2	110.3	10.5	211.0	107.5



# Performance Data

## Heating Coils

Table PD-21. Steam Coil Heating Capacity

Unit Size	Airflow cfm	EAT F	Steam PSIG					
			2	5	25	Capacity MBh	LAT F	
3 Ton	960	40	87.8	124.4	92.0	128.4	115.0	147.2
		60	78.0	134.9	82.2	139.0	101.7	157.7
		80	68.1	145.5	72.4	149.6	91.7	168.3
	1200	40	98.8	115.9	103.5	119.6	125.5	136.5
		60	87.7	127.4	92.5	131.1	114.4	148.0
		80	76.6	138.9	81.4	142.6	103.3	159.5
	1440	40	109.1	109.9	114.0	113.3	138.6	128.8
		60	96.8	122.1	102.1	125.4	126.4	141.0
		80	84.6	134.2	89.9	137.6	114.1	153.1
	1600	40	138.1	119.6	144.8	123.5	175.5	141.2
		60	122.7	130.7	129.3	134.6	160.0	152.3
		80	107.2	141.8	113.9	145.7	144.6	163.4
5 Ton	2000	40	155.3	111.6	162.8	115.1	197.3	131.0
		60	137.9	123.6	145.4	127.1	179.9	143.0
		80	120.5	135.6	128.0	139.1	162.5	155.0
	2400	40	171.6	106.0	179.9	109.2	218.0	123.8
		60	152.4	118.6	160.7	121.8	198.8	136.4
		80	133.1	131.2	141.5	134.4	179.6	149.0
	2400	40	201.2	117.3	210.9	121.1	255.6	138.3
		60	178.6	128.7	188.4	132.4	233.1	149.6
		80	156.1	140.0	165.8	143.8	210.5	160.9
	3000	40	226.4	109.6	237.4	113.0	287.7	128.5
		60	201.0	121.8	212.0	125.2	262.4	140.7
		80	175.7	134.0	186.7	137.4	237.0	152.9
7.5 Ton	3600	40	250.5	104.2	262.7	107.3	318.4	121.6
		60	222.5	117.0	234.6	120.1	290.3	134.4
		80	194.4	129.8	206.6	133.0	262.3	147.2
	3200	40	235.3	107.9	247.7	111.4	303.9	127.6
		60	209.4	120.4	221.6	123.9	277.2	139.9
		80	183.3	132.9	195.4	136.3	250.5	152.2
	4000	40	263.1	100.7	277.3	104.0	341.3	118.7
		60	234.2	114.0	248.1	117.2	311.3	131.8
		80	205.2	127.4	218.8	130.5	281.2	144.9
	4800	40	-	-	301.0	97.9	371.5	111.4
		60	254.1	108.9	269.4	111.8	388.9	125.1
		80	222.8	122.8	237.8	125.7	306.2	138.9
10 Ton	4800	40	336.4	104.7	354.6	108.2	436.8	124.0
		60	229.5	117.6	317.4	121.0	398.4	136.6
		80	262.5	130.5	280.0	133.8	360.0	149.2
	6000	40	-	-	396.9	101.1	491.1	115.5
		60	335.1	111.5	355.5	114.7	447.9	128.9
		80	293.8	125.2	313.7	128.3	404.8	142.3
	7200	40	-	-	434.8	95.7	537.3	108.9
		60	-	-	389.6	109.6	490.3	122.8
		80	321.8	121.3	344.0	124.1	445.3	137.1



# Electrical Data

## Electrical Data Calculations

RLA = Rated Load Amps

Compressor LRA = Locked Rotor Amps

Fan Motor LRA = Locked Rotor Amps,  
N.E.C. Table 430 - 151

FLA = Full Load Amps, N.E.C.  
Table 430 - 150

Voltage utilization range is  $\pm 10$  percent

## Determination of Minimum Circuit Ampacity (MCA)

MCA =  $1.25 \times$  largest motor amps (FLA or RLA) + the sum of the remaining motor amps.

## Determination of Maximum Fuse Size (MFS) and Maximum Circuit Breaker Size (MCB)

MFS and MCB =  $2.25 \times$  largest motor amps (FLA or RLA) + the sum of the remaining motor amps.

If the rating value determined does not equal a standard current rating of over current protective device, use the next lower standard rating for the marked maximum rating.

**Note: MFS for CXRA units is for non-time delay fuses.**

**Table ED-1. SCWB/SIWB/SCRB/SIRB Electrical Data**

	Qty.	SCWB/SIWB				SCRB/SIRB				Fan Motor Data				SCWB/SIWB		SCRB/SIRB	
		Compressor Motor Data				Compressor Motor Data				Fan Motor Data				MCA	MFS	MCA	MFS
		RLA	LRA	kW	RLA	LRA	kW	Qty/hp	FLA	LRA	kW	RLA	kW	RLA	kW	RLA	kW
3 Ton	208-230V	1	10.5	101	3.0	10.5	101	3.0	1/0.5	4.0	21	0.44	-	17	25	17	25
	460V	1	4.2	51	3.0	4.2	51	3.0	1/0.5	1.0	6	0.44	-	6	15	6	15
	575V	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
5 Ton	208-230V	1	15.4	118	5.2	15.4	118	5.2	1/0.75	4.5	31	0.73	-	24	35	24	35
	460V	1	10.0	71	5.2	10.0	71	5.2	1/0.75	1.4	8	0.73	-	14	20	14	20
	575V	1	5.8	43	5.2	5.8	43	5.2	1/0.75	1.4	11	0.73	-	9	15	9	15
7.5 Ton	208-230V	1	25.9	164	7.5	24.7	164	7.5	1/1.0	3.7	22	1.1	-	36	60	35	50
	460V	1	11.2	79	7.5	10.7	79	7.5	1/1.0	1.8	11	1.1	-	16	25	15	25
	575V	1	8.4	63	7.5	8.4	63	7.5	1/1.5	1.8	16	1.1	-	12	20	12	20
10 Ton	208-230V	2	15.4	118	5.3	15.4	118	5.3	1/2.0	7.5	46	1.3	-	42	50	42	50
	460V	2	10.0	71	5.3	10.0	71	5.3	1/2.0	3.4	23	1.3	-	26	35	26	35
	575V	2	5.8	43	5.3	5.8	43	5.3	1/2.0	2.3	18	1.3	-	15	20	15	20
15 Ton	208-230V	2	25.9	164	7.5	24.7	164	7.5	1/3.0	10.6	72	1.9	-	69	90	66	90
	460V	2	11.2	79	7.5	10.7	79	7.5	1/3.0	4.8	38	1.9	-	30	40	29	35
	575V	2	8.4	63	7.5	8.4	63	7.5	1/3.0	3.3	23	1.9	-	22	30	22	30

Note: Fan motor kW base on three phase motors. Compressor kW based on 80/67°F to evaporator, nominal airflow, and 105°F condensing temperature, 3 phase/60hz.

**Table ED-2. CCRA/CIRA Condenser Electrical Data**

Unit Size Tons	Rated Voltage	#Fans/HP	FLA (ea.)	LRA (ea.)	kW	MCA	MFS
3	208-230	1/0.33	1.5	3.8	0.29	1.9	15
	460	1/0.33	0.9	2.0	0.29	1.1	15
	575	-	-	-	-	-	-
5	208-230	1/0.75	5.0	14.6	1.17	6.3	15
	460	1/0.75	2.7	6.3	1.17	3.4	15
	575	1/0.75	1.4	5.4	1.17	1.8	15
7.5	208-230	2/0.75	5.0	14.6	1.17	11.3	15
	460	2/0.75	2.7	6.3	1.17	6.1	15
	575	2/0.75	1.4	5.4	1.17	3.2	15
10	208-230	2/0.75	5.0	14.6	1.17	11.3	15
	460	2/0.75	2.7	6.3	1.17	6.1	15
	575	2/0.75	1.4	5.4	1.17	3.2	15
15	208-230	4/0.75	5.0	14.6	1.17	21.3	25
	460	4/0.75	2.7	6.3	1.17	11.5	15
	575	4/0.75	1.4	5.4	1.17	6.0	15


Note: Fan motor kW base on single phase motors. Compressor kW based on 80/67°F entering air to the evaporator, nominal airflow, and 105°F condensing temperature, single phase/60hz.



## Dimensions and Weights

**3 & 5-Ton  
Self-Contained**

**Models SCWB/SIWB/SCWB/SIRB  
3 & 5-Ton Unit**

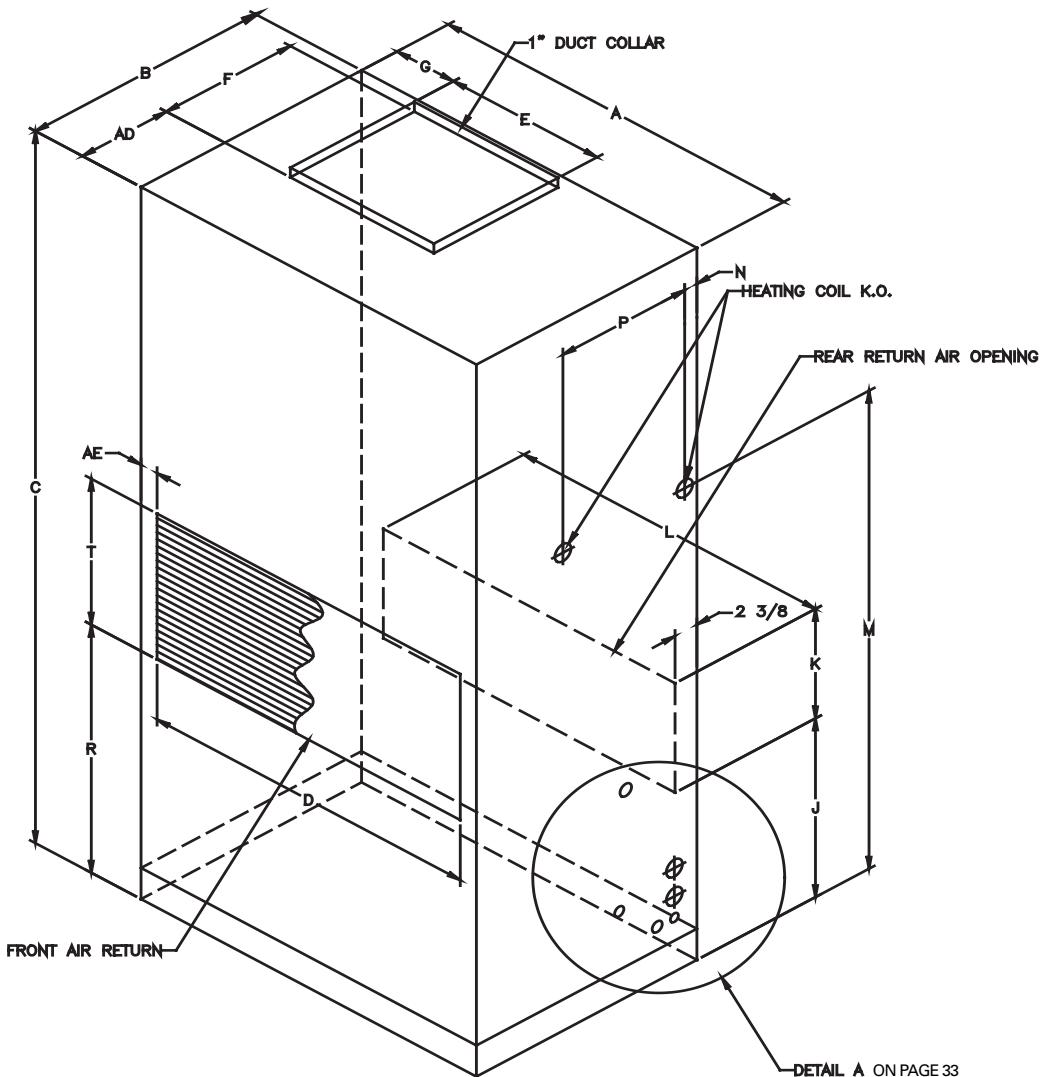

### **SCRB/SIRB/SCWB/SIWB 3 and 5-Ton Unit Dimensions, in.- lbs.**


Unit Size	Width B	Depth C	Height D	Discharge Duct E F G			Rear Air Return AD J K			Heating Coil K.O.'s L M N P R				Front Air Return T D AE			
				A	B	C	D	E	F	G	H	I	J	K	L	M	N
3-Ton	32	22 <sup>5</sup> / <sub>8</sub>	64 <sup>3</sup> / <sub>4</sub>	13 <sup>1</sup> / <sub>8</sub>	11 <sup>3</sup> / <sub>8</sub>	5 <sup>5</sup> / <sub>8</sub>	10	20 <sup>1</sup> / <sub>4</sub>	10	27 <sup>1</sup> / <sub>4</sub>	43 <sup>3</sup> / <sub>4</sub>	13 <sup>3</sup> / <sub>8</sub>	10 <sup>1</sup> / <sub>4</sub>	21 <sup>1</sup> / <sub>2</sub>	15	28 <sup>1</sup> / <sub>4</sub>	1 <sup>1</sup> / <sub>8</sub>
5-Ton	36 <sup>1</sup> / <sub>2</sub>	24	74	15 <sup>5</sup> / <sub>8</sub>	13 <sup>1</sup> / <sub>2</sub>	7 <sup>1</sup> / <sub>8</sub>	9 <sup>1</sup> / <sub>8</sub>	18	11 <sup>1</sup> / <sub>4</sub>	31 <sup>3</sup> / <sub>4</sub>	50	13 <sup>3</sup> / <sub>8</sub>	13 <sup>1</sup> / <sub>4</sub>	27 <sup>1</sup> / <sub>2</sub>	15	33	1 <sup>3</sup> / <sub>4</sub>

Unit Size	Drain X	Water Inlet & Discharge Line AB		Water Outlet & Liquid Line CD		Wtr Reg. Valve Capillary K.O. V AC		Electrical K.O.'s H Y AA		Operating Weight SXWB SXRB		Shipping Weight SXWB SXRB			
		W	Y	U	Y	V	AC	H	Y	AA	SXWB	SXRB	SXWB	SXRB	
3-Ton	23 <sup>5</sup> / <sub>8</sub>	8 <sup>7</sup> / <sub>8</sub>	10 <sup>5</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>2</sub>	7 <sup>3</sup> / <sub>4</sub>	2 <sup>1</sup> / <sub>2</sub>	9 <sup>1</sup> / <sub>4</sub>	8 <sup>1</sup> / <sub>2</sub>	5 <sup>5</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>2</sub>	4 <sup>3</sup> / <sub>8</sub>	245	210	420	390
5-Ton	22 <sup>1</sup> / <sub>8</sub>	7 <sup>3</sup> / <sub>4</sub>	11 <sup>1</sup> / <sub>2</sub>	2 <sup>1</sup> / <sub>2</sub>	8 <sup>1</sup> / <sub>2</sub>	2 <sup>1</sup> / <sub>2</sub>	10	8 <sup>1</sup> / <sub>2</sub>	6 <sup>3</sup> / <sub>8</sub>	2 <sup>1</sup> / <sub>2</sub>	4 <sup>3</sup> / <sub>8</sub>	405	315	570	500

# Dimensions and Weights

## 7.5-Ton Self-Contained

**Models SCWB/SIWB/SCWB/SIRB  
7.5-Ton Unit**

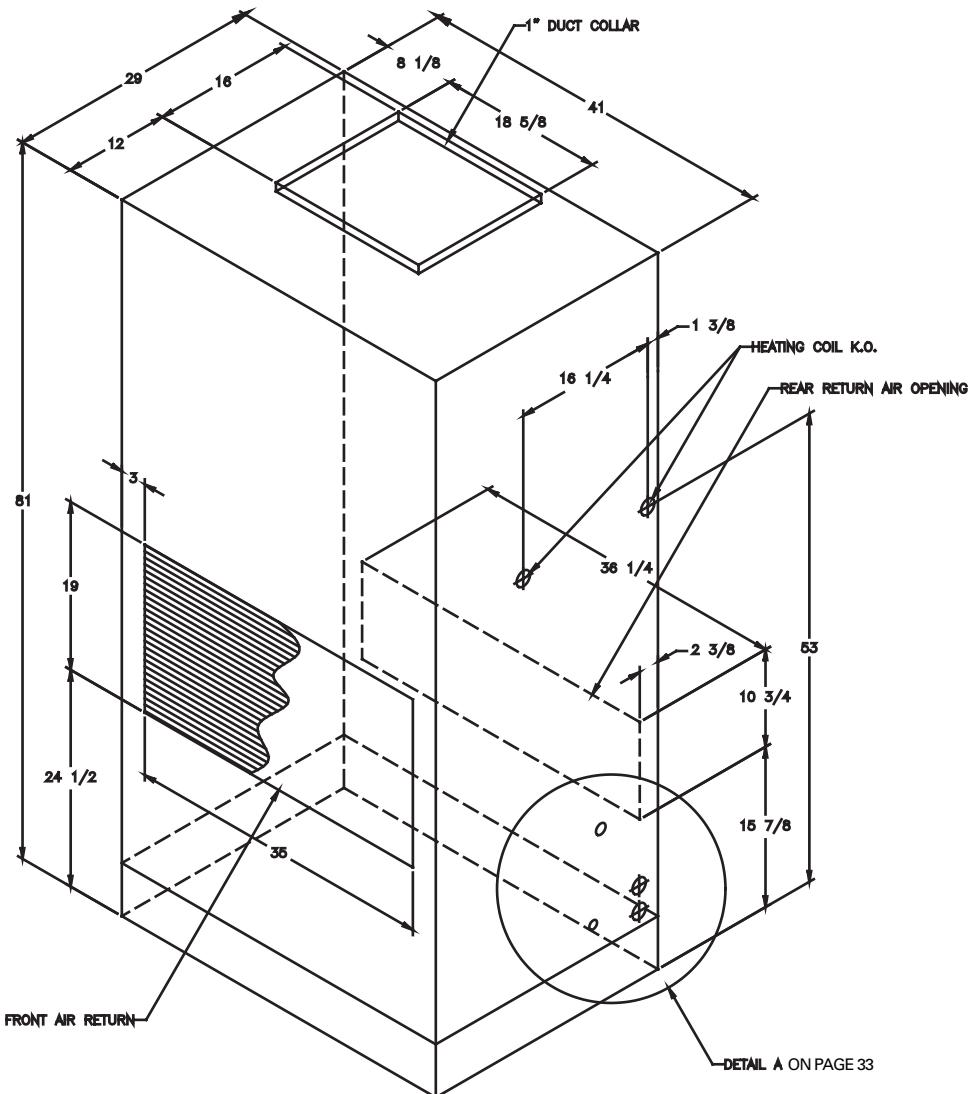

### ***SCRB/SIRB/SCWB/SIWB 7.5-Ton Unit Weight, lbs.***


Operating Weight		Shipping Weight	
SXWB	SXRБ	SXWB	SXRБ
509	400	730	640



## Dimensions and Weights

## 10 & 15-Ton Self-Contained

Models SCWB/SIWB/SCWB/SIRB  
10 & 15-Ton Unit

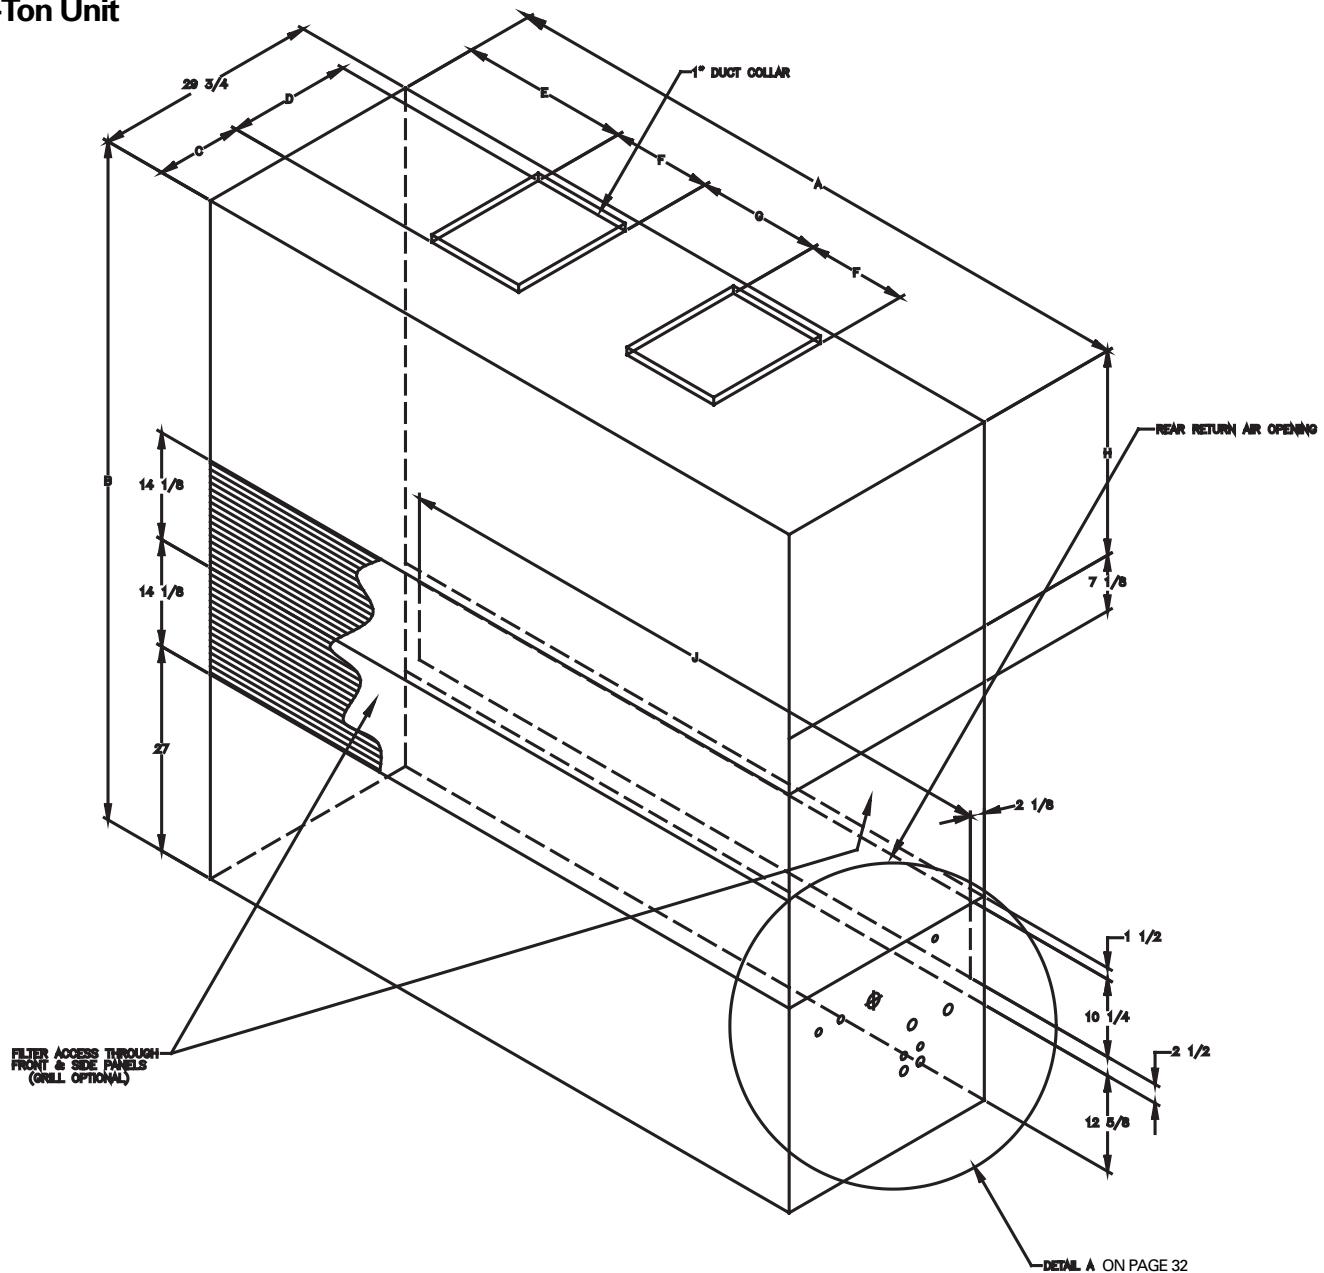


SCRB/SIRB/SCWB/SIWB 10 and 15-Ton Unit Dimensions, in. - lbs.

Unit Size	Width A	Height B	Discharge Duct C	E	F	G	Blower Section Height H	Rear Air Return J	Operating Weight SXWB	Shipping Weight SXWB	Operating Weight SXRB	Shipping Weight SXRB	
10-Ton	65 <sup>3</sup> / <sub>4</sub>	85 <sup>5</sup> / <sub>8</sub>	14 <sup>1</sup> / <sub>8</sub>	13 <sup>1</sup> / <sub>2</sub>	6 <sup>3</sup> / <sub>4</sub>	12 <sup>1</sup> / <sub>4</sub>	17	23	61 <sup>1</sup> / <sub>2</sub>	920	818	1160	1040
15-Ton	88 <sup>1</sup> / <sub>4</sub>	89 <sup>5</sup> / <sub>8</sub>	11 <sup>3</sup> / <sub>8</sub>	16 <sup>1</sup> / <sub>4</sub>	22 <sup>3</sup> / <sub>8</sub>	13 <sup>1</sup> / <sub>4</sub>	16 <sup>1</sup> / <sub>2</sub>	27	84	1208	1115	1510	1350


## Dimensions and Weights

## 3-15 Ton Self-Contained


### Detail "A" 3 and 5-Ton Units

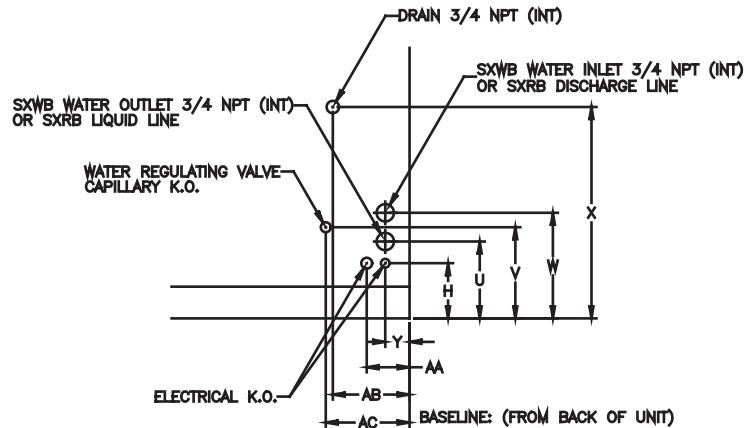

### Detail "A" 7.5-Ton Units

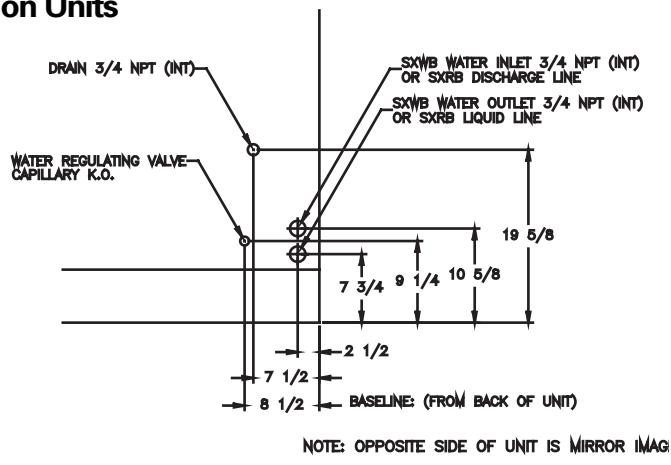


### Detail "A" 10 and 15-Ton Units

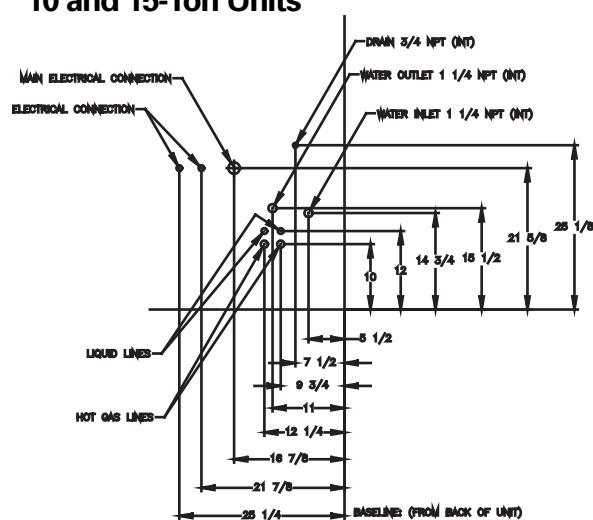

# Dimensions and Weights

## Air-Cooled Condenser


### 3 and 5-Ton CCRA/CIRA

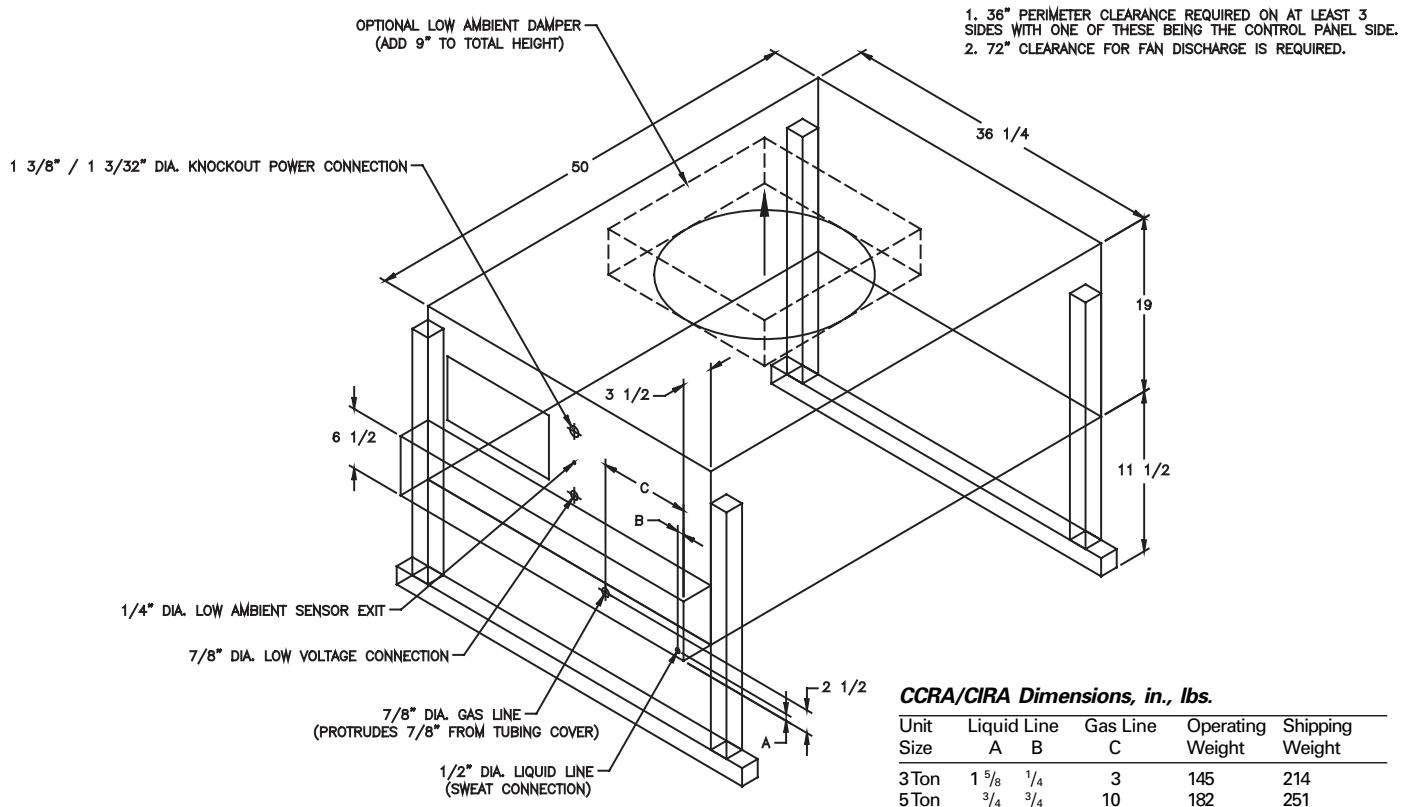

# Dimensions and Weights

## Air-Cooled Condenser

### 7.5-Ton CCRA/CIRA

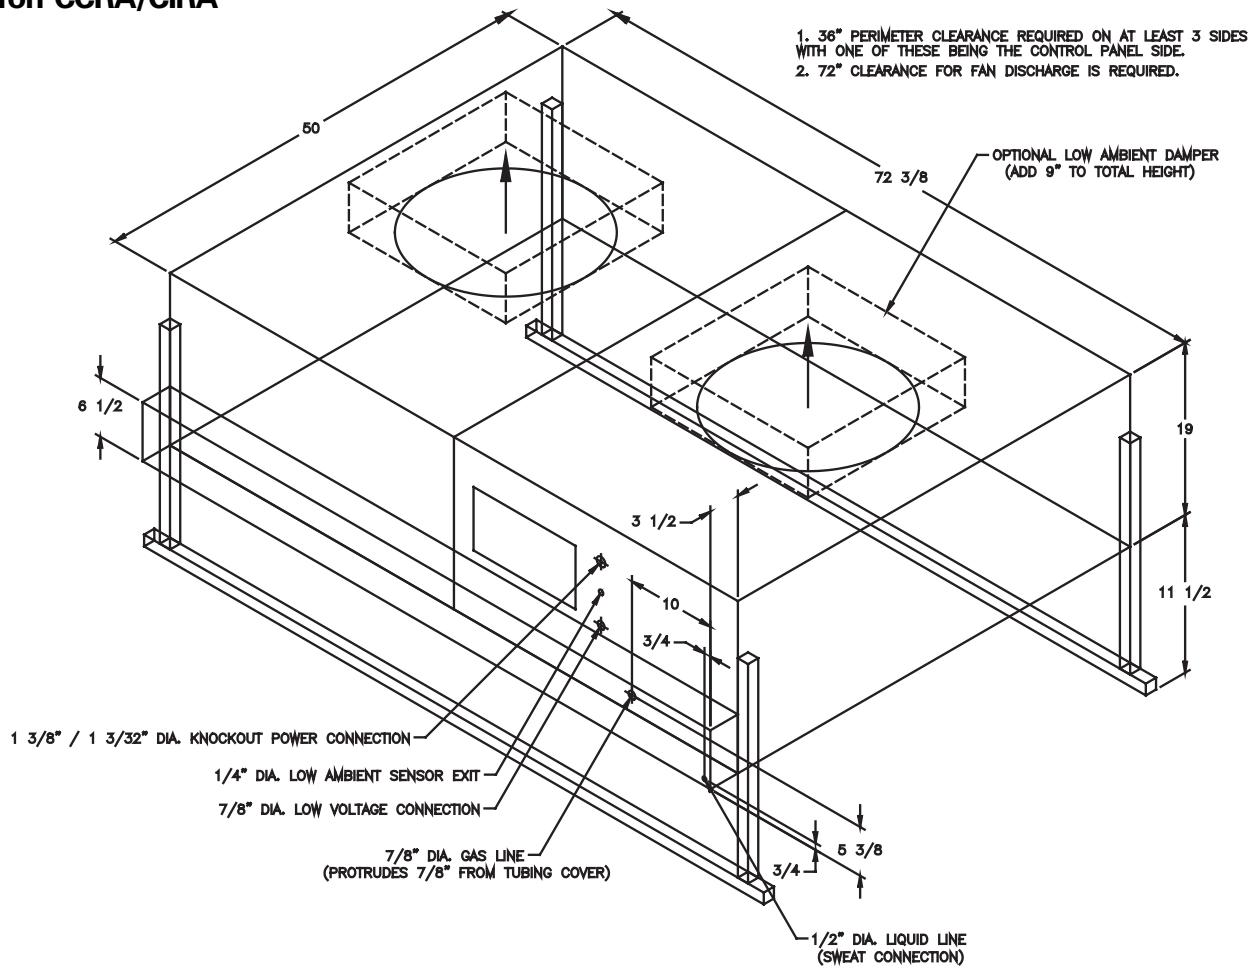

#### CCRA/CIRA Weight, lbs.


Unit Size	Operating Weight	Shipping Weight
7.5-Ton	364	502



## Dimensions and Weights

## Air-Cooled Condenser

### 10-Ton CCRA/CIRA

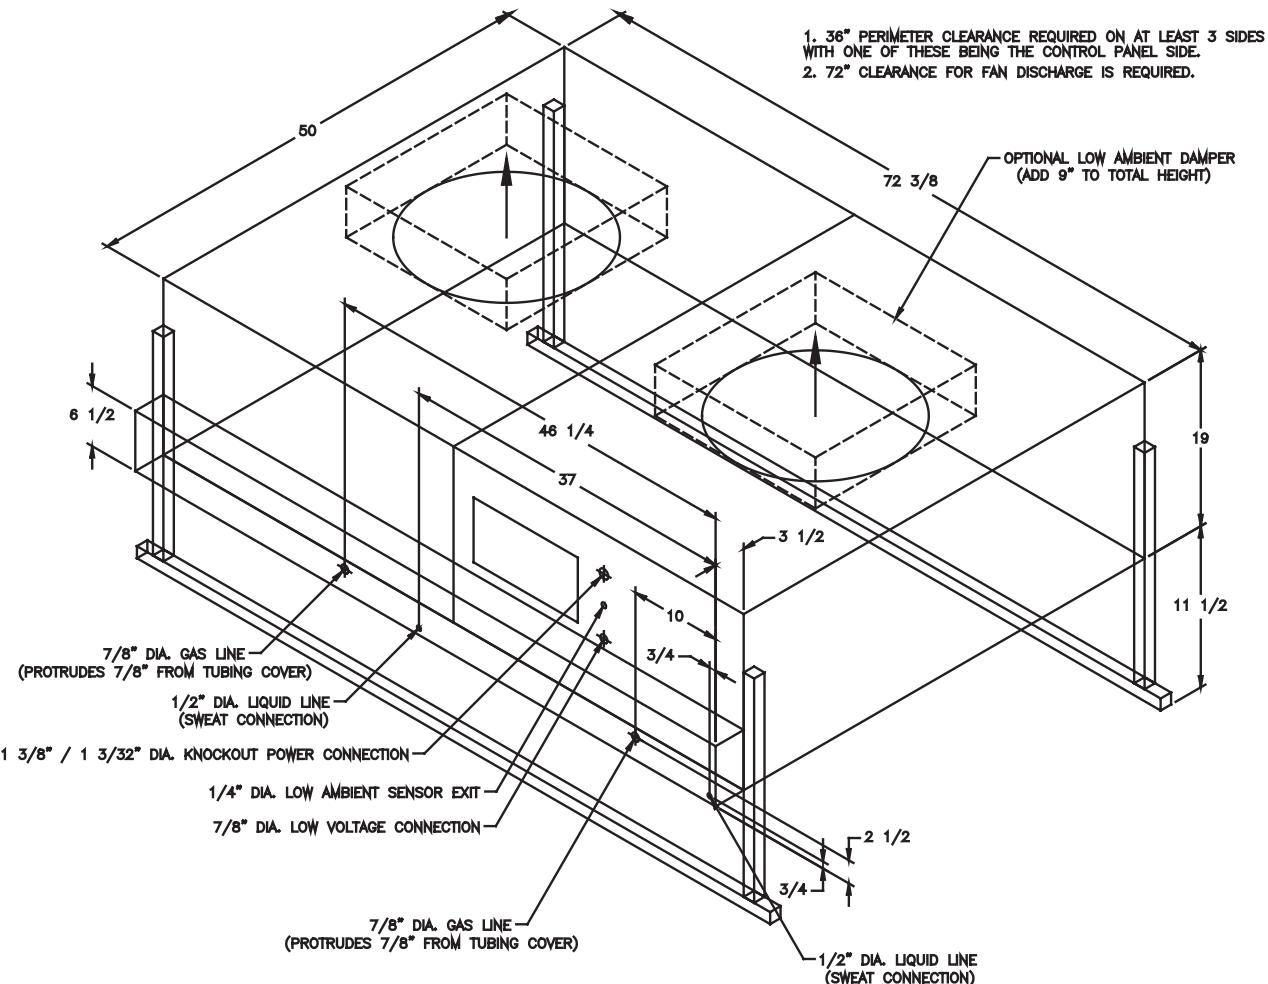


#### CCRA/CIRA Weight, lbs.

Unit Size	Operating Weight	Shipping Weight
10-Ton	364	502

# Dimensions and Weights

## Air-Cooled Condenser

### 15-Ton CCRA/CIRA

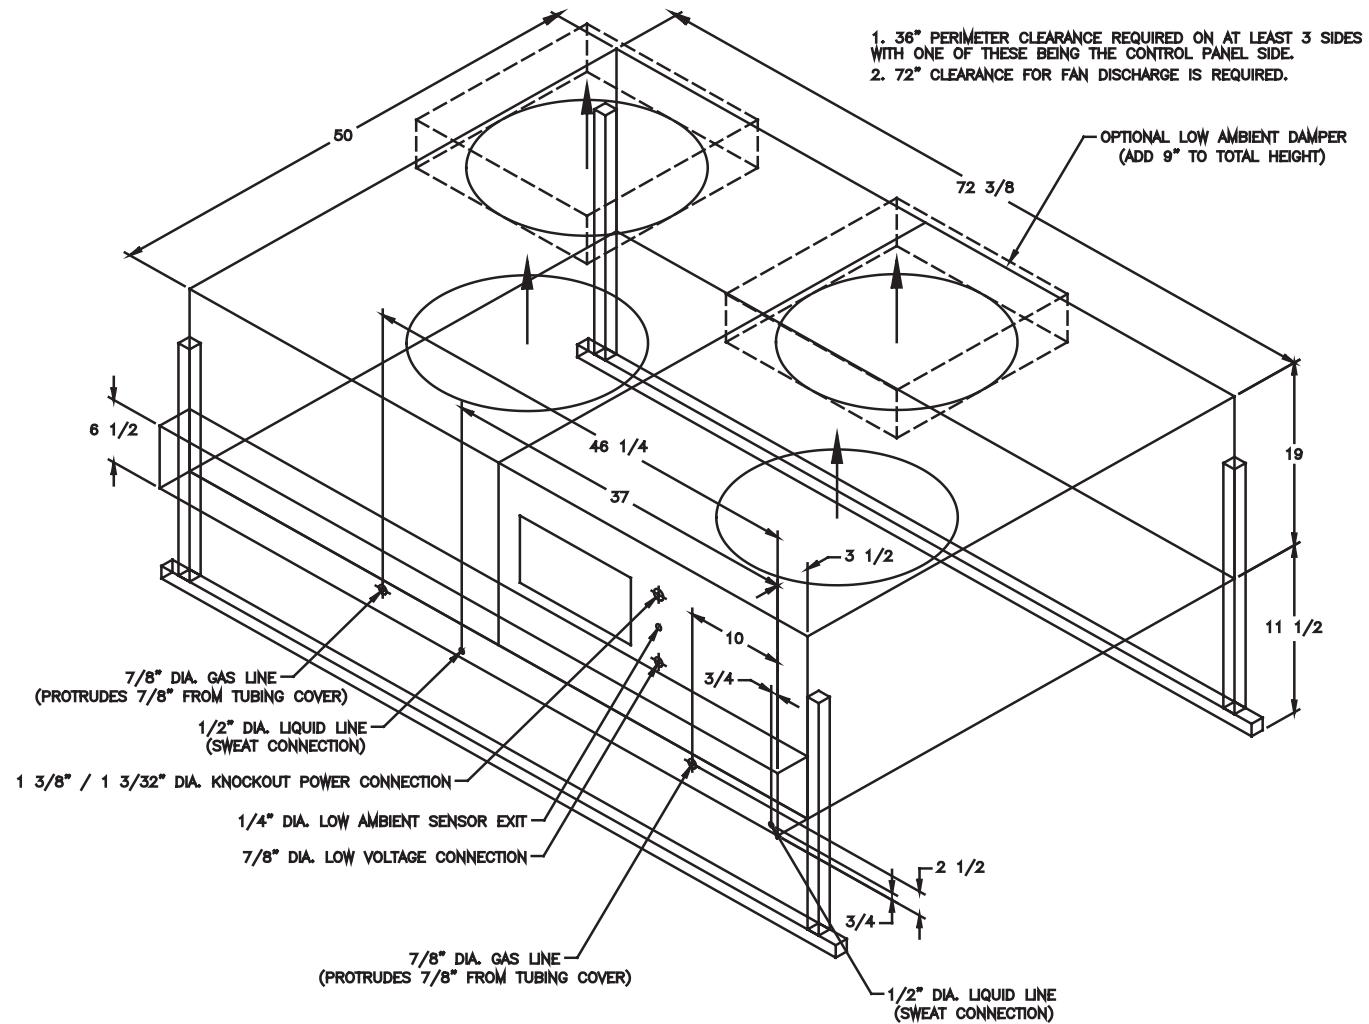



#### CCRA/CIRA Weight, lbs.

Unit Size	Operating Weight	Shipping Weight
15-Ton	440	563

# Dimensions and Weights

## Hot Water Coil

### Hot Water Coil

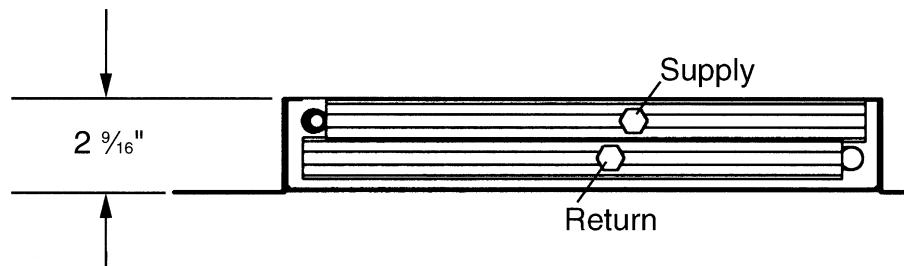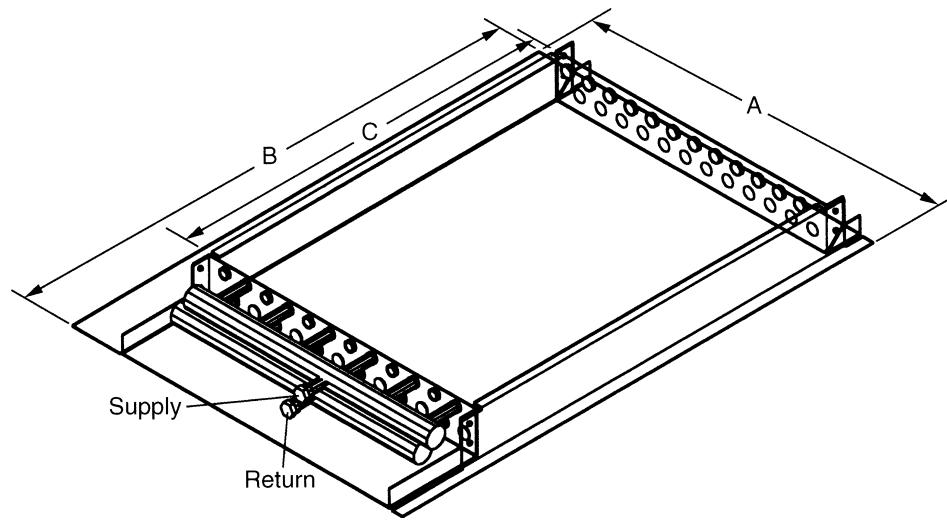

**Hot Water Coil Dimensions, in., lbs.**


Unit Size	A	B	C	Weight
3-Ton	19 $\frac{3}{4}$	28	20 $\frac{7}{16}$	25
5-Ton	19 $\frac{3}{4}$	32 $\frac{1}{2}$	25	35
7.5-Ton	19 $\frac{3}{4}$	37 $\frac{1}{4}$	29 $\frac{5}{8}$	108
10-Ton	24 $\frac{3}{4}$	62 $\frac{1}{4}$	54 $\frac{5}{8}$	121
15-Ton	24 $\frac{3}{4}$	83 $\frac{1}{4}$	75 $\frac{5}{8}$	166

# Dimensions and Weights


## Steam Coil

### Steam Coil

**Steam Coil for 3.5 and 7.5-Ton Units**

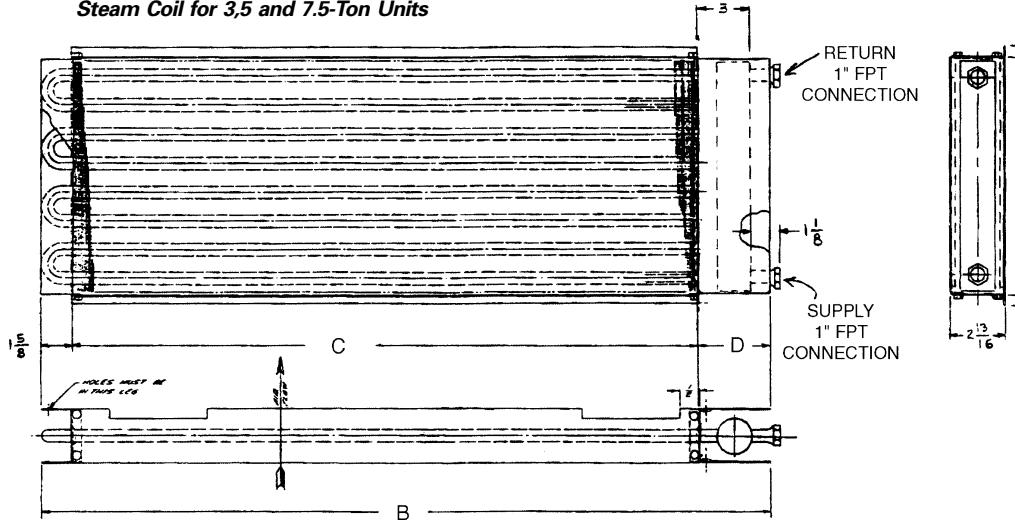

**Steam Coil for 10 and 15-Ton Units**

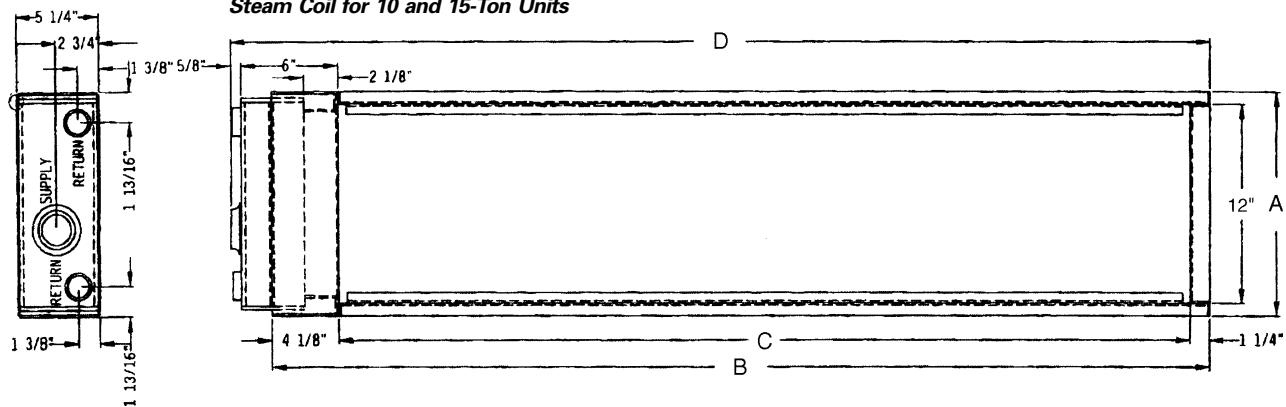



**Steam Coil Dimensions, in., lbs.**

Unit Size	A	B	C	D	E	Weight
3-Ton	12 <sup>21</sup> / <sub>32</sub>	28 <sup>13</sup> / <sub>16</sub>	23 <sup>1</sup> / <sub>4</sub>	3 <sup>11</sup> / <sub>16</sub>	12	27
5-Ton	15 <sup>5</sup> / <sub>8</sub>	33 <sup>1</sup> / <sub>4</sub>	28	3 <sup>5</sup> / <sub>8</sub>	15	35
7.5-Ton	18 <sup>5</sup> / <sub>8</sub>	37 <sup>1</sup> / <sub>4</sub>	31 <sup>15</sup> / <sub>16</sub>	3 <sup>11</sup> / <sub>16</sub>	18	127
10-Ton	13 <sup>1</sup> / <sub>2</sub>	58 <sup>5</sup> / <sub>8</sub>	53	—	—	144
15-Ton	13 <sup>1</sup> / <sub>2</sub>	78 <sup>5</sup> / <sub>8</sub>	73	—	—	196

# Dimensions and Weights

## Discharge Plenum

### Discharge Plenum

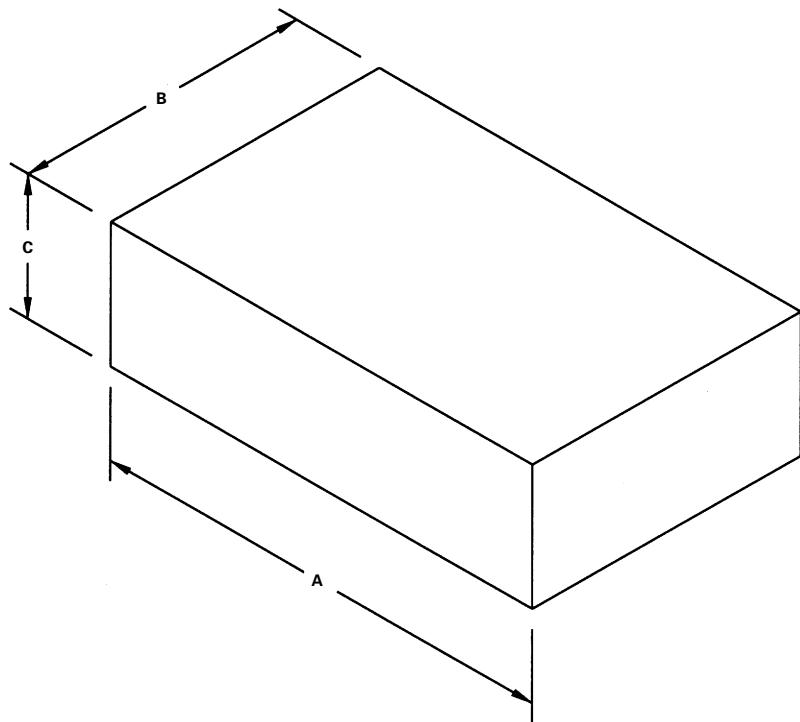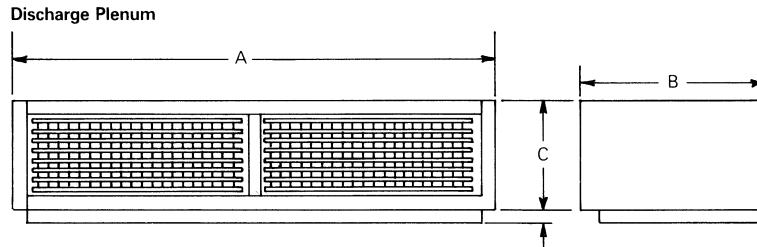

**Discharge Plenum Dimensions, in., lbs.**


Unit Size	A	B	C	Weight
3-Ton	32	22 $\frac{3}{8}$	21 $\frac{1}{4}$	55
5-Ton	36 $\frac{1}{2}$	23 $\frac{7}{8}$	17 $\frac{1}{4}$	65
7.5-Ton	41	26 $\frac{7}{8}$	15 $\frac{5}{8}$	70
10-Ton	65 $\frac{3}{4}$	29 $\frac{3}{4}$	13 $\frac{3}{4}$	84
15-Ton	88 $\frac{1}{4}$	29 $\frac{3}{4}$	15 $\frac{1}{6}$	113

## Dimensions and Weights


## Service Clearances

### Service Clearances

**Top View**  
**SCWB/SIWB/SCRB/SIRB**

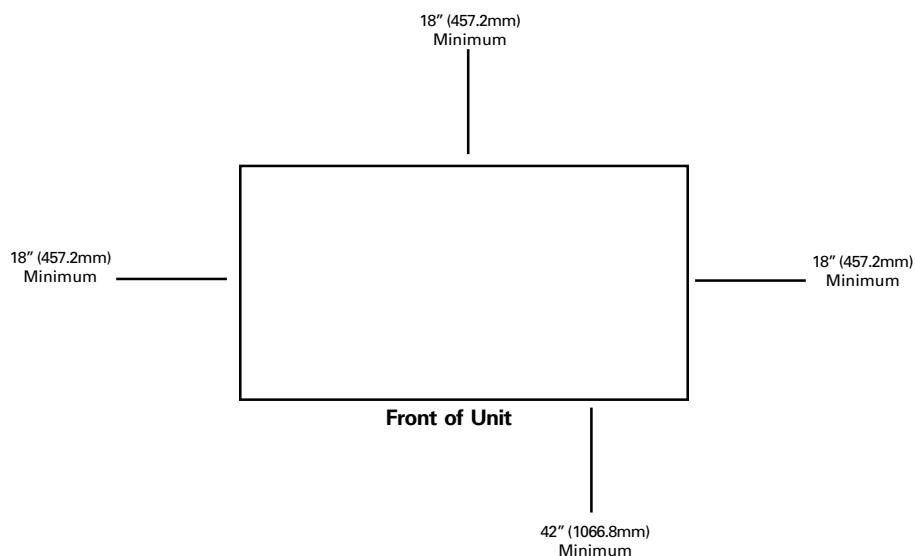

**Top View**  
**CCRA/CIRA**

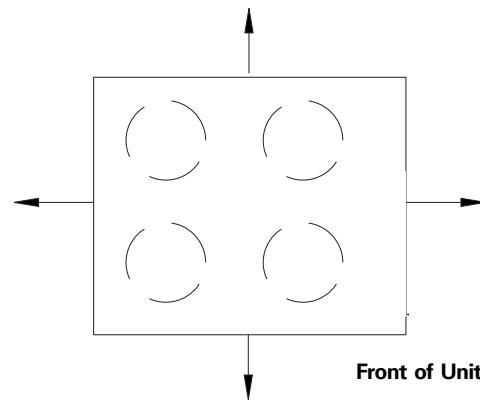

Clearances: 36" perimeter clearance required on at least 3 sides, with one of these being the control panel side. 72" top clearance required for fan discharge.



# Mechanical Specifications

## Deluxe Self-Contained SCRB/SIRB/SCWB/SIWB

### Cabinet

The unit framework is heavy gauge welded steel construction. Exterior panels are fabricated from 18-gauge zinc coated galvanized steel. The unit exterior is cleaned, phosphatized, and painted with an air-dry enamel finish. The fan and compressor sections are insulated with  $\frac{3}{4}$ -inch (19 mm) one-pound (0.5 kg) density fiberglass insulation.

The unit is provided with removable panels to allow service access to compressors, condensers, fan motor, bearings, coils, and valves. Knockouts are provided on both sides of the unit to allow electrical power, control wiring, piping connections, and fan shaft removal (10 and 15-ton units only). A decorative return air grille is provided on all 3, 5 and 7.5 ton units. The 10 and 15-ton cabinet separates into two sections for conversion into a horizontal configuration. This configuration has front and back access panels on the coil and compressor sections and front and back access to the blower section.

### Compressors

The 3, 5, and 7.5 ton units have a single compressor and 10 and 15-ton units have dual compressors. Compressors are hermetic 3600 rpm motors with crank-case heaters as standard. Each compressor has its own independent refrigerant circuit. The compressors are protected with internal motor winding temperature cutouts and are mounted on rubber-in-shear isolators for vibration isolation.

### Condenser (Water-Cooled)

The condenser is a shell and coil design with a finned, copper, inner tubing, and a steel outer shell. Piping connections are from either side of the unit. Each refrigerant circuit is provided with a separate condenser or pair of condensers. Condenser waterside working pressure cannot exceed 400 psig.

### Evaporator

The evaporator coil is constructed of seamless copper tubes expanded into aluminum fins. Tubes are  $\frac{3}{8}$ -in (9.5 mm) OD with internally enhanced surfaces. Coils are factory leak tested to 475 psig.

The drain pan is galvanized steel. Knockouts are provided on both sides of the unit for condensate removal.

### Refrigerant Circuit (Water-Cooled)

Refrigerant circuits are independent and completely piped including filter driers, distributors and thermal expansion valves with non-adjustable superheat. The circuits are leak-tested, dehydrated, and charged with oil and Refrigerant-22 at the factory. Shrader access valves are provided in the suction and liquid lines.

### Refrigerant Circuit (Air-Cooled)

Refrigerant circuits are independent and completely piped including distributors and thermal expansion valves with non-adjustable superheat. The circuits are leak tested, dehydrated, and charged with oil and nitrogen at the factory. Shrader access valves are provided in the suction and liquid lines.

### Supply Fan

The 3, 5 and 7.5 ton units have a single supply fan and the 10 and 15-ton units have two supply fans. Supply fans are forward curved centrifugal-type. The 10 and 15-ton units are secured to a solid steel shaft with permanently lubricated bearings. The drive components include variable pitch sheaves and V-belts. The supply fan motor is an open drip-proof type with a standard NEMA frame, permanently lubricated motor bearings, and a service factor of 1.00 minimum. The fan wheel is dynamically balanced at the factory.

### Filters

One-inch throwaway filters are installed in the coil section of the unit.

### Unit Controls

All units are provided with a terminal block.

### Agency Listing

The unit has the US Underwriter's Laboratory agency listing and/or the Canada CSA agency listing.

## Deluxe Self-Contained Options

### Protective Coating

### Unit

The unit's exterior and exposed interior shall have a four to six mil coat protective coating.

### Coil

The evaporator coil shall have a corrosion protective coating consisting of a conversion layer and a polyurethane top layer applied to protect in harsh environments.

### Hydronic Heating Coils

#### Hot Water

The hot water coil shall be a two-row, type WC heating coil and is field installed inside the unit's cabinet.

#### Steam

The 3, 5, and 7.5-ton steam coil shall be a one-row, type SDS heating coil. The 10 and 15 ton steam coil shall be a one-row, type NS heating coil. Steam coils shall be field installed inside the unit's cabinet.

### Discharge Plenum

The discharge plenum shall be provided with double deflection louvers to provide horizontal discharge.

### Cupro-Nickel Condenser

The condenser shall be shell and coil design with 90-10 cupro-nickel inner tubing. Piping connections shall be made from either side of the unit. Each refrigerant circuit shall be provided with a separate condenser or pair of condensers. Condenser waterside working pressure shall be 400 psig.

### Permanent Filter

One-inch permanent filters shall be provided for field installation in the coil section of the unit.

### Return Air Grille

A decorative return air grille shall be provided for field installation on 10 and 15-ton units.

### Oversized Fan Motor Kit

Oversized fan motors and drive kits shall be available for those applications where external static pressure exceeds the capability of the standard fan motor.

### Water Regulating Valve

A water regulating valve shall be provided for each condenser circuit to control condensing pressure. The  $\frac{3}{4}$ -inch valve includes a capillary tube adapter fitting to connect the liquid line Shrader valve. The water regulating valve drops the waterside operating pressure to 250 psig.



# Mechanical Specifications

## Time Delay Relay

A time delay relay shall provide a four minute time delay prior to starting the second compressor on 10 and 15-ton units to help prevent power demand surges.

## Anti-Recycle Timer

An anti-recycle timer shall be provided to protect the compressor from excessive cycling. Compressors will lock out for five minutes when either the thermostat contacts open or there is a momentary power outage.

## Rubber-in-Shear Isolation

Rubber-in-shear isolation pads shall be provided for installation under the base of the unit for vibration isolation.

## Spring Isolation

Spring vibration isolators shall be provided for installation under the base of the unit for vibration isolation.

## Unit Mounted Thermostat

Unit mounted cooling only thermostat with up to two stages of cooling can be factory or field installed on the unit.

## Remote Mounted Thermostat

A remote 0heat/2cool thermostat shall be provided on 3, 5, and 7.5 ton units. A remote 2heat/2cool manual or auto thermostat shall be provided on 10 and 15-ton units.

## Remote Programmable Thermostat

A remote programmable 1heat/2cool thermostat shall be provided on 3, 5 and 7.5 ton units. A remote programmable 2heat/2cool thermostat shall be provided on 10 and 15-ton units.

## Remote Air-Cooled Condenser CCRA/CIRA

### Cabinet

The unit framework is formed of heavy gauge welded steel. Exterior panels are fabricated from 18-gauge galvanized steel.

### Refrigerant Circuits and Controls

The 3, 5, and 7.5-ton units shall have a single refrigerant circuit and the 10 and 15-ton unit have dual refrigeration circuits. All units are provided with an integral subcooling circuit and factory installed controls to run the unit fans. The control panel includes fan motor contactors, a terminal block connection

for compressor interlock, and a 115-volt control power transformer.

### Condenser Coil

A condenser coil with a slab-type arrangement is provided. The coil is constructed of seamless,  $\frac{3}{8}$ -in (9.5 mm) O.D. copper tubes, expanded into aluminum fins. Each circuit includes an integral subcooler. The coil is leak-tested under water at 425 psig.

### Condenser Fan and Motor

Condenser fans are weatherproof with a permanently lubricated motor and built-in thermal overload protection. Fans are direct drive type and are statically and dynamically balanced at the factory. The 3 and 5-ton units have a single condenser fan. The 7.5 and 10-ton units have two condenser fans. The 15-ton unit has four condenser fans.

### Protective Coating Option Unit

The unit interior and exterior shall have a four to six mil protective coating applied with an air-dry process.

### Condenser Coil

The condenser coil has a corrosion protective coating consisting of a conversion layer and a polyurethane top layer applied to protect from harsh environments.

### Low Ambient Operation Option

The low ambient damper allows operation down to 0°F (-17.78°C) by utilizing additional fan cycling and an external damper assembly for head pressure control. The low ambient damper includes a 16-gauge damper assembly, HCFC-22 operator, tubing and adapter fittings, rubber grommet, and all necessary mounting hardware and instructions for field installation.

### Agency Listing

The unit has the US Underwriter's Laboratory agency listing and/or the Canada CSA agency listing.



**The Trane Company**  
A Division of American Standard Inc.  
[www.trane.com](http://www.trane.com)

For more information, contact your local Trane  
office or e-mail [comfort@trane.com](mailto:comfort@trane.com)

An American Standard Company

Literature Order Number	PKG-PRC010-EN
File Number	PL-UN-PKG-PRC010-EN 1201
Supersedes	PKG-DS-2 10/98
Stocking Location	La Crosse – Inland

The Trane Company has a policy of continuous product improvement and reserves the right to change design and specifications without notice.

Free Manuals Download Website

<http://myh66.com>

<http://usermanuals.us>

<http://www.somanuals.com>

<http://www.4manuals.cc>

<http://www.manual-lib.com>

<http://www.404manual.com>

<http://www.luxmanual.com>

<http://aubethermostatmanual.com>

Golf course search by state

<http://golfingnear.com>

Email search by domain

<http://emailbydomain.com>

Auto manuals search

<http://auto.somanuals.com>

TV manuals search

<http://tv.somanuals.com>