

ROOM AIR CONDITIONER OWNER'S MANUAL

Please read the operating instructions and safety precautions carefully and thoroughly before installing and operating your room air conditioner.

MANUEL D'UTILISATION CLIMATISEUR DE FENÊTRE

Veuillez lire attentivement et en entier ce guide d'utilisation et les mesures de sécurité ci-incluses avant de procéder à l'installation et au fonctionnement de votre climatiseur.

AIRE ACONDICIONADOR MANUAL DEL PROPIETARIO

Por favor lea las instrucciones de operación y las precauciones de seguridad cuidadosa y totalmente antes de instalar y operar su acondicionador de aire de ventana.

MODELS, MODÈLES, MODELOS: LXA0810ACL LXA1010ACL

LXA1010ACL

LXA1210ACL LXA1230ACL Electrical Data

About the Controls on

r Conditione

he

Safety Precautions

Safety Precautions3

Electrical Data Electrical Data......5

Controis	0
Ventilation	8
Air Direction	8

Care and Maintenance

Air Filter Cleaning9
How to Attach Front Grille to
Cabinet9

Features and Installation

Features10 How to Install the Unit11 How to Replace the Unit ...11 Installation Kits Contents...12

Before you call for service...

Normal Operation15 Abnormal Operation15



FOR YOUR RECORDS

Staple your receipt to this page in case you need it later. Write down the model and serial numbers here:

Model

Serial #

You can find them on a label on the side of each unit.

Dealer's Name

Date Purchased




READ THIS MANUAL

Inside you will find many helpful hints on how to use and maintain your air conditioner properly. Just a little preventive care on your part can save you a great deal of time and money over the life of your air conditioner.

You'll find many answers to common problems in the chart of troubleshooting tips. If you review our chart of **Troubleshooting Tips** first, you may not need to call for service at all.

CAUTION

- Contact an authorized Service technician for repair or maintenance of this unit.
- The air conditioner is not intended for use by young children or invalids without supervision.
- Young children should be supervised to ensure that they do not play with the air conditioner.

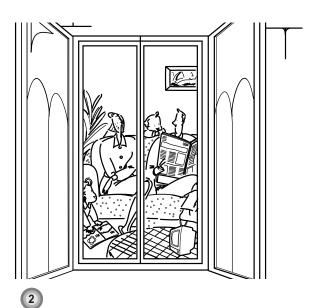

Safety Precautions


To prevent injury to the user or other people and property damage, the following instructions must be followed.


■ Incorrect operation due to ignoring of instruction will cause harm or damage.


The seriousness is classified by the following indications.

: This symbol indicates the possibility of death or serious injury.
 This symbol indicates the possibility of injury or damage to properties only.


Meanings of symbols used in this manual are as shown below.



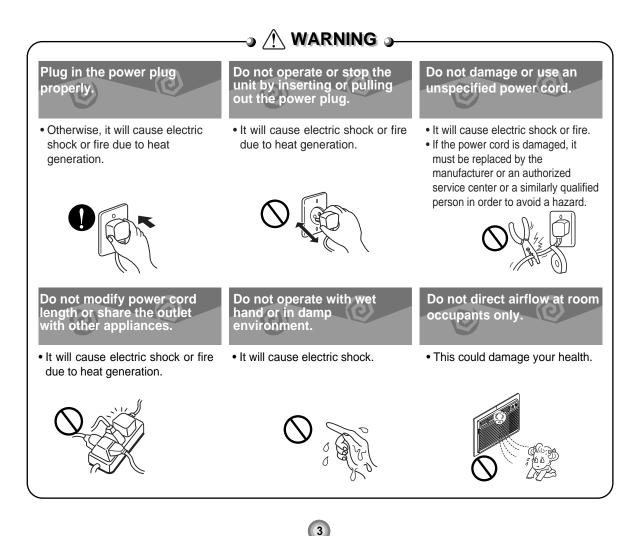

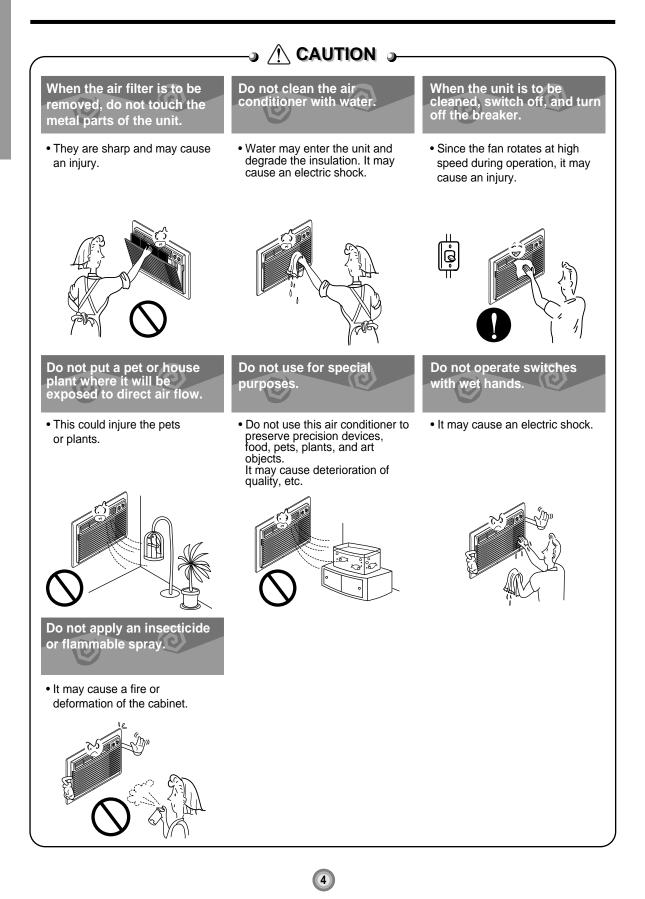


Electrical Data(For 115V model)

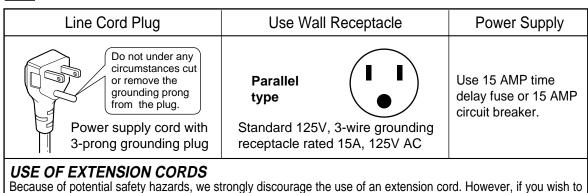

use an extension cord, use a CSA certified/UL-listed 3-wire (grounding) extension cord, rated 15A, 125V.

Electrical Data(For 230/208V model)

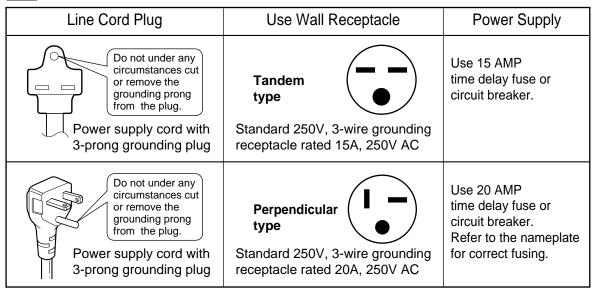

All wiring should be made in accordance with local electrical codes and regulations. **NOTE :** Aluminum house wiring may pose special problems. Consult a qualified electrician.

ELECTRICAL SAFETY

IMPORTANT GROUNDING INSTRUCTIONS

Air conditioner has a three-prong grounding plug on its power supply cord, which must be plugged into properly grounded three-prong wall receptacle for your protection against possible shock hazard.

FUSE – Use a time-delay fuse or circuit breaker. Refer to the nameplate for proper power supply requirements.


208, 230, and 208/230 VOLT UNITS

These units are equipped with a three-prong grounding plug on the power supply cord, which must be plugged into a matching properly grounded three-prong wall receptacle for your protection against possible shock hazard. If such an outlet is not present, one must be installed by a qualified electrician in accordance with the National Electrical Code and local codes and ordinances.

NOTE: DO NOT USE AN EXTENSION CORD ON 208, 230, AND 208/230 VOLT UNITS. The controls will look like one of the following:



Controls – Cooling Only

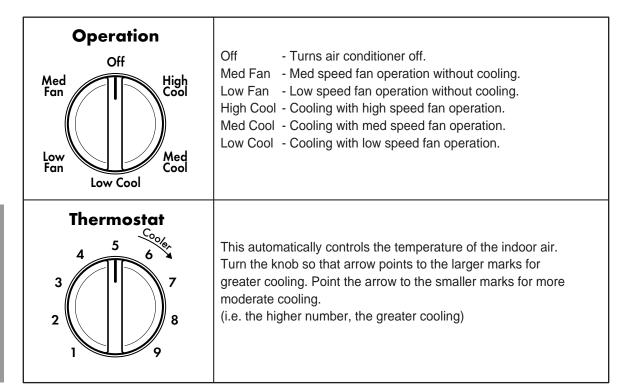

• FOR NORMAL COOLING

- 1. Turn the Operation Knob to the **High Cool** from the **Low Cool** setting.
- 2. Set the Thermostat control to the desired temperature mark **5** (the mid-point is a good starting position). If the room temperature is not satisfactory after a reasonable time, adjust the control to a cooler or warmer setting, as appropriate.

• FOR MAXIMUM COOLING

- 1. Turn the Operation Knob to the High Cool setting.
- 2. Set the Thermostat control to the largest **9** temperature mark.

• FOR QUIETER OPERATION

- 1. Turn the Operation Knob to the Low Cool setting.
- 2. Set the Thermostat control as needed.

• ENERGY SAVER (optional)

On : Both the fan and the compressor turn on and turn off together while operation knob is set to the Cool position.

You can get the more economical operation.

Off : The fan runs constantly while operation knob is set to the Cool position.


Ene	ergy Save	r
Off	·	On

You can access the Energy Saver switch when you open the inlet grille.

About the Controls on the Air Conditioner The controls will look like one of the following:



Controls – Cooling & Heating

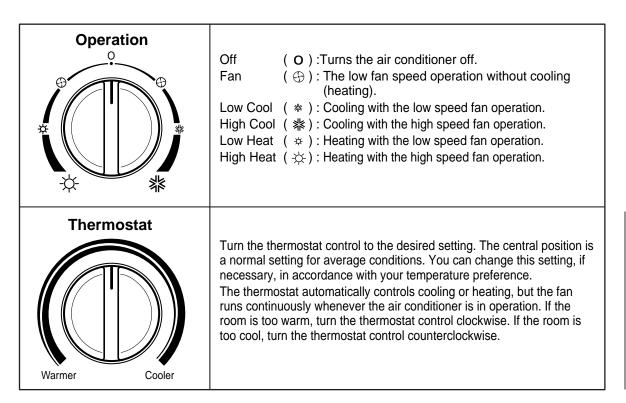

7

• THE AIR CONDITIONER

This automatically controls the temperature of the indoor air.

The compressor will turn on and off to keep the room at the setting temperature.

In the heating operation, the electric heater will turn on and off to keep the room at the setting temperature.

• HEAT PUMP MODELS

When the outdoor temperature is lower than -4°C (24°F), the electric heater will turn on instead of the heat pump.

CAUTION

When the air conditioner has been performed its cooling or heating operation and is turned off or set to the fan position, wait at least 3 minutes before resetting to the cooling operation again. A slight heat odor may come from the unit when first switching to HEAT after the cooling season is over. This odor, caused by fine dust particles on the heater, will disappear quickly. This is harmless.


Additional controls and important information.

Ventilation

The ventilation lever is located in the right of the air discharge. The ventilation lever must be in the CLOSE position in order to maintain the best cooling conditions.

When fresh air is necessary in the room, set the ventilation lever to the OPEN position.

The damper is opened and room air is exhausted outside.




PULL OPEN / PUSH CLOSE

Air Direction

The direction of air can be controlled wherever you want by adjusting the horizontal louver and the vertical louver.


HORIZONTAL AIR-DIRECTION CONTROL

The horizontal air direction is adjusted by moving vertical louver. The lever of vertical louver is located in the right and left side of the air discharge.



• VERTICAL AIR-DIRECTION CONTROL

The vertical air direction is adjusted by moving the horizontal louver.




TURN THE AIR CONDITIONER OFF AND REMOVE THE PLUG FROM THE POWER OUTLET.


Air Filter Cleaning

The air filter should be checked at least twice a month to see if cleaning is necessary. Trapped particles in the filter will build up and block the airflow. This reduces the cooling capacity and also causes an accumulation of frost on the cooling coils.

If the filter becomes turn or damaged you should replace immediately. Replacement filters are available from your salesperson, dealer, and the authorized customer service centers.

- 1. Open the inlet grille downward by pulling out the top of the inlet grille.
- 2. Remove the air filter from the front grille assembly by pulling the air filter up slightly.
- 3. Wash the filter using lukewarm water below 40°C (104°F).
- 4. Gently shake the excess water from the filter completely. Replace the filter.







About the Controls or the Air Conditioner


How to Attach Front Grille to Cabinet

The front grille can be removed for cleaning or to check the model and serial numbers. For your safety, you should attach the front grille as the following procedures.

- 1. Pull down front grille from the cabinet top.
- 2. Push front grille's tips toward the cabinet in order to insert front grille's tabs into the cabinet.
- 3. Open the inlet grille.
- 4. Tighten the screw through the front grille into the plate of control box.
- 5. Close inlet grille.








9

Learning parts name prior to installation will help you understand the installation procedure.

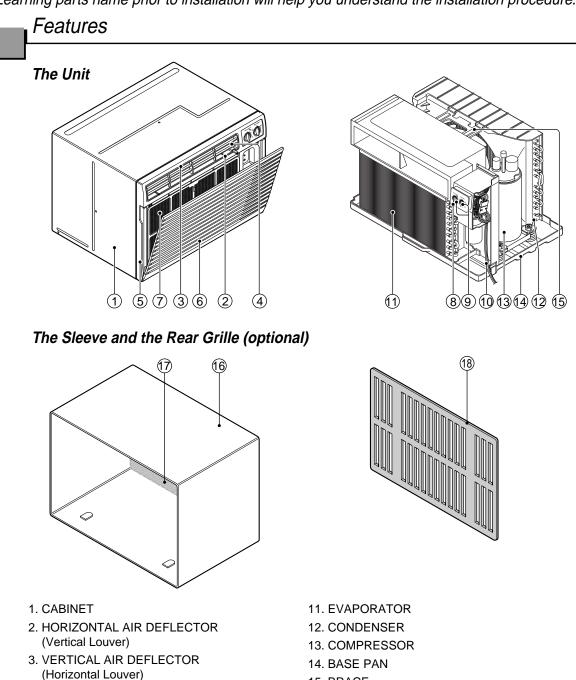

- 15. BRACE
 - 16. SLEEVE ASSEMBLY (Including Expanded Aluminum Rear grille, optional)
 - 17. REAR GRILLE (Expanded Aluminum Rear grille, optional)
 - 18. REAR GRILLE (Aluminum louvered Rear grille, optional)

10

4. AIR DISCHARGE

8. CONTROL BOARD

6. INLET GRILLE (Air Intake)

5. FRONT GRILLE

7. AIR FILTER

10. POWER CORD

9. KNOBS

How to Install the Unit


CAUTION : There are sharp edges that can cause serious cuts.

CAUTION: When lifting the air conditioner, it is HEAVY. Use 2 peoples to lift.

For existing sleeve, you should measure the wall sleeve dimensions.

You can install the new air conditioner according to these installation instructions to achieve the best performence. All wall sleeves used to mount the new air conditioner must be in good structural condition and have the rear grille that securely attaches to the sleeve or the flange of the sleeve to secure the new air conditioner.

With the LG sleeve, you can maintain the best performance of the new air conditioner. If you keep the existing sleeve, you run the risk of poor performance or product failure. This is not covered under the LG warranty.

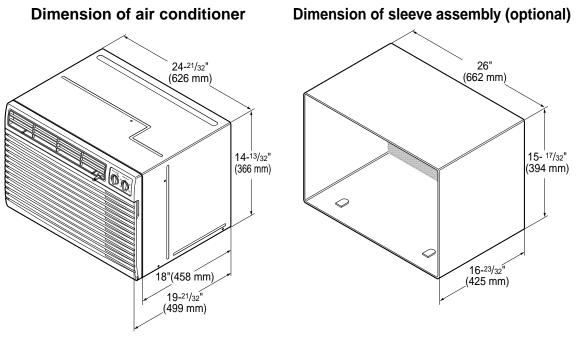


How to Replace the Unit


Note : When you completed the installation, the new air conditioner unit should have a rearward slope, as shown below.

 Remove the old air conditioner from the wall sleeve and prepare the wall sleeve.
 Clean the interior of the sleeve (do not disturb the insulation

or seals).


The wall sleeve must be fastened in the wall securely before installing the new air conditioner.



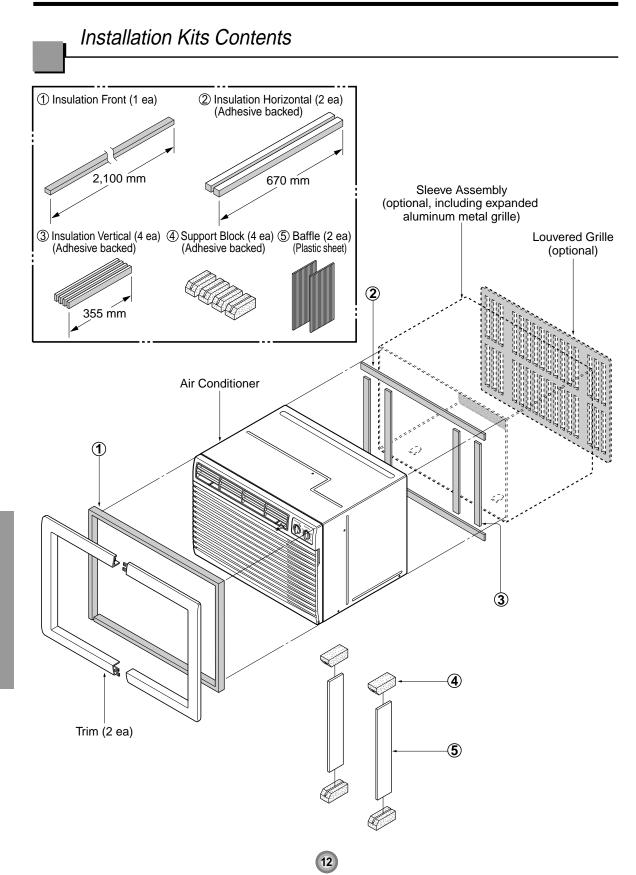

- 2. Prepare the wall sleeve for installation of the new unit according to the following installation procedures. Before you prepare the wall sleeve, you should check the wall sleeve dimensions.
- 3. Redirect the louvers at the back of the wall sleeves as following A and B lengths in the below table.

Width of the existing wall sleeve	Α	В
25-1/2" (648 mm)	2- ³ /4" (70 mm)	4-3/4" (120 mm)
25- ³ /4" (654 mm)	2- ³ /4" (70 mm)	5" (130 mm)
26" (660 mm)	3" (75 mm)	5" (130 mm)
26- ³ /4" (680 mm)	3-1/4" (80 mm)	5-1/2" (140 mm)
27" (686 mm)	3-1/2" (90 mm)	5-1/2" (140 mm)




Insulation Horizontal

(2 ea)

4. Sleeve (up to 18 inches deep) When the depth of your existing sleeve is deeper than 18", please skip to step 5. Remove the backing from horizontal insulation and attach them to the inside of the wall sleeve as shown below.

Remove the backing from insulation vertical and attach them to the inside of the wall sleeve, as shown below.

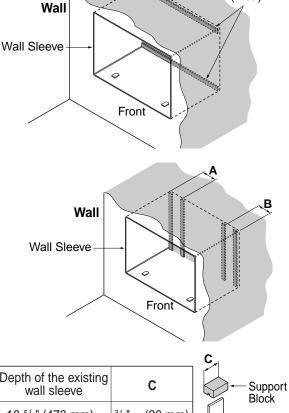


5. Sleeve (18~22 inches deep)

When the depth of your existing sleeve is not deeper than 18", please skip to step 6.

Cut the baffles and the support blocks as following **C** length in the below table.

		C
Depth of the existing wall sleeve	С	Suppo Block
18-⁵/ଃ" (473 mm)	³ /4" (20 mm)	
19- ³ /4" (502 mm)	1- ³ /4" (45 mm)	Baffle
22" (559 mm)	4" (100 mm)	C

13

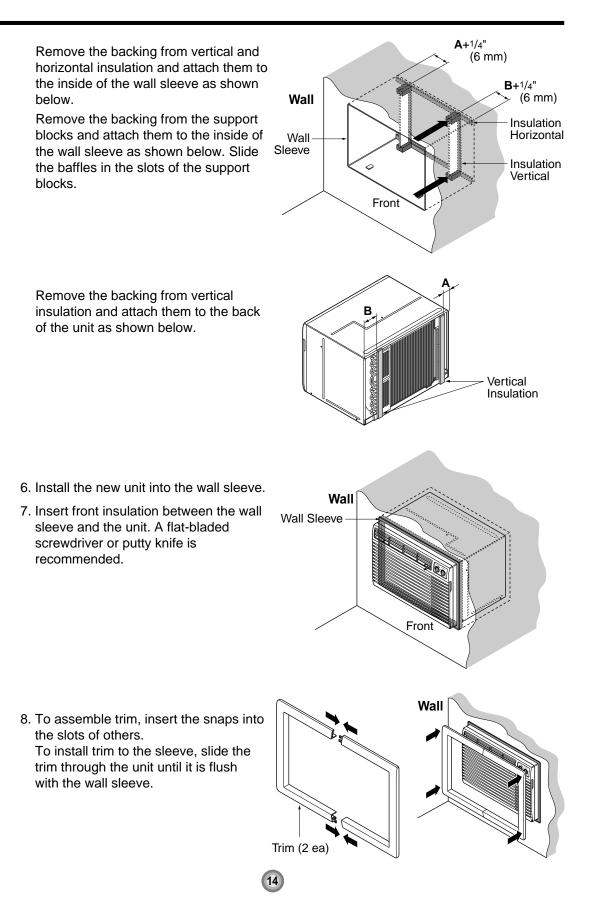

Troubleshooting Tips Save time and money! Review the chart below first and you may not need to call for service.

Normal Operation

- You may hear a pinging noise caused by water being picked up and thrown against the condenser on rainy days or when the humidity is high. This design feature helps remove moisture and improve efficiency.
- You may hear the thermostat click when the compressor cycles on and off.
- Water will collect in the base pan during high humidity or on rainy days. The water may overflow and drip from the outdoor side of the unit.
- The fan may run even when the compressor does not.

Abnormal Operation

Problem	Possible Causes	What To Do
Air conditioner does not start	The air conditioner is unplugged.	 Make sure the air conditioner plug is pushed completely into the outlet.
	The fuse is blown/circuit breaker is tripped.	 Check the house fuse/circuit breaker box and replace the fuse or reset the breaker.
	■ Power failure.	• If power failure occurs, turn the mode control to OFF . When power is restored, wait 3 minutes to restart the air conditioner to prevent tripping of the compressor overload.
Air conditioner does not cool as it should	Airflow is restricted.	 Make sure there are no curtains, blinds, or furniture blocking the front of the air conditioner.
	The THERMOSTAT may not be set high enough.	 Turn the knob to a higher number. The highest setting provides maximum cooling.
	■ The air filter is dirty.	Clean the filter at least every 2 weeks. See the operating instructions section.
	The room may have been hot.	 When the air conditioner is first turned on, you need to allow time for the room to cool down.
	■ Cold air is escaping.	 Check for open furnace floor registers and cold air returns. Set the air conditioner's vent to the closed position.
	Cooling coils have iced up.	See Air Conditioner Freezing Up below.
Air conditioner freezing up	■ Ice blocks the air flow and stops the air conditioner from cooling the room.	• Set the mode control at Med Fan or High Cool with the thermostat at 1 or 2 .

Free Manuals Download Website <u>http://myh66.com</u> <u>http://usermanuals.us</u> <u>http://www.somanuals.com</u> <u>http://www.4manuals.cc</u> <u>http://www.4manuals.cc</u> <u>http://www.4manuals.cc</u> <u>http://www.4manuals.com</u> <u>http://www.404manual.com</u> <u>http://www.luxmanual.com</u> <u>http://aubethermostatmanual.com</u> Golf course search by state

http://golfingnear.com Email search by domain

http://emailbydomain.com Auto manuals search

http://auto.somanuals.com TV manuals search

http://tv.somanuals.com