Belkin Bulldog Plus

Shutdown Management Software for Windows



User's Manual

Table of Contents

INTRODUCTION	5
Bulldog Plus features:	5
BULLDOG PLUS INSTALLATION	5
Bulldog Plus Setup:	6
BULLDOG PLUS SERVICE	7
BULLDOG PLUS MONITOR	9
NETWORKING	11
Operation Mode:	11
Remote Monitoring and Control:	11
Remote Monitoring and Control: Using Internet Browser	12
BULLDOG PLUS MONITOR OPERATIONS	14
Top Layer Buttons	14
Bulldog Monitor Main Menu	15
SYSTEM	16
Login	16
Monitor Screen	17
Font	17
Window	17
Close Monitor	18
CONFIGURATION	19
Configuration Window	19
DEVICES	21
Modem錯誤! 尚未定	義書籤。
Notification Users Pager List	21
Notification Users e-mail	
Notifify Users Network Broadcast	21
Color	21
Close	22
UPS	23
UPS Property	23
Attached Devices	23
Log Management:	24
Schedule	24
Action	25
Action - Shutdown:	26



	Action - Logging:	26
	Action - Broadcasting:	27
	Action - Paging:	27
	Action- Command:	27
	Action - Alarm:	27
	Action - e-mail:	27
	Action - SNMP Trap:	27
	Action - Receptacle Control:	28
Stop	All Action	28
Volt	age Sensitivity	28
Trar	nsfer Voltage	28
ADVAN	CED UPS PROPERTY	29
NETWO	RK	30
Set	Password	30
Cho	ose Master/Slave	30
Wak	e On LAN	31
SNN	<i>И</i> Р	32
	SNMP Trap Number:	33
HTT	Р	34
CONTRO	OL	35
Shu	tdown Now	35
Can	cel Shutdown	35
Turr	Receptacle Relay On	36
Turr	n Receptacle Relay Off	36
UPS	S Audible Alarm On	36
UPS	S Audible Alarm Off	36
10 S	Seconds Test	36
Dee	p Battery Test	36
Can	cel Test	36
VIEW		37
Mete	ers	37
Eve	nt Log	37
Hist	ory Graph	38
Hist	ory Data	39
Auto		
Ren	o Save	39
	o Save note Hosts	
BOTTO		40
	note Hosts	40 41



42



Introduction

Congratulations on your purchase of Bulldog Plus to manage your Uninterruptible Power Supply (UPS). Bulldog Plus is designed to provide end users the ability to take proactive steps to protect their equipment from power related damages. Bulldog Plus allows for automatic shutdowns, scheduled shutdowns and a variety of other features that help you manage your system and its peripheral components.

Bulldog Plus provides detailed information about the UPS and its protected equipment. It is easy to install and program, yet has the necessary features to handle all of one's power requirements. Included is the capability for network management protocol (SNMP). Bulldog Plus will disseminate UPS information into SNMP protocol and project it to the appropriate Network Management Station (NMS), such as HP OpenView. To make use of resources on the Internet, Bulldog Plus also supports HTTP protocol. This enables end-users to monitor their UPS anywhere, anytime, by simply utilizing their web browser.

Bulldog Plus runs in the background as a Windows service, and communicates with the UPS in order to ensure that your computer and attached components are protected from any power problems.

Bulldog Plus features:

- 1.Graceful operating system shutdown
- 2.Scheduled tests, shutdown/restarts of the UPS, turn on/off receptacles
- 3.Flexible events
- 4.Notification: Pager, e-mail and audible alarm, network broadcasting and SNMP
- 5.Real-time values of voltage, current, frequency and loading...
- 6.Historical data & graph
- 7.Network monitoring
- 8.Multi-computer shutdown/restart
- 9. Support Simple Network Management Protocol (SNMP)
- 11.Support HTTP, remote monitor and control using Internet browser
- 12.Support Universal Serial Bus (USB)
- 13.Multi-lingual menus



Bulldog Plus Installation

Please note that the USB communication is not supported by Windows 95 and NT4.0.

Bulldog Plus Setup:

- 1. Turn off your computer.
- 2. Attach the electrical power cable from the computer to the UPS.
- 3. Attach the electrical power cable from the UPS to an AC power outlet.
- 4. Plug the communication cable into the UPS, then plug the other end of the cable into the communication port on your computer.
- 5. Start your computer.
- 6. Check the communication type of your UPS. If you select the USB option you must have connected the UPS to the computer and install the HID driver.
- 7. Place the Bulldog CD in your CD-ROM device and execute the setup.exe to run the setup program.
- 8. During the installation, the following dialog gives you 3 options:
 - Program File: Files contain Bulldog Service, Bulldog Monitor and this on-line help.
 - Audio Files: Some .wav files. These files will be played to notify you when power event occurs.
 - SNMP Files: Bulldog Plus SNMP DLL file.
- 9. After finishing the installation, the setup process will create a Bulldog Plus association.
- 10. The Bulldog Plus software is comprised of two modules:
 - An UPS Monitoring Module (Bulldog Service), which runs in the background as a Windows Service and communicates to the UPS.
 - An User Interface Module (Bulldog Monitor), which enables you to control and configure Bulldog Plus through the drop down menus and dialog boxes. It also allows you to monitor the UPS through the Main Screen.

Uninstall: To remove Bulldog Plus from your hard disk.

Help: Bulldog Plus on-line help.

Bulldog Monitor: User interface, used to monitor and configure your UPS. Bulldog Status: Reflect the status of Bulldog Plus service program, the service is used to communicate with your UPS.



Bulldog Plus Service

Belkin Bulldog Service runs in the background as a Windows Service when the system initiates. You can also run Bulldog Service manually by selecting the Start Menu- Program Files - Belkin Bulldog - Bulldog Service. Once Bulldog Service starts there is a Bulldog Service icon located on the system tray to indicate UPS status.

1. Normal



2. UPS Disconnect, cannot get any information from UPS.




UPS Disconnect

3. Power Failed! The UPS is operating on battery power.



4. UPS Bypass Active!



Moving your mouse over the Bulldog Plus icon in the system tray and click the right button to pop up the following menu




• Show Countdown: **Belkin Bulldog** displays the countdown time (time to shutdown/suspend the operating system) window to remind the user that the operating system will shutdown or suspend in the displayed time. This function lets the user know clearly how much time is left to shutdown/suspend the computer when power fails. The operating system shutdown time can be adjusted from the Action menu



	SHUT 00	:04:42
8₩4){ <mark>En</mark>	17:12 PM

- Monitor: Run the Bulldog Plus user interface.
- Configuration: Displays the configuration window, allows you to change the UPS parameters.
- Meters: Shows UPS real-time meters.
- Program Stop: If this item marked Bulldog Plus stopped. Unmark it and the program will resume.

Once a power event has occurred, Bulldog Plus will pop up a broadcast dialog box to inform user what happened to UPS.

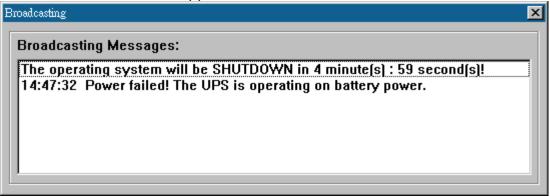



Bulldog Plus Monitor

Bulldog Monitor enables you to control and configure Bulldog Plus through drop down menus and dialog boxes. It also allows you to monitor the UPS through the Main Screen. It is not necessary for Bulldog Monitor to reside in your computer's memory, the execution depends on the user's requirement. This can save precious system resources.

After finishing the Bulldog Plus installation, Bulldog Service automatically loads into memory and runs once the Windows operating system starts up. There is a Bulldog Plus icon that lies in the system tray to indicate current UPS status.

To run the Bulldog Monitor, moves the mouse cursor over the Bulldog Plus icon and double-click to launch Bulldog Monitor, or click the right button to pop up the menu:



Then select Monitor to run the program. You can also launch Bulldog Monitor without running Bulldog Service, select Bulldog Monitor from Program Files - Bulldog Plus menu.



-	anaogini							
•	🔪 BELKIN E	BULLDOG H	lus Monitor					_ 🗆 🗵
2	ystem <u>C</u> on	trol <u>V</u> iew	<u>W</u> izard <u>1</u>	<u>H</u> elp				
	7 Configure) Meters	7 Event Log	hilİİh ; History			BEL	KIN
]	Host Selectio	n Local=tn	sofzem 172.	16.176.141	Model=BU100	KR 2000	OS=Wind	ows 98 💌
	UPS Health	u 🥝	<u>www.b</u>	elkin.com	Test Result:		est Perforn	ned
	UP	S Type: On	-Line	_	AC Source:			
	IIPS	Model: BII	100XR 200	n	Battery Stat	us: Norr	nal	
					Battery Lev	el: 100 9	6	
	Firmware V	Version: 1.0					Ĩ	
	Hos	t Name: ms	ofzem					
	Rating VA: 1000VA				Loading Le	vel: 19 %	;	
		ашıg тА. П	000YA					
	Rating In	iput Volt: 1	10V		Input Volta	zel	📗 Output V	oltage1
	RatingOu	tput Volt: 1	107		82		8	
	Rating Bat	tery Volt: 4	17	_	41	123	41	123
	Rating In	put Freq: 6	OHz		0 118.87	165	0 11	OV 1 165
1	2/05/2001-13	3:55:26 <ui< th=""><th>?S communi</th><th>cation establ</th><th>ished!></th><th></th><th></th><th>•</th></ui<>	?S communi	cation establ	ished!>			•
	Main	🗶 Tree	Time) Status	27) Diagram	N Scroll	Receptacle	Network

Bulldog Monitor Main Screen:




Networking

BULLDOG Plus software is comprised of two modules: **BULLDOG Service** and **BULLDOG Monitor**. You may run both the programs in a computer to monitor your localized UPS or run the programs in two different computers.

Operation Mode:

BULLDOG Service can operate in "Master" Mode (which allows BULLDOG to send commands to its connected UPS) in "Serial Slave" mode (which listens to its connected UPS) or in "Networking Slave" mode (which obtains the UPS information from Master via the network). If two or more computers are communicating with a single UPS, only one of these computers should be in Master mode; the others should be in Slave mode to prevent them from sending contradictory commands.

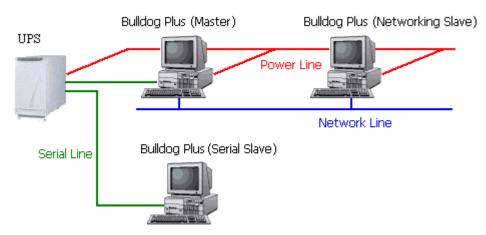


When a power event occurs, the Master gets the information then transmits it to Salve(s). Each BULLDOG Service executes different "Actions"(FlexEvent) so that the system manager can configure different strategies into each different computer. For example: When a power failure occurs, the file server and mail server won't shutdown until the UPS battery is low, but other less important workstations execute shutdown after 5 minutes, and the initial workstations shutdown after 10 minutes. Shutting down workstations preserves more battery power for your mission critical network servers.

Remote Monitoring and Control:

Bulldog Monitor has the ability to monitor Local hosts and Remote hosts.



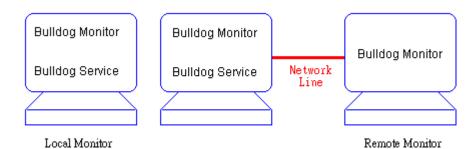

You can run only Bulldog Monitor without running Bulldog Service. Bulldog Monitor will search hosts in the LAN(Local Area Network) which runs Bulldog Service in the combo box. Click on the Host Selection combo box to list the searched hosts in the LAN. Select one, then Bulldog Monitor will connect to the selected host.

🔍 BELKIN BU	LLDOG P	lus Monitor				
<u>S</u> ystem <u>C</u> ontro	ol <u>V</u> iew	<u>W</u> izard <u>H</u> e	lp			
Configure	S) Meters	7 Event Log	hlÌÌÌh History			BELKIN
Host Selection	Local=tns	ofzcm 172.16	.176.141	Model=GES651	V110100	OS=Windows 98 . 💌
UPS Health:	Host=tner Host=sun- Host=tner	ngkzl 172.16.1 -sparc1 172.16 ngwzs 172.16.	.76.100 N 5.176.144 176.106 I	fodel=Unknown Model=GES651 Model=Unknown	OS=Win V110100 OS=Win	udows 98 A) OS=SunOS 5.5.1 ndows 98 A OS=Linux 2 2 14-3 Olp OS=HP-UX B 10.20
UPS	Host=ups	web 172.16.17	/6.153 M	odel=BU100XR	2000 (OS=Linux 2.2.14-3.0lp
UPS M	Host=hj	pupsU 172.16.	176.147 1	Model=BU100XI 5.154 Model=BU	R 2000	OS=HP-UX B.10.20 2000 OS=SCO SV 3

If the host is located on the Internet, you can also input the remote host IP address from the View Menu- Remote Hosts menu shows the hosts you can establish connections with.

Remote Hosts 🔀
💿 Search Result
 Host=thengfwm 172.16.176.129 Model=Unknown OS=Windows 98 A Host=sun-ultra1 172.16.176.145 Model=Unknown OS=SunOS 5.5.1 Host=sun-sparc1 172.16.176.144 Model=GES651V110100 OS=SunOS Host=upsweb 172.16.176.153 Model=BU100XR 2000 OS=Linux 2.2 Host=scok6.delta.tw 172.16.176.154 Model=BU100XR 2000 OS=HP-UX Host=hpups0 172.16.176.147 Model=BU100XR 2000 OS=Linux Host=upsweb2 172.16.176.155 Model=BU100XR 2000 OS=Linux Host=upsweb2 172.16.176.155 Model=BU100XR 2000 OS=Linux Host=thpups0 172.16.176.155 Model=BU100XR 2000 OS=Linux Host=thpups0 172.16.176.155 Model=BU100XR 2000 OS=Linux
C Connect To This IP Address

Remote Monitoring and Control: Using Internet Browser.

Another way to remote monitor Bulldog Service is by using the Internet Browser. Launch the Microsoft Internet Explorer or Netscape




Communicato	r, type th	e IP addres	s in the l	JRL and pr	ess enter.	You
Main Time	Status	Outlet Me	ters Eve		Configure Cont	rol
AC Source: Utility Battery Status:	Status:	UPS current s	tatus (update	e every 30 secor	ıds)	
Normal	OPS Co	omm Disconnect	0	UPS System Of	f	
	🥥 Buzzer	Alarm	۲	Output Bad		
	le 🖉 🖉	l	۲	Output Off		
	Ø Battery	Low	۲	Fan Failure		
	Ø Battery	Depleted	۲	Fuse Break		
UPSenity	Ø Battery	Need Replace	۲	Inverter Bad		
Wab	ille 🏈 Test In	Progress	۲	Charger Bad		
	🎯 Overlo	ad	۲	Bypass Bad		
	🎯 Overhe	at	۲	Awaiting Powe		
	🎯 UPS Fa	ult	۲	Economic Mod	e	

will then be able to see the UPS information. You can change the network port number to prevent conflict with other WEB server programs. If the port number isn't 80 you have to type URL like this: http://172.16.176.141:2000 where 2000 is the port number you assigned.



Bulldog Plus Monitor Operations

The Main Screen has 7 areas that present information on the operating status of your UPS. These areas are discussed in the following sections.

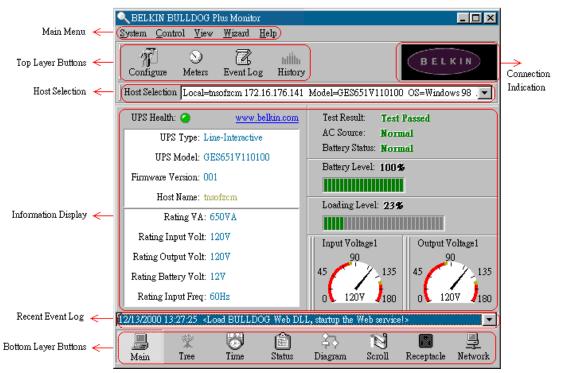

Host Selection: Press the combo box to select hosts that runs Bulldog Plus in the LAN. Users can monitor or control the UPS remotely (password is needed).

Connection Indication: The logo will rotate while the communication between Bulldog Monitor and Bulldog Service is established.

Information Display: Press Bottom Layer Buttons to change the information that is displayed in this area.

Recent Event Log: Preserve last 10 event logs in the combo box, click on the combo box to pull down and view the logs.

Top Layer Buttons

These buttons are used to increase the speed of your operation, refer to the dialog boxes in the menu.



Configuration: Same as the System-> Configuration in the menu. Meters: Same as the View-> Meters in the menu.





Event Log: Same as the View-> Event Log in the menu. History Graph: Same as the View-> History Graph in the menu.

Bulldog Monitor Main Menu

The Main Screen has a menu bar at the top with 5 main options:

<u>System Control V</u>iew <u>W</u>izard <u>H</u>elp

 System: This menu allows you to set the Bulldog Plus and computer parameters.

- Control: This menu allows you to set UPS buzzer, outlet, and test.
- View: The View menu allows you to see the real-time values and history event or history data.
- Wizard: Directs users to configure the most frequent use of settings, the wizard guides users step-by-step to finish their configuration.

• Help: The Help menu allows you to access the online help system.



System

The system menu allows you to configure the UPS and the monitoring screen parameters. When you select the System menu from Main Menu bar, a drop down menu appears offering you the following menu options:

System	<u>C</u> ontrol	View		
Logi	n			
Configuration				
Monitor Screen				
Font 🕨				
Win	dow			
Clos	e Monitor			
<u></u> 103	c hieffior			

Login: Used for Remote Monitor. User must enter the password verification before he can control or configure the UPS.

Configuration: The Configuration menu allows you to tailor various Bulldog Plus parameters.

Monitor Screen: Allows you to change displayed item in the Scroll Screen of Information Display Area.

Font: Sets the font size. Bulldog Plus will resize the window automatically. **Window**: This menu allows you to change the displayed items in the Information Display Area. The items in the menu refer to each button in the Bottom Layer Buttons.

Close Monitor: Stops Bulldog Monitor.

Login

Password	X	
Password:		

QK	Qancel	

When attempting to use Bulldog Monitor as a Remote Monitor (connect to different host) you have to enter the password for verification if you want to do such tasks as configurations, or to control the UPS. Otherwise, you can only view the UPS information.

If user runs Bulldog Service and Bulldog Monitor on the same computer, you can perform such configurations or control the UPS without the



password.

To change your password, please choose the Set Password option from Configure - Network menu

Monitor Screen

This dialog box allows you to change displayed items in the Scroll screen of the Information Display Area

Main Screen		×
	Language: English	•
	Meters: Input Voltage1 💽 Output Voltage1	•
	Step: 1 Second(s)	
	Scroll Window: 💿 LO Voltage	
	O 1/O Frequency	
	○ Batt Voltage	
	🔿 I/O Current	
	<u>O</u> K <u>Cancel</u>	

Language: Choose a language that suits your operating system needs. Program will automatically replace the on-line help file and audio files to your selected preferences.

Meters: Press the Main button from the Bottom Layer Buttons, and you will see that there are two meters in the information area. You can change the displayed items of the two meters.

Scroll Window: Press the Scroll button from the Bottom Layer Buttons, and the scroll window will display the information in this area. This item allows you to change the display menu and its items.

Font

This menu allows you to change the font size of Bulldog Monitor window.

Window

This menu allows you to change the display items in the Information Display Area. The items in the menu refer to each button in the Bottom Layer Buttons.



Close Monitor

Close Bulldog Monitor and leave Bulldog Service running.



Configuration

🔍 BELKIN	BULLDOG Plus Configure
<u>D</u> evices <u>U</u>	PS <u>N</u> etwork
1	BULLDOG Plus Configuration Window
Ţ	UPS Communication Port: COM2
e	Next UPS Test Date/Time: 12/06/2001 12:00
e	Next UPS Shutdown Date/Time: 12/05/2001 20:00
O °	Next UPS Restart Date/Time: 12/06/2001 08:00
<u></u>	Local Host IP: 172.16.176.141
₽ _	BULLDOG Service Mode: Master
4	Remote Host IP:

The Configuration Screen has a menu bar at the top with three main options:

Devices: This menu allows you to configure the modem, pager and e-mail applications.

UPS: The UPS menu allows you to plan and set the UPS schedule or perform the Action...

Network: This menu allows you to choose the Master/Slave settings or configure SNMP, HTTP functions.

Configuration Window

UPS Communication Port: COM1, ... COM4, USB. Next UPS Test Date/Time: The date of the next user-initiated UPS self test. Setting from System->Configuration->UPS->Schedule. Next UPS Shutdown Date/Time: This field displays the date of the next shutdown the computer and UPS. Setting from System->Configuration->UPS->Schedule. Next UPS Restart Date/Time: The date of the next restart UPS. Setting from System->Configuration->UPS->Schedule. Local Host IP: IP address of a computer, which runs Bulldog Monitor.



Bulldog Service Mode: Bulldog Service acts as a Master or Slave. Remote Host IP: The host, which runs Bulldog Service. If Bulldog Monitor and Bulldog Service runs on the same computer and this field will be empty.



Devices

Notification Users -- Pager List

Program will set the modem to notify all via the pager numbers, which are listed in the pager list. You can input your pager number for your own notification purposes. For example: 060123456 is your pager number, each ',' tells modem to delay 2 seconds, delay time is for setting waiting period for the response signal, before proceeding to transmit to the displayed number 119. 119 will appear in your pager LCD.

To trigger the pager notification you must enable the Pager Action in the Action dialog box.

- a. Add: Add a new pager number.
- b. Modify: Modify the selected pager number.
- c. Delete: Delete the selected pager number.

Notification Users -- e-mail

You can also e-mail users through SMTP when power events occur. To trigger the e-mail notification you must enable the e-mail Action in the Action dialog box.

- a. Add: Add a new user.
- b. Modify: Modify the selected user name.
- c. Delete: Delete the selected user.

Notifify Users -- Network Broadcast

You can also broadcast information to users when a power event has occurred. The broadcast function is associated with Windows Messenger service.

To trigger the broadcasting notification you must enable the Broadcast Action in the Action dialog box.

a. Domain: Enable this item to broadcast to all the users in the domain, otherwise Bulldog Plus will send messages to the hosts that users assign.

- b. Add: Add a new machine name.
- c. Modify: Modify the selected machine name.
- d. Delete: Delete the selected name.

Color

Used to change the screen color.



a. Color Items: This area lets you select an item, which you want to change the color for. The right-top corner will display the current selected color.

- b. Change: Change the color you have selected.
- c. Default: Default setting.
- d. Exit: Close the dialog box.

Close

Close the Configuration window.



UPS

<u>U</u> PS	<u>N</u> etwork
U	PS <u>P</u> roperty
A	ttached <u>D</u> evices
Ŀ	og Management
<u>S</u> c	:hedule
A	ction
<u>S</u> 1	op All Action
V	oltage <u>S</u> ensitivity
T	ransfer Voltage

UPS Property

This dialog box allows you to configure the UPS COM port, battery replacement date, ... etc. Load Warning and Load Severity used to prevent UPS overload (see the UPS hardware user manual). In general, Load Warning will notify the user to reduce the UPS load, Load Severity will shutdown the computer to prevent overload.

a. COM Port: COM1, ...COM4, USB.

b. Load Warning: Load warning.

c. Load Severity: User must reduce UPS load.

d. Last Battery Replacement Date: Records the last battery replacement date.

e. Next Battery Replacement Date: Displays the date of the next battery replacement, Bulldog Plus will notify the user to replace the battery.f. Host Name: Local host name.

Attached Devices

Allows the user to assign the attached device a name. When you're controlling the outlet, Bulldog Plus will let you know which devices you are controlling.

a. Select an Outlet Group: Assigns an outlet group. Please look at the back panel carefully, some outlets may share one control relay, these outlets are called an outlet group. If you turn off the outlet group (for example: outlet1 and outlet2) then the UPS will stop power to the outlet group outlet1and outlet2.

b. Device Name: Assigns the attached devices a name, for example: Outlet Group1 is called Monitor for association with the monitor and Outlet



Group2 is called Computer for association with the CPU. These records can improve the efficiency of your management. Don't forget to press the Update button.

c. Update: Updates your change.

Log Management:

(Please consider the free space in your hard disk)

a. Maximum Event Log Entries: Always Bulldog Plus to preserve less than the assigned entries of event log.

b. Data Log Interval: Time designated for automatic saving of a record of UPS data.

c. Maximum Data Log Storage: It allows you to save how many months UPS data files you wish to keep.

Schedule

This function allows you to shutdown, restart, test and turn on/off outlets. You can schedule up to 6 events. Settings are based on day, week or month and up to a period of 2 years.

Choose the applicable schedule to set whether it be for:

a. One Time: This set schedule is applicable for a single day.

- b. Daily: This set schedule is applicable for every day
- c. Weekly: This set schedule is applicable for once a week period.
- d. Monthly: This set schedule is applicable for once a month period.




SUN	MON	TUE	WED	THR	FRI	SAT	Year:
						1	
2	3	4	5	6	7	8	2001 💌
9	<mark>8</mark> 10	<mark>8</mark> 11			<mark>.</mark> 14	15	Month:
16	<mark>8</mark> 17	<mark>8</mark> 18			<mark>e</mark> 21	22	December 💌
23	24	<mark>8</mark> 25	26	27	<mark>8</mark> 28	29	_
30	<mark>8</mark> 31						E <u>x</u> it
Restart					3 🖵 :	00 💌	Applicable:
10 Secon					2 • :	00 💌	One Time
	'n			_ 2() 🔽 :	00 💌	Daily
Shutdow) 🗣 :	00 -	
Shutdow None							- Weekly
) 🖵 :	00 🖵	

Action

The action menu provides you with a list of events to choose from. The event and/or any combination of these actions can be selected from the Choose Event list box. Actions that are already enabled will show a check mark. To delay the actions, set the desired time for delay in the Delay combo box.



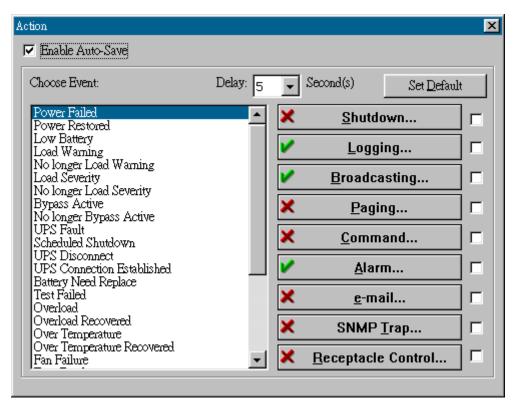

a. Enable Auto-Save: Bulldog Plus will save opened files and close applications automatically when you enable this function.

b. Choose Event: When you select one item in the list the action buttons will display current settings. Press button to do further configurations.

c. Set Default: Sets all the actions to default values.

d. Delay: The power event must stay within the delay time to trigger actions.

Action - Shutdown:

Shutdown/Hibernate/Suspend the operating system or shutdown UPS. If you select the shutdown item Bulldog Plus will execute or ignore the Auto-Save function depending on your selection in the Action dialog box. But if you select the "suspend" or "hibernate" item, the program will ignore the Auto-Save function.

The action of "shutdown", "hibernate" or "suspend" are the same as if you select the Shutdown Option from the Windows Start menu.

Action - Logging:

Allows you to log events as well as modify the default logging message. You can see this message in the Event Log dialog box.



Action - Broadcasting:

Permits you to broadcast an event based on a set period of time. If you want to be notified once, set the time period to "0". However, if you want to be notified more than once, set the time period to a larger number. Each number corresponds to the number of times of notification.

Action - Paging:

Allows you to set the time period for paging intervals. If you want to be notified once, set the time period to "0". However, if you want to be notified more than once, set the time period to a larger number. Each number corresponds to the number of times of notification.

Action- Command:

Permits you to execute command files and set a period of time to delay its activation. To test this function, you can click the Test button. To enable or disable this action, mark the Enable Command check box.

Action - Alarm:

Permits you to send out audible alarm instead of a broadcast message. There are two alarms to select from - Buzzer and Audio. If you choose Audio, the Bulldog Plus requires a ".wav" file to emit the alarm. You can browse your system for other ".wav" files by clicking on the Browse button. If you want to be notified once, set the time period to "0". However, if you want to be notified more than once, set the time period to a larger number. Each number corresponds to the number of times of notification.

Action - e-mail:

Permits you to send e-mails through SMTP. If you want to be notified once, set the time period to "0". However if you want to be notified more than once, set the time period to a larger number. Each number corresponds to the number of times of notification. You can edit the user list by clicking the Edit list button, and add, modify or delete any user name in the list. To enable or disable this action, mark the Enable e-mail check box.

Action - SNMP Trap:

Lets you send a SNMP trap when the relative power event occurs. To enable or disable this action, mark the Enable SNMP Trap check box.



You also need to specify the SNMP Trap target hosts and community string, please see the SNMP dialog box in the Network menu.

Action - Receptacle Control:

Allows you to control the Receptacle Relay on or off. Each Receptacle Relay may control not only one outlet, please see the rear panel of your UPS or the UPS hardware user's manual.

Stop All Action

Clicking on this, terminates all the actions immediately.

Voltage Sensitivity

Adjusts the UPS voltage sensitivity.

Transfer Voltage

Changes the low transfer voltage and high transfer voltage. This function lets your UPS adjust to the local power environment.

a. Low Transfer Voltage: When utility power voltage drops lower than the assigned value the UPS will switch to backup mode. The output power is supplied from the battery.

b. High Transfer Voltage: When utility power voltage rises higher than the assigned value, the UPS will switch to backup mode. The output power is supplied from the battery.



Advanced UPS Property

Ad	Ivanced UPS Property
	Enable Wakeup Computer
	Enable Resume Computer
	🗖 Enable Power Fail, Auto-Reboot
	Enable Economic Mode
	UPS Periodic Auto-Test
	BiWeekly -
	Set <u>D</u> efault <u>O</u> K <u>C</u> ancel

If your UPS doesn't support this function, the item will be displayed as gray and the user cannot select this item.

Enable Wakeup Computer: If your computer architecture is compatible to ATX and the BIOS supports RS-232(RI) Wakeup function. You should enable this item to make the Schedule work correctly.

Enable Resume Computer: Be sure the BIOS supports RS-232(RI) Wakeup function. When Bulldog Plus suspends the computer and the UPS detects the change of power status, the UPS will resume the computer to its prior operating status and let Bulldog Plus notify users.

Enable Power Fail, Auto-Reboot: The time-line describes below,

		1	Power Restore
Input Power	Power Fail		
	Countdown to Sh	utdown PC	
Computer		Shutdown PC	
	Backup	Countdown to	
UPS		Shutdown UPS	
			***UPS Restart to Turn PC on

If you enable this function, the UPS will reboot to restart the computer otherwise, it goes back to its normal state.

Enable Economic Mode: Switches to UPS economic mode.

UPS Periodic Auto-Test: Daily, weekly, biweekly and monthly. UPS starts the test procedure automatically when it reaches the test time.



Network

<u>Network</u> Set <u>P</u>assword.... <u>M</u>aster/Slave... <u>R</u>emote Wakeup... <u>S</u>NMP.... <u>H</u>TTP....

Set Password

Sets the Bulldog Service password.

Choose Master/Slave

Please refer to the BULLDOG Service operation mode. If the computer connects to UPS directly (with RS-232 or USB) and can send commands to its connected UPS then the BULLDOG Service acts as a "Master". If it connects to UPS directly (with RS-232 or USB) but only listens to UPS then it is a "Serial Slave". If the computer is powered by the UPS, but obtains the UPS information from Master via TCP/IP network then it is a "Networking Slave". When BULLDOG Service is a Networking Slave you must assign the Master IP address so that the Networking Slave can connect to the Master and obtain the UPS information.

- a. Master: Configures the BULLDOG Service to be a Master.
- b. Serial Slave: Configures the BULLDOG Service to be a Serial Slave.
- c. Networking Slave: Configures the BULLDOG Service to be a Networking Slave.
- d. Master IP Address: When BULLDOG Service is a Networking Slave you must assign the Master IP address so that the Slave can connect to the Master host and obtain the UPS information.



Choose Master/Slave	×
Master	
🔿 Serial Slave	
O Networking Slave	
Master IP Address:	
172 16 176 149	
QK Qancel	

Wake On LAN

To wake up the remote host, Bulldog Plus sends notification through the network. You must provide the IP address and the network hardware address of the remote host. In Windows98, you can execute the "ipconfig /All" command under the MS-DOS prompt to obtain the network cards physical address of the local host. Or, input the "arp -a" command to see the remote host's physical address. Your network card must support the remote wakeup feature and this function should be enabled.

Wake On LAN Edit
Host IP Address:
172 16 176 146
Network Card Hardware Address:(In Hex)
00 - c0 - 02 - 17 - 21 - 10
Wake me up when
SENTRY BULLDOG Plus Resume The Computer From Suspend Mode
Each Time SENTRY BULLDOG Plus Startup
<u>OK</u> <u>Cancel</u>

a Bulldog Plus Resume The Computer From Suspend Mode: BulldogPlus will reinstate the computer into normal mode, and the program willawaken the remote hosts once the actions have been enabled.b. Each Time Bulldog Plus Startup: Program will wake up the remotehosts which are enabled when Bulldog Plus starts and is connected tothe UPS.



SNMP

If you are using a Windows 95/98/Me operating system, you can configure the SNMP parameters directly from the Bulldog Plus:

Select the Accept SNMP packet from any hosts, Bulldog Plus will accept all the requested commands and set commands. When you select the Accept SNMP packet from the following hosts, Bulldog Plus receives information only from the hosts that you assigned. Once a power event has occurred and the user enables the SNMP Trap in the Action dialog box, Bulldog Plus will send the SNMP trap to the hosts that are listed in the Trap Target list box. To add, modify or delete the host, click on its respective command button.

SNMP	×
Port Number: 161	QK
System Contact: Jesse System Name: Power UPS	Çancel
 Accept SNMP packet from any hosts 	
C Accept SNMP packet from the following hosts	
Add Modify Delete	
Trap Target	
172.16.176.141 public 172.16.176.142 private	
Add Modify Delete	

If you are using a Windows 2000/XP/2003 operating system, you must install the SNMP Service and configure the SNMP parameters from your operating system:

Bulldog Plus will ignore the values that were set in the SNMP dialog box. To change the parameters of SNMP function, you should install the SNMP Service in the Network option. Select the SNMP Service from the Network option in the Control Panel and click the Property button to do your changes.



SNMP Trap Number:

Variable	Trap No.	Description
dupsCommunicationLost	1	SEVER: Communication with the UPS failed
dupsCommunicationEstablished	2	INFORMATION: Communication with the UPS reestablished
dupsPowerFail	3	WARNING: Power failed! The UPS is operating on battery power
dupsPowerRestored	4	INFORMATION: Power restored! The utility power restored
dupsLowBattery	5	SEVER: The UPS batteries are low and will soon be exhausted
dupsReturnFromLowBattery	6	INFORMATION: The UPS has returned from a low battery condition
dupsLoadWarning	7	INFORMATION: Loading percent of the UPS over the Load Warning
		value
dupsNoLongerLoadWarning	8	INFORMATION: Returned from Load Warning condition
dupsLoadSeverity	9	Warning: Loading percent of the UPS over the Load Severity value
dupsNoLongerLoadSeverity	10	INFORMATION: Returned from Load Severity condition
dupsLoadOnBypass	11	WARNING: The UPS loads on bypass
dupsNoLongerLoadOnBypass	12	INFORMATION: The UPS is not on bypass mod
dupsUPSFault	13	SEVER: A general fault caused in the UPS
dupsBatteryGroundFault	14	SEVER: The UPS battery ground fault
dupsNoLongerBatteryFault	15	INFORMATION: The UPS recovered from battery ground fault
dupsTestInProgress	16	INFORMATION: The UPS test in progress
dupsBatteryTestFail	17	SEVER: The UPS test in progress
dupsFuseFailure	18	SEVER: The UPS fuse failed
dupsFuseRecovered	19	INFORMATION: The UPS fuse recovered
dupsOutputOverload	20	SEVER: The UPS overload
dupsNoLongerOverload	21	INFORMATION: Recovered from UPS overload
dupsOutputOverCurrent	22	SEVER: The UPS output is over current
dupsNoLongerOutputOverCurrent	23	INFORMATION: Recovered from UPS over current
dupsInverterAbnormal	24	SEVER: The UPS inverter is operating abnormally
dupsInverterRecovered	25	SEVER: Recovered from UPS inverter abnormal state
dupsRectifierAbnormal	26	SEVER: The UPS rectifier is operating abnormally
dupsRectifierRecovered	27	INFORMATION: The UPS recovered from abnormal state
dupsReserveAbnormal	28	SEVER: The UPS rectifier is operating abnormally
dupsReserveRecovered	29	INFORMATION: The UPS rectifier is now operating normally
dupsLoadOnReserve	30	INFORMATION: The UPS load on reserve
dupsNoLongerLoadOnReserve	31	INFORMATION: The UPS no longer load on reserve
dupsEnvOverTemperature	32	WARNING: The environment is over normal temperature
DupsNoLongerEnvOverTemperatu	33	INFORMATION: The environment recovered from abnormal
re		temperatures



DupsEnvOverHumidity	34	WARNING: The environment over normal humidity
DupsNoLongerEnvOverHumidity	35	INFORMATION: The environment recovered from abnormal humidity

HTTP

Bulldog Plus supports WEB Server for remote management and to obtain the UPS information. Users can use IE or Communicator to connect with Bulldog Service. Even your computer doesn't have Bulldog Plus installed you can monitor and control your UPS via the network.

HTTP		×
🔽 Enable HT	TP	
HTTP Root:		
E:\tri\bc\UP	Sentry Smart\WWW	/Root
Port Number:		
80	QK	Qancel
·		

a .Enable HTTP: Enable or disable the feature of Web service.

b. HTTP Root: The HTTP root path. All the html and gif files will be located here.


c. Port Number: The default port number is 80 but if there is already one WEB server running you can change Bulldog Service HTTP port number to a different number. At the Internet Browser you can input http://172.16.176.141:2000 in the URL where 2000 is the assigned port number.



Control

Control View Help Shutdown Now... Cancel Shutdown... Turn Receptacle Relay On... Turn Receptacle Relay Off... UPS Audible Alarm On UPS Audible Alarm Off 10 Seconds Test Deep Battery Test Cancel Test

Shutdown Now

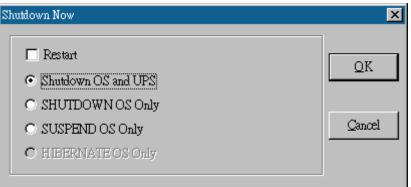

This command will execute the shutdown procedure at once.

a. Restart: This function lets you restart the UPS automatically after being shutdown. To start the UPS for the next schedule, mark the Restart check box.

b. Shutdown OS and UPS: Use this function to shutdown both the OS and UPS.

c. SHUTDOWN OS Only: Use this function to shutdown OS only.

d. SUSPEND OS Only: Use this function to suspend your operating system.

e. HIBERNATE OS Only: Use this function to hibernate your operating system.

Cancel Shutdown

This menu enables you to terminate the current shutdown procedure.



Turn Receptacle Relay On

Turns the selected receptacle relay on. Each Receptacle Relay may control more than one outlet, please see the rear panel of your UPS or the UPS hardware user's manual.

- a. Select a Receptacle Relay: Selects a receptacle relay.
- b. Delay: Set the delay time to turn on the receptacle relay.
- c. On: Executes the stated command.

Turn Receptacle Relay Off

Turns the receptacle relay off. Each Receptacle Relay may control more than one outlet, please see the rear panel of your UPS or the UPS hardware user's manual.

- a. Select a Receptacle Relay: Selects a receptacle relay.
- b. Delay: Set the delay time to turn off the outlet group.
- c. Off: Executes the turn off command.

UPS Audible Alarm On

Enables the UPS buzzer. On the Bottom Layer Buttons press the Status button to get the UPS buzzer status.

UPS Audible Alarm Off

Mutes UPS buzzer alarm.

10 Seconds Test

UPS switches to backup mode and the output power is supplied by the battery for 10 seconds.

Deep Battery Test

UPS switches to backup mode and output power is supplied by the battery until the battery is low.

Cancel Test

This menu allows you to stop the test immediately.




View



Meters

Bulldog Plus supports up to 12 meters of real-time values. Each meter has the ability to display all of the UPS values. Selecting different items from the Selection dialog box will display the selected item value.

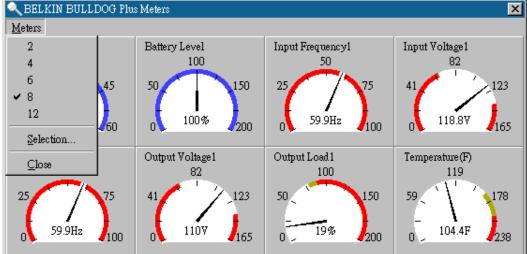

a. 2,4,6,8,12: Displays meter number.

- b. Selection: Assigns each meter to a different UPS item value.
- c. Close: Closes the meter window.

Event Log

This menu offers you the possibility of viewing past events.




112/05/2001 13:55:26 <ups communication="" established!=""> 112/05/2001 13:55:20 <connect to="" ups!=""> 12/05/2001 13:47:23 <ups cannot="" disconnect!="" from="" information="" retrieve="" the="" ups.=""> 112/05/2001 13:47:23 <ups cannot="" disconnect!="" from="" information="" retrieve="" the="" ups.=""> 112/05/2001 13:37:26 <load bulldog="" dll,="" sentry="" service!="" startup="" the="" web=""></load></ups></ups></connect></ups>	lvent Log		
112/05/2001 13:55:26 <ups communication="" established!=""> 112/05/2001 13:55:20 <connect to="" ups!=""> 12/05/2001 13:47:23 <ups cannot="" disconnect!="" from="" information="" retrieve="" the="" ups.=""> 112/05/2001 13:47:23 <ups cannot="" disconnect!="" from="" information="" retrieve="" the="" ups.=""> 112/05/2001 13:37:26 <load bulldog="" dll,="" sentry="" service!="" startup="" the="" web=""></load></ups></ups></connect></ups>	BELKIN S	SENTRY BULLI	DOG Plus Event Log Print Exit
12/05/2001 13:55:20 <connect to="" upsi=""> 12/05/2001 13:47:23 <ups cannot="" disconnect!="" from="" information="" retrieve="" the="" ups.=""> 12/05/2001 13:37:26 <load bulldog="" dll,="" sentry="" service!="" startup="" the="" web=""></load></ups></connect>	Date	Time	
	<u>A</u> 12/05/2001	13:55:20 13:47:23 13:37:26	<connect to="" upsi=""> <ups cannot="" disconnect!="" from="" information="" retrieve="" the="" ups.=""> <load bulldog="" dll,="" sentry="" service!="" startup="" the="" web=""></load></ups></connect>

- a. Print: Prints the event log.
- b. Exit: Closes event log dialog box.

History Graph

Clicking on the History Graph opens a dialog box that contains information about the UPS data in graphical format. This information is available only if there is an accumulation of data. You can select the month and year you want to view.

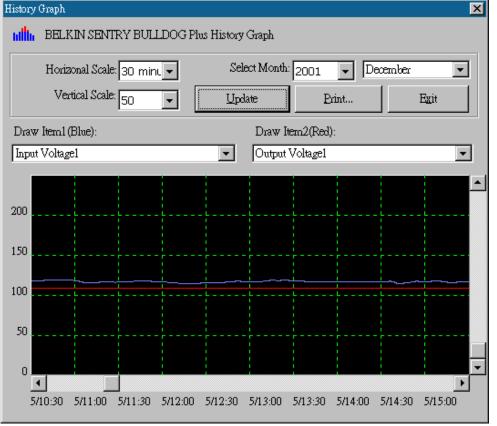



- a. Horizontal Scale: Selects the time scale.
- b. Vertical Scale: Selects the value scale.
- c. Select Month: Displays the UPS data for the month, which you want to see.
- d. Draw Item1(Blue): Displays the UPS item value by a blue line.
- e. Draw Item2(Red): Displays the UPS item value by a red line.
- f. Update: Updates the graph.
- g. Print: Exports the graph to a printer.
- h. Exit: Closes the history graph dialog box.

History Data

Clicking on the History Data opens a dialog box that contains information about UPS data in list format. This information is available only if there is an accumulation of data. You can select the month and year you want to view.

Selec	ted Month: 2	2002 💌	February 💌	Update	Export	Brint Exit	t
	Date	Time	Battery Voltage	Battery Current	Battery Level	Input Frequency1	Ľ
1	02-25-2002				100.0	60.0	
2	02-26-2002	14:30	27.2		100.0	60.0	
3	02-26-2002	14:31	27.2		100.0	60.0	
4	02-26-2002	14:32	27.2		100.0	60.1	
5	02-26-2002	14:33	27.2		100.0	60.0	
6	02-26-2002	14:34	27.2		100.0	60.0	
7	02-26-2002	14:35	27.2		100.0	59.9	
8	02-26-2002	14:36	27.2		100.0	60.0	
9	02-26-2002	14:37	27.2		100.0	60.0	
10	02-26-2002	14:38	27.2		100.0	60.0	
11	02-26-2002	14:39	27.2		100.0	60.0	
12	02-26-2002	14:40	27.2		100.0	60.0	Π,

a. Select Month: Displays the UPS data in the month, which you want to see.

- b. Update: Updates the list.
- c. Save As: Saves the data in the list format to the file that you assigned.
- d. Print: Exports the list data to a printer.
- e. Exit: Closes the history data dialog box.

Auto Save

When certain power events occur, Bulldog Plus will save open files and close applications before shutting down the operating system. If these saved files are untitled, Bulldog Plus will assign file names for them and



put the files in temporary directory. This dialog box will tell you which files were saved by Bulldog Plus.

- a. Program Title: The application's title name.
- b. Auto-Save File Name: Bulldog Plus names the file for you.
- c. Clear: Clear this record.

Remote Hosts

Detects the hosts, which are running the Bulldog Service in the LAN. You can also type in the IP address and connect to the WAN.

Remote Hosts 🛛 🗙
Search Result
🔄 🖳 Host=thsupcfg 172.16.176.62 Model=GES501S110 🛛 OS=Windows 🔼
🖳 Host=thqc 172.16.176.70 Model=Unknown OS=Windows 98 A
🕒 🕒 Local=tnsofzcm 172.16.176.141 Model=BU100XR 2000 OS=Windov
🖲 Host=sun-sparc1 172.16.176.144 Model=GES651V110100 OS=SunOS
🛄 Host=thsof2kas 172.16.176.146 Model=GES651S110 OS=Windows 20
🖲 Host=thsuplpu 172.16.176.59 Model=Unknown OS=Windows 98 A
🚇 Host=thengysf 172.16.176.48 Model=Unknown OS=Windows 98 👘 👘
🚇 Host=thengadd 172.16.176.113 Model=GES501S OS=Windows 98 A 🔤
□ Host-unewoh 172 16 176 152 Model-Unknown OS-I inux 2 2 14-2 0
C Connect To This IP Address
Connect

a. Search Result: The hosts will be listed in the Search Result list box. Select the host you want to connect to and press the Connect button to establish the connection.

b. Connects to this IP address: Bulldog Plus will connect to the IP address, which you type in.

c. Connect: Establish the network connection.



Bottom Layer Buttons

Each button shows the respective information in the Information Area



Main: General Information about the UPS.

Tree: There are 2 sub-trees in the Bulldog Plus tree: System and UPS. The system tree is for host information and the status of Master/Slave connection, the UPS tree is for all other UPS information.

Time: Displays the time for all schedules, battery replacement date and countdown time.

Status: UPS status.

Diagram: Indicates the UPS current flow.

Scroll: UPS data graph.

Outlet: Displays outlet status. (If your UPS cannot control the outlet then this button disappears)

Network: Indicates the connection of Master/Slave, Bulldog Monitor and Bulldog Service.

Main

UPS Health: 3 levels: Green, yellow and red.

UPS Type: On line, off line, line interactive or 3 phase on line.

UPS Model: The UPS model, which is being monitored by Bulldog Plus.

Firmware Version: Indicating the version status of the UPS internal code.

Host Name: The host, which runs Bulldog Plus.

Rating VA: The UPS rating VA.

Rating Input Voltage: The UPS rating input voltage.

Rating Current: The UPS rating current.

Rating Battery Voltage: The UPS rating battery voltage.

Rating Input Frequency: The UPS rating input frequency.

Test Result: Results of the last self-test.

AC Source: Normal, battery or bypass.

Battery Status: The status of battery.

Battery Level: Percentage of battery level.

Loading: Output loading percentage.

Bulldog Plus with the ability to change the display item of the meters, the



referred menu item: System-> Main Screen.

UPS Tree

System: System tree for host information and the connection of Master/Slave.

UPS: UPS tree for all of the UPS information.

Time

Last Battery Replacement Date: To change the date of last battery replacement in the System-> Configuration UPS->UPS Property. Next Battery Replacement Date: To change the date of next battery replacement in the System-> Configuration UPS->UPS Property. Next 10 seconds Test Time: System-> Configuration UPS-> Schedule. Next Deep Test Time: System-> Configuration UPS-> Schedule. Next Shutdown UPS Time: system->Configuration UPS-> Schedule. Next Restart UPS Time: System-> Configuration UPS-> Schedule.

Status

Shows all of the UPS statuses, red light indicates this event happened.

Diagram

Input and output power flow of UPS.

Scroll

Records the most recent UPS data information. You can change the displayed item from System->Main Screen.

Outlet

Displays the UPS outlet status (If your UPS cannot control the outlet this button disappears).

Status: Identifies the current outlet status: Normal or shut. Next Turn Off Time: System->Configuration->UPS->Schedule Next Turn On time: System->Configuration->UPS->Schedule

Network

Displays all the Bulldog Services searched in the LAN.



Service and Support

Corporate Headquarters

Belkin Corporation 501 West Walnut Street Compton • CA • 90220-5221 • USA Tel: 310.898.1100 Fax: 310.898.1111

Customer Service/Sales: 800.2BELKIN 800.223.5546

Technical Support: 310.898.1100 ext. 2263 800.223.5546 ext. 2263 Fax: 310.604.2089 techsupp@belkin.com belkin.com/support/tech

United Kingdom

Belkin Components, Ltd. Express Business Park Shipton Way • Rushden • NN10 6GL United Kingdom Tel: +44 (0) 1933 35 2000 Fax: +44 (0) 1933 31 2000

France

Belkin SAS Components 5 rue du Petit Robinson 78 350 Jouy en Josas • France Tel: +33 (0) 1 34 58 14 00 Fax: +33 (0) 1 39 46 62 89

Germany

Belkin Components GmbH Hanebergstrasse 2

Belkin Components

80637 • München • Germany Tel: +49 (0) 89 143405 0 Fax: +49 (0) 89 143405 100

The Netherlands

Belkin Components B.V. Starparc Building • Boeing Avenue 333 1119 PH Schiphol-Rijk • The Netherlands Tel: +31 (0) 20 654 7300 Fax: +31 (0) 20 654 7349

European Customer Service/Sales: 00 800 223 55 460 eurosales@belkin.com

European Tech Support: 00 800 223 55 460 eurosupport@belkin.com

Australia

Belkin, Ltd. 7 Bowen Crescent • West Gosford • NSW 2250 Australia Tel: +61 (0) 2 4372 8600 Fax: +61 (0) 2 4372 8603

Tech Support: Australia Toll Free 1800 666 040 New Zealand Toll Free 0800 441 913 Singapore Toll Free 800 6161 790 belkin.com/anz

China

Belkin Shanghai Representative Office Suite 31 • 39/F • Plaza 66 1266 Nanjing West Road Shanghai • 200040 • China Tel: 8621-62881747 Fax: 8621-62881748



Customer Service/Sales: china@belkin.com

Tech Support: 800-820-5816



Free Manuals Download Website <u>http://myh66.com</u> <u>http://usermanuals.us</u> <u>http://www.somanuals.com</u> <u>http://www.4manuals.cc</u> <u>http://www.4manuals.cc</u> <u>http://www.4manuals.cc</u> <u>http://www.4manuals.com</u> <u>http://www.404manual.com</u> <u>http://www.luxmanual.com</u> <u>http://aubethermostatmanual.com</u> Golf course search by state

http://golfingnear.com Email search by domain

http://emailbydomain.com Auto manuals search

http://auto.somanuals.com TV manuals search

http://tv.somanuals.com