



# Tools and materials

The following tools are required for installation:

- Phillips screwdriver
- 10-mm hex-nut driver

The following items are supplied with the rack:

- Screws
- Hex nuts
- Cage nuts
- Cage nut-fitting tool

## Selecting a site

**⚠ WARNING: To prevent fire or electric shock, install the unit in a temperature- and humidity-controlled indoor environment, free of conductive contaminants.**

When selecting a site, consider the following factors:

- Elevated operating ambient temperature—if the equipment is installed in a closed or multi-unit rack assembly, the operating ambient temperature of the rack environment might be greater than room ambient temperature. Install the equipment in an environment compatible with the operating temperature.
- Reduced air flow—in the rack, the rate of air flow required for safe operation of the equipment must not be compromised.
- Circuit overloading—consideration should be given to the connection of the equipment to the supply circuit and the effect that overloading of the circuits might have on overcurrent protection and supply wiring. Appropriate consideration of equipment nameplate ratings should be used when addressing this concern.
- Reliable earthing—reliable earthing of rack-mounted equipment should be maintained. Particular attention should be given to supply connections other than direct connections to the branch circuit, such as the use of power strips.
- Electrical requirements—all models require a dedicated (unshared) branch circuit, suitably rated for the specific UPS as stated in "Input specifications" in the user guide.

## Readying the equipment

1. Check the battery recharge date specified on the label that is affixed to the shipping carton.



**IMPORTANT:** Do not use the battery if the recharge date has passed. If the date on the battery recharge date label has passed without the battery being recharged, contact an HP authorized service representative for directions.

2. Transport the packaged unit to its installation location.
3. Unpack the equipment near the rack where the unit will be assembled.



**CAUTION:** Always plan the rack installation so that the heaviest item is on the bottom of the rack. Install the heaviest item first, and continue to populate the rack from the bottom to the top.

## Installing the mounting rails




**⚠ WARNING: To reduce the risk of personal injury or damage to the equipment, be sure that:**

- The leveling feet are extended to the floor.
- The full weight of the rack rests on the leveling feet.
- The stabilizing feet are attached to the rack if it is a single-rack installation.
- The racks are coupled together in multiple-rack installations.
- Only one component is extended at a time. A rack may become unstable if more than one component is extended for any reason.




**NOTE:** Mounting hardware for square- and round-holed racks is included in the UPS kit.


1. Loosen the hex nuts, and extend the brackets to the desired length.

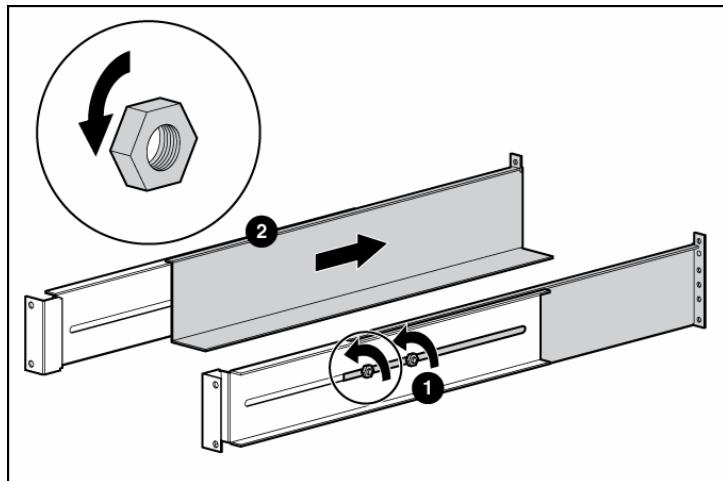


- 2.** Insert screws through the rack into the mounting rail and the front of each mounting bracket.

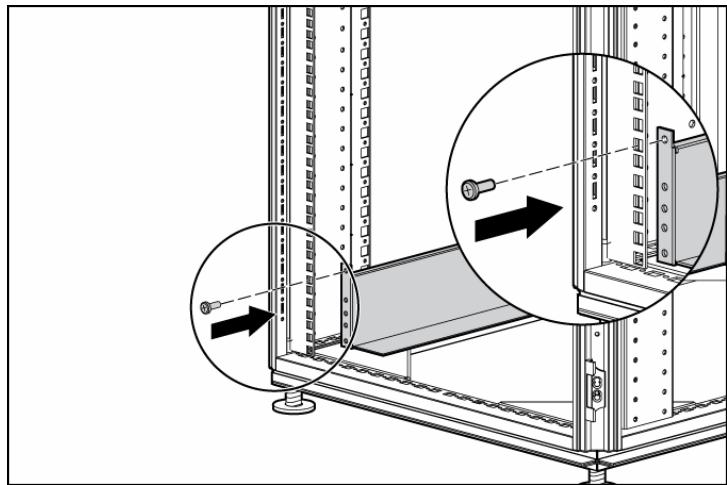


- 3.** Install cage nuts or clip nuts into the rear of the rack.

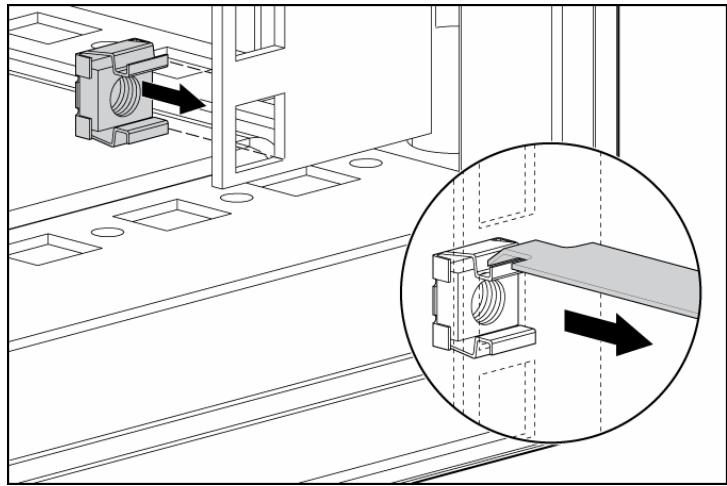

- 4.** Insert screws through the mounting rail into the cage nuts or clip nuts.

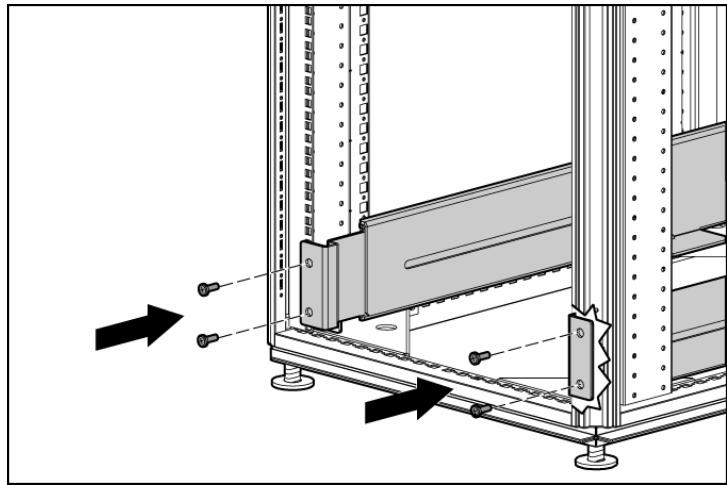


- 5.** Tighten the hex nuts.

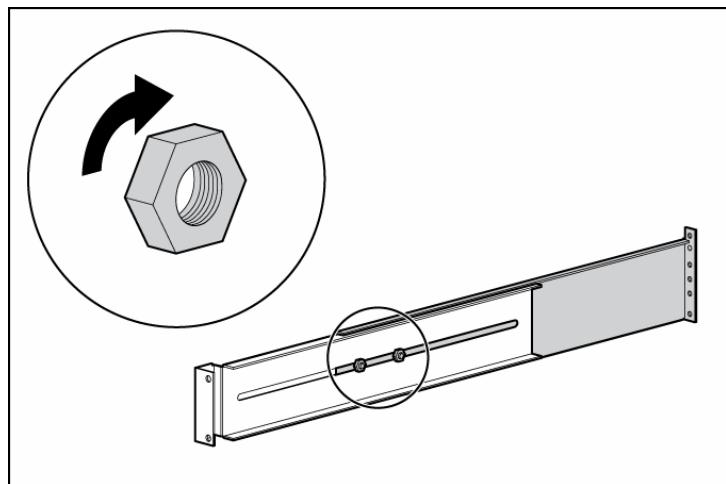

## Preparing the rails for integrated shipping

If the unit is to be shipped in an HP 9000 or 10000 series rack:

1. Remove the hex nuts, flat washers, and lock washers from the mounting rail.
2. Install the rail reinforcement plates and tighten using the hex nuts with captive washers included in the kit, instead of the nuts included with the rail.
3. Install the rear mounting brackets using hex nuts. Wait until the unit is installed and the brackets are adjusted before tightening the nuts.

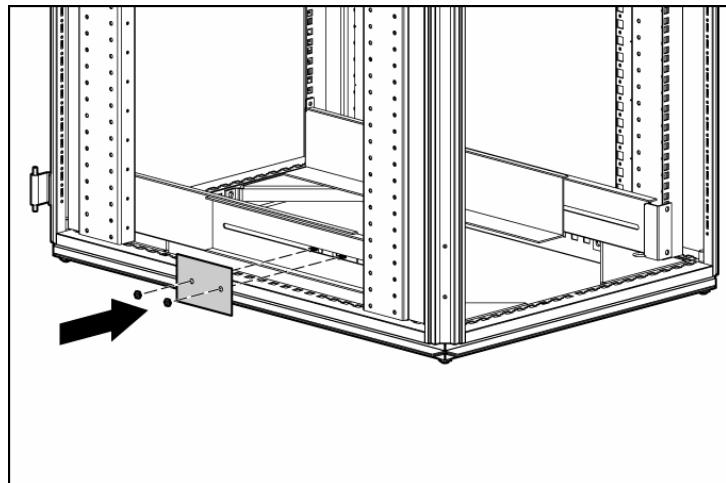


# Powering down the UPS

1. Shut down all load devices.
2. Press the Standby button to take the UPS out of Operate mode. Power to the load receptacles ceases.
3. Disconnect the UPS from utility power.
4. Wait at least 60 seconds for the UPS internal circuitry to discharge.

## Switching off the ERM circuit breaker

**⚠ WARNING: To prevent personal injury from electric shock or damage to the equipment, verify that the circuit breaker is in the Off position.**

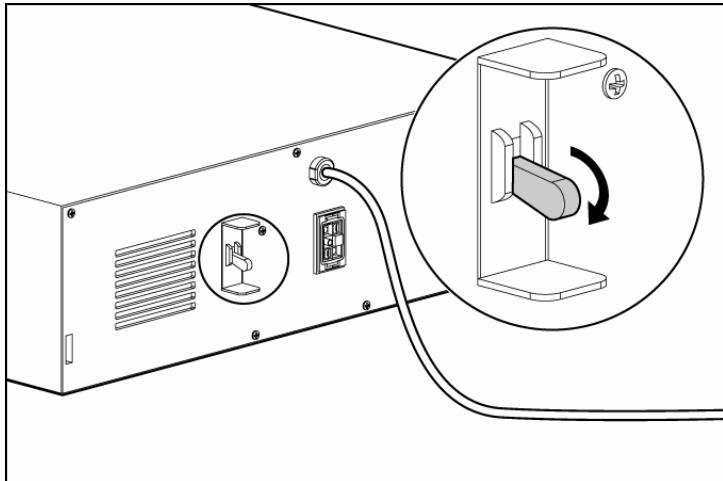

## Installing the ERM


Before installing the ERM, review and observe all warnings in "Precautions (on page 1)."

**⚠ WARNING: Uneven mechanical loading in the rack may cause a hazardous condition.**

**⚠ CAUTION:** Always plan the rack installation so that the heaviest item is on the bottom of the rack. Install the heaviest item first, and continue to populate the rack from the bottom to the top.


1. Install the mounting rails ("Installing the mounting rails" on page 2).
2. With one person on each side of the carton, lift the chassis and lower it to the floor in front of the rack.

3. Install the mounting ears on the chassis using the screws provided.

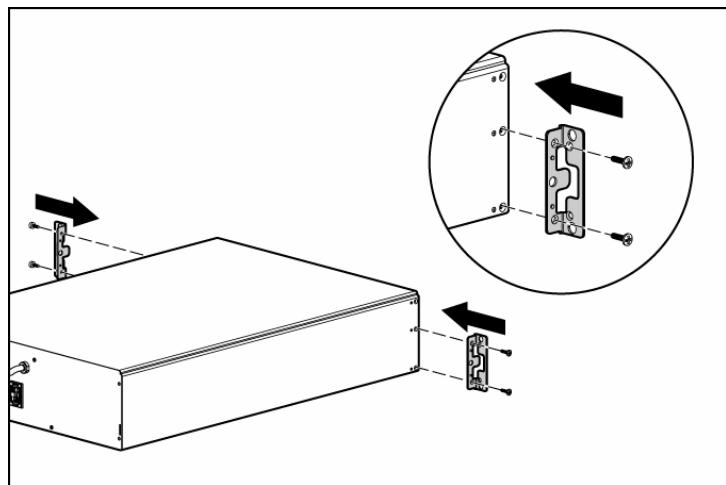


4. With one person on each side, lift the chassis to rail level and slide the chassis on the mounting rails.
5. Attach the chassis to the rack using the supplied screws.
6. If using the rear mounting brackets, be sure that the bracket tabs are fully inserted into the rear panel cutouts, then tighten the brackets.

## Attaching the ERM front bezel

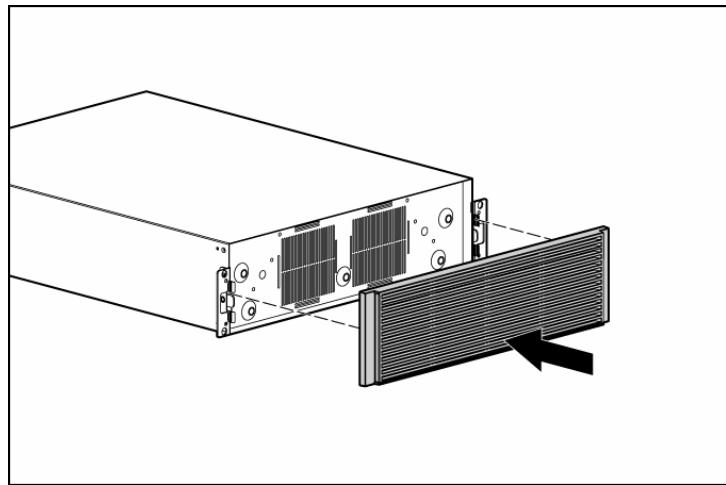


## Connecting the ERM to the UPS

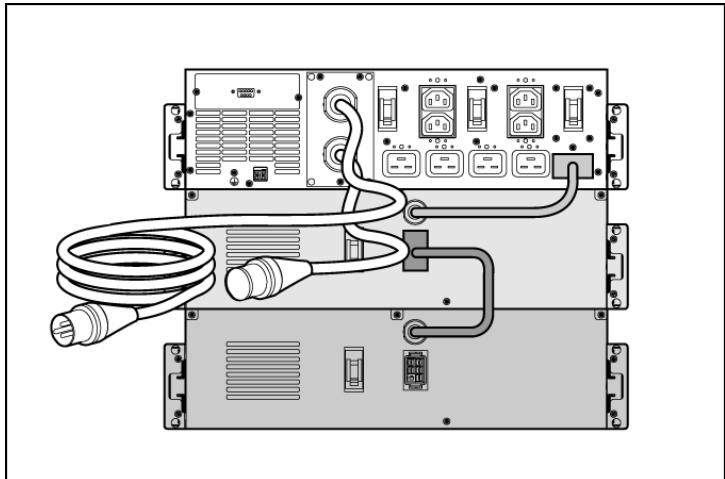

**NOTE:** To install a second ERM, plug the cable from the second ERM into the socket at the rear of the first ERM. Up to two ERM units can be connected.

## Switching on the ERM circuit breaker

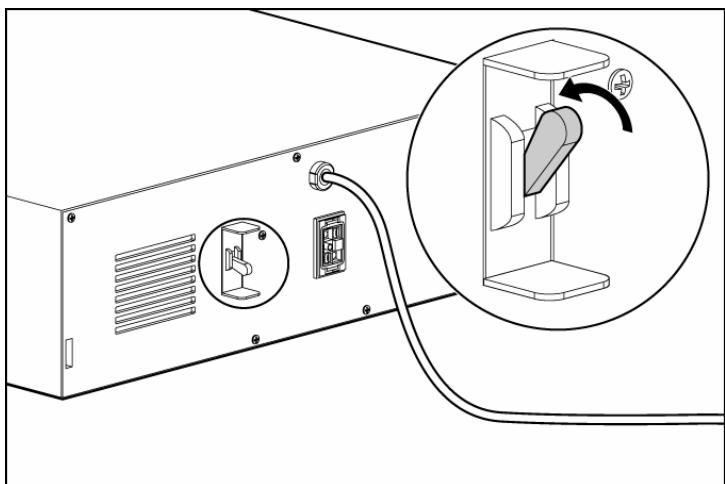

## Charging the ERM batteries

Connect the UPS to a grounded utility power outlet. When the UPS is plugged in, it automatically enters Standby mode and begins charging the ERM batteries. With the UPS in Standby mode, allow the ERM batteries to charge for at least 24 hours before putting the UPS into service.

**CAUTION:** To ensure maximum runtime, be sure to configure the UPS for the number of installed ERMs using the UPS front panel controls.

## Configuring the UPS

After the ERMs are installed, place the UPS in Configure mode, and use the UPS front panel controls and LED indicators to configure the UPS for the number of attached ERMs. Other UPS parameters that can also be configured are the nominal utility voltage level and Site Wiring Fault detection.

In Configure mode, the LED front panel display changes function to enable modification of the UPS parameters. Each LED is associated with a different parameter.

Available settings	Parameter	Associated LED	Explanation (when LED is illuminated)
Nominal Voltage Setting	200/208 Nom	General Alarm (red)	Nominal utility voltage level is set to 200/208 VAC (factory default for 326529-D71)
	220 Nom	On Battery (red)	Nominal utility voltage level is set to 220 VAC
	230 Nom	Battery Fault (red)	Nominal utility voltage level is set to 230 VAC (factory default for 326529-B31)
	240 Nom	Site Wiring Fault (red)	Nominal utility voltage level is set to 240 VAC
Wiring Fault Setting	Wiring Fault	Utility (green)	Audible alarm sounds when ground is missing or line and neutral connections are reversed
ERM Setting	0 ERMs	0% to 25% load (green)	UPS is configured for no attached ERMs (factory default)
	1 ERM	26% to 50% load (green)	UPS is configured for 1 attached ERM
	2 ERMs	51% to 75% load (green)	UPS is configured for 2 attached ERMs

To change the UPS configuration parameters:

1. Place the UPS in Configure mode.  
The LEDs associated with the currently configured parameters illuminate. A flashing green cursor indicates where you are in the configuration process as you scroll through the available settings.
2. To change the nominal voltage, press the On button to advance the cursor to the LED associated with the appropriate nominal voltage parameter. The selected voltage configuration LED flashes.


- Press the Standby button to select the nominal voltage configuration. The LED associated with the old input voltage parameter turns off, and the LED associated with the new input voltage parameter illuminates solid green.

**NOTE:** Only one nominal utility voltage can be configured. When setting voltage configuration parameters, selecting an On value for any one parameter automatically sets the other possibilities to Off.

- To enable the Wiring Fault parameter, press the On button to advance the cursor to the Utility LED, then press the Standby button. The LED illuminates solid green. This parameter is disabled by default, and should only be enabled for line-to-neutral connections. Enabling this feature for line-to-line power sources causes a false alarm.
- To configure the UPS for the number of connected ERMs, press the On button to advance the cursor to the load LED associated with the number of ERMs attached to the UPS.
- Press the Standby button to select the appropriate ERM configuration. The associated LED illuminates solid green.
- To save the configuration settings and exit Configure mode, press the Test/Alarm Reset button.

**NOTE:** Configure mode times out after 2 minutes. If the Test/Alarm Reset button has not been pressed, any new selections are not saved.


## UPS front panel controls

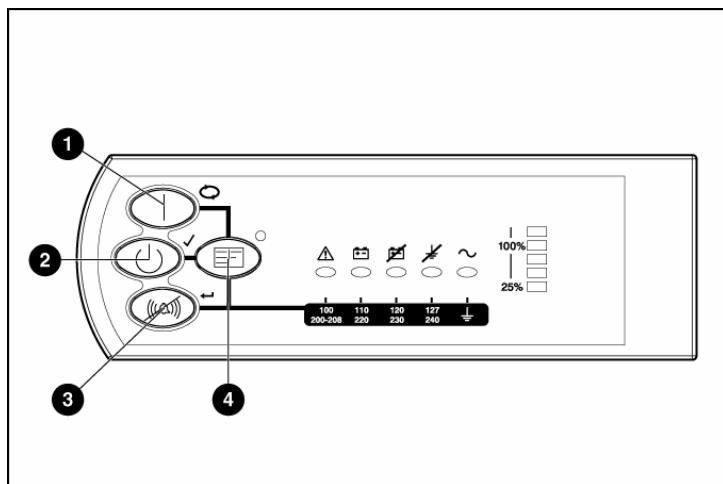

The front panel is shown with the bezel removed.

Item	Description	Function
1	On button	Powers up the UPS
2	Standby button	Places the UPS in Standby mode
3	Test/Alarm Reset button	<ul style="list-style-type: none"> <li>Silences UPS alarms</li> <li>Tests the LEDs</li> </ul>
4	Configure button	Places the UPS in Configure mode

## UPS front panel LED indicators

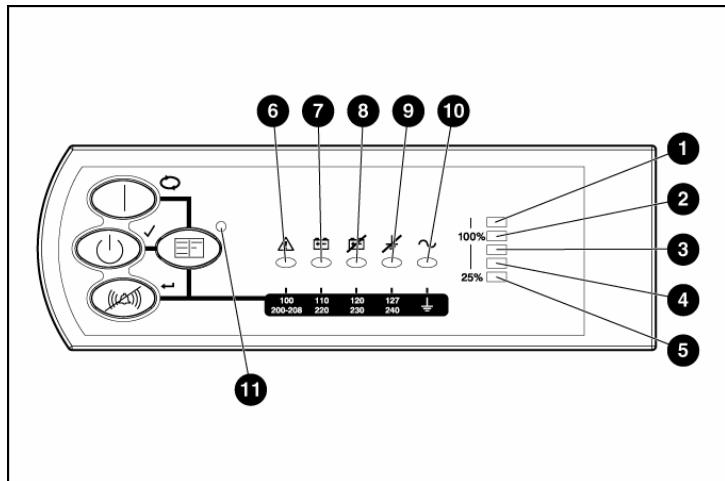

The front panel is shown with the bezel removed.

Item	LED description
1	Overload
2	76% to 100% load
3	51% to 75% load (2 ERMs)
4	26% to 50% load (1 ERM)
5	0% to 25% load (0 ERMs)
6	General Alarm
7	On Battery
8	Battery Fault
9	Site Wiring Fault
10	Utility
11	Configure Mode On

For more information, see "LED and audible alarm troubleshooting" in the user guide.

### Legal notice

© Copyright 2003, 2006 Hewlett-Packard Development Company, L.P.

The information contained herein is subject to change without notice. The only warranties for HP products and services are set forth in the express warranty statements accompanying such products and services. Nothing herein should be construed as constituting an additional warranty. HP shall not be liable for technical or editorial errors or omissions contained herein.

Free Manuals Download Website

<http://myh66.com>

<http://usermanuals.us>

<http://www.somanuals.com>

<http://www.4manuals.cc>

<http://www.manual-lib.com>

<http://www.404manual.com>

<http://www.luxmanual.com>

<http://aubethermostatmanual.com>

Golf course search by state

<http://golfingnear.com>

Email search by domain

<http://emailbydomain.com>

Auto manuals search

<http://auto.somanuals.com>

TV manuals search

<http://tv.somanuals.com>